

ABB INDUSTRIAL DRIVES

DCS880 drives

Hardware manual



DCS880 Drive Manuals

General	Publication number	EN	DE	IT	ES	FR	PL	ZH	RU
DCS880 Quick guide	3ADW000545	EN	DE	IT	ES	FR			
Safety instructions all languages	3ADW000481	EN	DE	IT	ES	FR	PL	ZH	RU
DCS880 Manual set	-	EN							
DCS880 Units									
DCS880 Flyer	3ADW000475	EN	DE	IT	ES	FR		ZH	RU
DCS880 Technical catalog	3ADW000465	EN	DE	IT	ES	FR	PL	ZH	RU
DCS880 Hardware manual	3ADW000462	EN	DE	IT	ES	FR	PL		RU
DCS880 Firmware manual	3ADW000474	EN	DE	IT	ES	FR	PL		RU
DCS880 Service manual	3ADW000488	EN							
DCS880 Hardparallel manual (on request only)	3ADW000530	EN							
DCS880 12-pulse manual	3ADW000533	EN							
DCS880 Current measurement aid (SDCS-CMA-2) manual	3ADW000745	EN							
ACS-AP-x assistant control panels user's manual	3AUA0000085685	EN							
DCS Thyristor power converter – Technical guide	3ADW000163	EN							
DCS880 External DC voltage measurement H1 ... H5	3ADW000601	EN							
Functional safety									
Supplement for functional safety	3ADW000452	EN		IT	ES	FR	PL		RU
FSPS-21 PROFIsafe safety functions module	3AXD50000158638	EN							
FSO-21 Safety functions module	3AXD50000015614	EN							
Functional safety for enclosed converter									
+Q957 Prevention of unexpected Start Up	3ADW000504	EN							
+Q951 Emergency stop, category 0 with MC opening	3ADW000505	EN							
+Q952 Emergency stop, category 1 with MC opening	3ADW000506	EN							
+Q963 Emergency stop, category 0 without MC opening	3ADW000507	EN							
+Q964 Emergency stop, category 1 without MC opening	3ADW000508	EN							
Enclosed converter									
DCS880-A Catalog	3ADW000531	EN							
DCS880-A Installation manual	3ADW000627	EN							
DCS800-A +S880 Enclosed converters, flyer	3ADW000523	EN							
Rebuild and upgrade systems									
DCS880-R Rebuild manual	3ADW000599	EN							
DCS880-U Upgrade manual	3ADW000719	EN							
Door mounting kits									
DPMP-01 mounting platform for ACS-AP control panel	3AUA0000100140	EN							
DPMP-02 mounting platform for ACS-AP control panel	3AUA0000136205	EN							
Serial communication									
FCAN-01 CANopen adapter module	3AFE68615500	EN	DE						
FDNA-01 DeviceNet™ adapter module	3AFE68573360	EN							
FECA-01 EtherCAT adapter module	3AUA0000068940	EN	DE		ES				
FENA-11/-21 Ethernet adapter module	3AUA0000093568	EN						ZH	
FEPL-02 Ethernet POWERLINK adapter module	3AUA0000123527	EN	DE						
FPBA-01 PROFIBUS DP adapter module	3AFE68573271	EN	DE				PL	ZH	
FSCA-01 RS-485 adapter module	3AUA0000109533	EN						ZH	
FDCO-01/02 DDCS communication modules	3AUA0000114058	EN							
FPNO-21 PROFINET fieldbus adapter module	3AXD50000158614	EN							
Tool and maintenance manuals and guides									
Drive Composer PC tool	3AUA0000094606	EN							
Drive application programming (IEC61131-3) manual	3AUA0000127808	EN							
Adaptive programming, Application guide	3AXD50000028574	EN							
NETA-21 remote monitoring tool	3AUA0000096939	EN							
NETA-21 remote monitoring tool guide	3AUA0000096881	EN							
DDCS branching unit NDBU-95 user's manual	3BFE64285513	EN							
Extension modules									
FIO-11 Analog extension module	3AFE68784930	EN	DE	IT					
FIO-01 Digital extension module	3AFE68784921	EN	DE	IT					
FAIO-01 Analog extension module	3AUA0000124968	EN	DE						
FDIO-01 Digital extension module	3AUA0000124966	EN							
FEN-01 TTL encoder interface	3AFE68784603	EN	DE	IT				ZH	
FEN-31 HTL encoder interface	3AUA0000031044	EN						ZH	
FSE-31 pulse encoder interface module user's manual	3AXD50000016597	EN							
FEA-03 F series extension adapter	3AUA0000115811	EN							
Ethernet tool network for ACS880 drives appl. guide	3AUA0000125635	EN							

Table of contents

DCS880 Drive Manuals	2
Safety instructions	8
What this chapter contains	8
To which products this chapter applies	8
Usage of warnings and notes	8
Installation and maintenance work	8
Grounding	9
Printed circuit boards and fiber optic cables	9
Mechanical installation	10
Operation	10
The DCS880	11
Chapter overview	11
The DCS880 converter modules	11
Type code	12
Plus codes	13
Main circuit and control	14
Armature converter DCS880 H1 ... H4	14
Armature converter DCS880 H5	15
Armature converter DCS880 H6	16
Armature converter DCS880 H7 and H8	17
Mechanical installation	18
Chapter overview	18
Safety	18
Examining the installation site	18
Necessary tools	18
Moving the drive	18
Unpacking and examining the delivery (H1 ... H3)	19
Unpacking and examining the delivery (H4)	20
Unpacking and examining the delivery (H5)	21
Unpacking and examining the delivery (H6)	22
Unpacking and examining the delivery (H7, H8)	23
Delivery check	24
Installing the drive (H1 ... H3)	26
Installing the drive (H4, H5)	27
Installing the drive (H6 ... H8)	28
Cabinet installation	28
Terminal options for converter modules size H1 ... H4	29
Connection of H4 converter module DC terminals	29
Terminal cover according to VBG 4 regulations (H1 ... H4 only)	29
Mounting the converter module H5 inside an enclosure	31
Cooling air inlet	31
Cooling air outlet	31
Mounting the H7 power unit inside an enclosure	32
Cooling air inlet	32
Cooling air outlet	32
Cable entries	32
Power cable connection	32
Mounting the H8 power unit inside an enclosure	33
Cooling air inlet	33
Cable entries	33
Cooling air outlet	33

Planning the electrical installation	34
Chapter overview	34
Options	34
Line reactors (L1)	34
Semiconductor fuses (F1)	37
Single-phase autotransformer (T3) for the excitation (adapt voltage).....	41
Line reactors for single- and 3-phase connection of the excitation	42
Auxiliary transformer (T2) for electronic system/fan supply	42
Overvoltage protection at the secondary side of high voltage transformers	43
Example	44
EMC filters (E1).....	45
Converters size H1 ... H4 configuration using an OnBoard field exciter	48
Converters size H5 configuration using FEX-425-Int field exciter	49
Converters size H6 configuration using a FEX-425-Int field exciter	50
Converters size H1 ... H6 configuration using external field exciters DCF803, DCF804.....	51
Converters size H7 and H8 configuration using external field exciters DCF803, DCF804.....	52
Converters size H1 ... H3 as large field exciter	53
Start, Stop and E-Stop control.....	54
1: Generation of the On/Off and Start/Stop commands:	54
2: Generation of control and monitoring signals:	54
3: Off2 (emergency off/electrical disconnect/fast current off) and Off3 (emergency stop):	54
4: DC contactor (US style):.....	55
Cooling fans	56
Fan assignment for DCS880	56
Fan cable sizes and tightening torque connected at the fan terminals	56
Fan data for DCS880 (H1 ... H4)	57
Fan connection for DCS880 (H1 ... H4)	57
Fan data for DCS880 (H5 ... H8).....	58
Fan connection for DCS880 (H5 ... H8).....	59
Monitoring the DCS880 power section.....	59
Implementing thermal overload and short-circuit protection	60
Protecting drive and input power cables in case of short-circuits.....	60
Circuit breakers.....	60
Protecting the motor and motor cable in case of short-circuits	60
Protecting the drive and the input power and motor cables against thermal overload.....	60
Protecting the motor against thermal overload	60
Protecting the drive against ground faults.....	61
Residual current device compatibility	61
Cross-sectional areas - Tightening torques.....	62
Selecting the power cables	63
General rules	63
Additional US requirements	63
Conduit.....	63
Armored cable/shielded power cable	64
Selecting the control cables	64
Connection of a motor temperature sensor to the drive I/O	65
Electrical installation	66
Chapter overview	66
Checking the insulation of the drive	66
IT (ungrounded) systems	67
Supply voltage	67
Connecting the power cables.....	67
Location of F-type adapters and interfaces.....	68

FEA-03 I/O extension adapter configuration	69
Pulse encoder connection	70
Pulse encoder connection principles	71
Connecting the signal and control cables	73
Routing the cables	73
Continuous motor cable shield or enclosure for equipment on the motor cable.....	74
DCSLink wiring	74
Cabling	74
Connecting a control unit at H7 and H8 power units.....	76
Installation checklist	77
Technical data	78
Chapter overview	78
Environmental Conditions.....	78
Sound pressure level and vibration.....	78
North American Standards	78
Regulatory compliance	79
Short Circuit Current Ratio (SCCR).....	79
Current ratings - IEC regenerative converters (S02).....	80
Current ratings - IEC non regenerative converters (S01)	81
Control board SDCS-CON-H01 (H1 ... H8)	82
Location of the control circuit board SDCS-CON-H01	82
Watchdog function.....	82
Recommended wire size - Tightening torques	82
Intermediate cover	83
Control circuit terminal layout	84
XAI: Reference voltages and analog inputs	85
XAO: Analog outputs.....	85
XD2D: Drive-to-drive link	85
RO1, RO2, RO3: Relay outputs.....	86
XD24: Digital interlock	86
XDIO: Digital inputs/outputs	87
XDI: Digital inputs.....	87
XENC: Encoder.....	88
XTAC: Analog tacho	88
XSMC: Mains contactor.....	88
XSTO: Safe torque off	88
X205 Memory unit connection	89
Replacing the memory unit.....	89
Additional terminals.....	89
Ground isolation diagram	90
Jumpers and switches	91
DDCS Interface configuration	92
Ch0 DriveBus or module bus connection to Advant Controller (star).....	92
DDCS branching unit NDBU-95	93
DCSLink board SDCS-DSL-H1x (H1 ... H8)	94
Daisy chain DPI-H01 kit (H1 ... H8).....	95
Contents of the kit	95
Layout	95
Installation	96
Chaining a control panel.....	96
Setting up the firmware	97
Power Interface board SDCS-PIN-H01 (H1 ... H5)	98
Layout SDCS-PIN-H01	98
Technical data	99

Power supply board SDCS-POW-H01 (H6 ... H8)	100
Technical data	100
Field circuit interfaces SDCS-BAB-F01 and SDCS-BAB-F02 (H1 ... H4).....	101
Ratings OnBoard field exciter	101
Cables	101
Layout	101
Location.....	102
Functions	102
Circuit diagrams	103
Measuring board SDCS-PIN-H51 (H6 ... H8)	106
Following connectors are available.....	106
Settings of the SDCS-PIN-H51 for converter sizes H6 ... H8.....	106
Layout of the SDCS-PIN-H51	107
Firing pulse transformer board SDCS-PIN-H41 (H6 ... H8).....	108
Location of the SDCS-PIN-H41.....	108
Layout of the SDCS-PIN-H41	108
Optical power link board SDCS-OPL-H01 (H7, H8).....	109
Following connectors are available.....	109
XSMC: Mains contactor	109
Location of the SDCS-OPL-H01.....	110
Layout of the SDCS-OPL-H01.....	110
Connection between firing board and control board for H6 ... H8	111
Circuit diagrams	112
Galvanic isolation - T90, A92, F11, F90	114
Hardware and firmware settings	114
DC-DC transducer A92 (1)	116
Transformer T90.....	117
Dimensions and weights	118
Size H1	118
Size H2.....	119
Size H3.....	120
600 V Units.....	120
Size H4	121
600 V Units.....	121
Size H5.....	122
Size H6 (classic fan box)	123
Mounting the module size H6 inside a cabinet	123
Size H6 (ErP fan box).....	124
Mounting the module size H6 inside a cabinet	124
Size H7 (+P906)	125
Size H8 left-hand (+P906)	126
Size H8 left-hand (+P906)	127
Size H8 right-hand (+P906).....	128
Size H8 right-hand (+P906).....	129
Branch fuses installed inside converters size H5 ... H8 (type X0).....	130
Branch fuses installed inside converters size H7, (double fuse, type XA)	130
Accessories	132
DCF803-0016, FEX-425-Int and DCF803-0035	132
Layout of the SDCS-FEX-4	132
Cross section FEX-425, DCF803-0016, DCF803-0035	132
Electrical data.....	133
Control unit.....	133

Power part.....	133
DCSLink communication	134
RS232-Port.....	135
Diagnostics	135
DCF803-0016 and DCF803-0035 configuration (H1 ... H8)	136
Dimensions	137
FEX-425-Int configuration (H5).....	137
FEX-425-Int configuration (H6).....	139
DCF803-0050, DCF804-0050, DCF803-0060 and DCF804-0060.....	140
Cross section DCF803-0050, DCF803-0060, DCF804-0050, DCF804-0060	140
Electrical data.....	141
Electronic power supply	141
Control unit.....	142
Power part.....	142
DCSLink communication	143
RS232-Port.....	143
Diagnostics	144
DCF803-0050/0060 and DCF804-0050/0060 configuration (e.g., 2 motors)	145
Dimensions	148
DCF505/DCF506 Overvoltage protection and large field exciters	149
Assignment field supply converter, overvoltage protection and cross-sectional areas	149
Diagram of overvoltage protection DCF505/DCF506.	150
Layout of SDCS-FEP-1 / FEP-2.....	150
Dimensions	151
Fuses and fuse holders IEC	152
Semiconductor fuses and fuse holders for AC and DC power lines	152
Line reactors IEC	153
Line reactors type ND01 ... ND17 (uk = 1 %)	153
Line reactors type ND401 ... ND413 (uk = 4 %).....	157
Autotransformer (T3).....	159
Line reactor (L3)	160
Connection example.....	160
Auxiliary transformer (T2) for converter electronics and fans	161
Supply transformer (T8) for cooling fans.....	162
Dimensions	162
Residual current detection.....	163
Schematic and function principle.....	163
Electrical and mechanical data of the CTs.....	163
Electrical and mechanical data of the SDCS-IOB-4	164
General information about the DCS880 residual current detection	165
Optical cables	168
Other cables	169
DCSLink cable.....	169
Recommended connectors.....	169

Safety instructions

What this chapter contains

This chapter contains the safety instructions you must follow when installing, operating, and servicing the drive.

If ignored, physical injury or death may follow, or damage may occur to the drive, the motor or driven equipment. Read the safety instructions before you work on the unit.

To which products this chapter applies

The information is valid for the whole range of the product DCS880, the converter modules DCS880-S0b size H1 ... H8, field exciter units DCF80x, etc. like the Rebuild Kit DCS880-R00.

Usage of warnings and notes

There are two types of safety instructions throughout this manual: warnings and notes. Warnings caution you about conditions which can result in serious injury or death and/or damage to the equipment, and advice on how to avoid the danger. Notes draw attention to a particular condition or fact or give information on a subject.

The warning symbols are used as follows:



Dangerous voltage warning warns of high voltage which can cause physical injury or death and/or damage to the equipment.



General danger warning warns about conditions, other than those caused by electricity, which can result in physical injury or death and/or damage to the equipment.



Electrostatic sensitive devices warning warns of electrostatic discharge which can damage the equipment.

Installation and maintenance work

These warnings are intended for all who work on the drive, motor cable or motor. Ignoring the instructions can cause physical injury or death and/or damage to the equipment.



WARNING

- **Only qualified electricians are allowed to install and maintain the drive!**
- Never work on the drive, motor cable or motor when main power is applied.
- Always ensure by measuring with a multimeter (impedance at least 1 M Ω) that:
 - 1. Voltage between drive input phases U1, V1 and W1 and the frame is close to 0 V.
 - 2. Voltage between terminals C+ and D- and the frame is close to 0 V.
- Do not work on the control cables when power is applied to the drive or to the external control circuits. Externally supplied control circuits may cause dangerous voltages inside the drive even when the main power on the drive is switched off.
- Do not make any insulation resistance or voltage withstand tests on the drive or drive modules.
- Isolate the motor cables from the drive when testing the insulation resistance or voltage withstand of the cables or the motor.
- When reconnecting the motor cable, always check that the C+ and D- cables are connected with the proper terminal.

Notes:

- The motor cable terminals on the drive are at a dangerously high voltage when the main power is on, regardless of whether the motor is running or not.
- Depending on the external wiring, dangerous voltages (115 V, 220 V or 230 V) may be present on the relay outputs of the drive system (e.g., XRO1 ... XRO3).

- DCS880 with enclosure extension: Before working on the drive, isolate the whole drive system from the supply.

Grounding

These instructions are intended for all who are responsible for the grounding of the drive. Incorrect grounding can cause physical injury, death and/or equipment malfunction and increase electromagnetic interference.



WARNING

- Ground the drive, motor, and adjoining equipment to ensure personnel safety in all circumstances, and to reduce electromagnetic emission and pick-up.
- Make sure that grounding conductors are adequately sized and marked as required by safety regulations.
- In a multiple-drive installation, connect each drive separately to protective earth (PE \oplus).
- Minimize EMC emission and make a 360° high frequency grounding (e.g., conductive sleeves) of screened cable entries at the cabinet lead-through plate.
- Do not install a drive equipped with an EMC filter to an ungrounded power system or a high resistance-grounded ($> 30 \Omega$) power system.

Notes:

- Power cable shields are suitable as equipment grounding conductors only when adequately sized to meet safety regulations.
- As the normal leakage current of the drive is higher than 3.5 mA_{AC} or 10 mA_{DC} a fixed protective earth connection is required.
- This product can cause a DC current in the protective earthing conductor. Where a residual current-operated protective (RCD) or monitoring (RCM) device is used for protection in case of direct or indirect contact, only an RCD or RCM of Type B is allowed on the supply side of this product.


Printed circuit boards and fiber optic cables

These instructions are intended for all who handle the circuit boards and fiber optic cables. Ignoring the following instructions can cause damage to the equipment.



WARNING

- The printed circuit boards contain components sensitive to electrostatic discharge. Wear a grounding wrist band when handling the boards. Do not touch the boards unnecessarily.
- Use grounding strip:

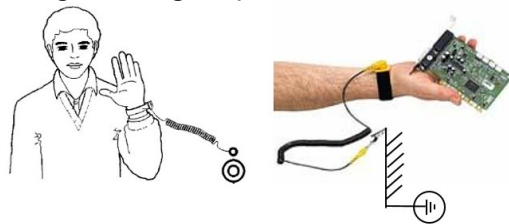

- ABB order no.: 3ADV050035P0001



WARNING

- Handle the fiber optic cables with care.
- When unplugging optic cables, always grab the connector, not the cable itself.
- Do not touch the ends of the fibers with bare hands as the fiber is extremely sensitive to dirt.
- The minimum allowed bend radius is 35 mm (1.38 in.).

Mechanical installation

These notes are intended for all who install the drive. Handle the unit carefully to avoid damage and injury.



WARNING



- DCS880 sizes H4 ... H8:
 - The drive is heavy. Lift the drive by lifting lugs only.
 - The drive's center of gravity is high. Do not tilt the drive. The drive will overturn from a tilt of about 6 degrees. An overturning drive can cause physical injury.
 - Do not lift the drive by the front cover.
 - Place drives H4 ... H6 only on their back.
- Make sure that dust from drilling does not enter the drive when installing. Electrically conductive dust inside the unit may cause damage or lead to malfunction.
- Ensure sufficient cooling.
- Do not fasten the drive by riveting or welding.

Operation


These warnings are intended for all who plan the operation of the drive or operate the drive. Ignoring the instructions can cause physical injury or death and/or damage to the equipment.



WARNING

- Before adjusting the drive and putting it into service, make sure that the motor and all driven equipment are suitable for operation throughout the speed range provided by the drive. The drive can be adjusted to operate the motor at speeds above and below the base speed.
- Do not control the motor with the disconnecting device (disconnecting mains); instead, use the control panel keys  and , or commands via the I/O board of the drive.
- Mains connection:
You can use a disconnect switch (with fuses) to disconnect the electrical components of the drive from the mains for installation and maintenance work. The type of disconnect switch used must be as per EN 60947-3, Class B, so as to comply with EU regulations, or a circuit-breaker type which switches off the load circuit by means of an auxiliary contact causing the breaker's main contacts to open. The mains disconnect must be locked in its "OPEN" position during any installation and maintenance work.
- EMERGENCY STOP buttons must be installed at each control desk and at all other control panels requiring an emergency stop function. Pressing the STOP button on the control panel of the drive will neither cause an emergency stop of the motor, nor will the drive be disconnected from any dangerous potential.
- To avoid unintentional operating states, or to shut the unit down in case of any imminent danger according to the standards in the safety instructions it is not sufficient to merely shut down the drive via signals "RUN", "drive OFF" or "Emergency Stop" respectively "control panel" or "PC tool".
- Intended use:
The operating instructions cannot take into consideration every possible case of configuration, operation, or maintenance. Thus, they mainly give such advice only, which is required by qualified personnel for normal operation of the machines and devices in industrial installations.
If in special cases the electrical machines and devices are intended for use in non-industrial installations - which may require stricter safety regulations (e.g., protection against contact by children or similar) - these additional safety measures for the installation must be provided by the customer during assembly.

Note:

- When the control location is not set to Local (Local not shown in the status row of the display), the stop key on the control panel will not stop the drive. To stop the drive using the control panel, press the Loc/Rem key and then the stop key .

The DCS880

Chapter overview

This chapter briefly describes the operating principle and construction of the converter modules.

The DCS880 converter modules

The DCS880-S size H1 ... H8 are intended for controlling DC motors.



Size H1 ... H5
20 ... 1190 A



Size H6
900 ... 2000 A



Size H7
1900 ... 3000 A



Size H8
2050 ... 5200 A

Type code

The type code contains information on the specification and configuration of the drive. The first digits from left show the basic configuration (e.g., DCS880-S01-2000). The optional selections are given thereafter on the name plate by plus code. The main selections are described below. Not all selections are available for all types.

The drive's basic type code: DCS880-aab-cccc-ddef + plus code		
Product family:	DCS880	
Product type:	aa	= S0 Standard converter module
		= R0 Rebuild kit
		= U1 Upgrade kit
		= A0 Enclosed converter
Bridge type:	b	= 1 Single bridge (2-Q)
		= 2 2 anti-parallel bridges (4-Q)
Module type:	cccc	= Rated DC current (IP00)
Rated AC voltage:	dd	= 04 100 V _{AC} ... 415 V _{AC}
		= 05 100 V _{AC} ... 500 V _{AC} (IEC)/525 V _{AC} (UL)
		= 06 270 V _{AC} ... 600 V _{AC}
		= 07 315 V _{AC} ... 690 V _{AC}
		= 08 360 V _{AC} ... 800 V _{AC}
		= 10 450 V _{AC} ... 990 V _{AC}
		= 12 540 V _{AC} ... 1200 V _{AC}
Power connection:	e	= X Standard H1 ... H7
		= L Left side H8
		= R Right side H8
Revision code:	f	= 0 1 st generation
		= A H7: Double fuse
		= B H5/H6: New cooling fan R2E250-RE04-10
Field exciter configuration:	+0S163	H1 ... H4 without OnBoard field exciter
	+S164	H5 and H6 with internal field exciter, supply external (H5 and H6: 25 A, Rebuild kit: 16 A/25 A)
Fan voltage:	Standard	Size H4 Fan voltage: 230 V/1-ph
Application programming:	+S551	Memory unit including drive application programming license
SDCS-DSL-H10:	+S521	1 DCSLink channel, 0 channels optical power link SDCS-DSL-H10
Voltage measurement:	+S185	SDCS-PIN-H51 configured for 20 V _{AC} ... 100 V _{AC} (H6 ... H8)
Control panel:	+0J404	Without control panel
	+J428	Daisy-chain option DPI-H01 kit
	+J429	Bluetooth control panel ACS-AP-W

The technical data and specifications are valid as of going to press. ABB reserves the right to make subsequent alterations.


Plus codes

Option	Option code	Description
ACS-AP-I	standard	built-in
no ACS-AP-I	0J404	No control panel
ACS-AP-W	+J429	Bluetooth panel
DPI-H01	+J428	Daisy-chain option
FDNA-01	+K451	Fieldbus DeviceNet
FPBA-01	+K454	Fieldbus PROFIBUS
FCAN-01	+K457	Fieldbus CANOpen
FSCA-01	+K458	Fieldbus Modbus
FECA-01	+K469	Fieldbus EtherCat
FEPL-02	+K470	Fieldbus Ethernet POWERLINK
FEIP-21	+K490	Two-Port EtherNet/IP Adapter
FMBT-21	+K491	Two-Port Modbus/TCP Adapter
FPNO-21	+K492	Two-Port PROFINET IO Adapter
FENA-21	+K475	Ethernet/IP, Modbus/TCP, ProfNet
FIO-11	+L500	Analog I/O Extension (3 AI, 1 AO, 2 DIO)
FIO-01	+L501	Digital I/O Extension (4 DIO, 2 RO)
FAIO-01	+L525	Analog I/O Extension (2 AI, 2 AO)
FDIO-01	+L526	Digital I/O Extension (3 DI, 2 RO)
FEN-01	+L517	TTL Encoder interface
FEN-21	+L516	Resolver Interface
FEN-31	+L502	HTL Encoder Interface
FDCO-01	+L503	DDCS communication 10/10 MBd
FDCO-02	+L508	DDCS communication 5/10 MBd
Application programming	+S551	Memory unit including drive application programming license
no OnBoard field exciter	0S163	Excludes OnBoard field exciter (H1 ... H4)
SDCS-DSL-H10	+S521	1 DCSSLink channel, 0 channels optical power link
FSPS-21	+Q986	PROFISAFE Adapter FSPS-21
FSO-21	+Q972	Functional Safety Option
FSE-31	+L521	Functional Safety Encoder

Main circuit and control


Armature converter DCS880 H1 ... H4

400 V and 500 V (IEC)/525 V (UL) units with OnBoard field exciter. 600 V units are always without OnBoard field exciter.

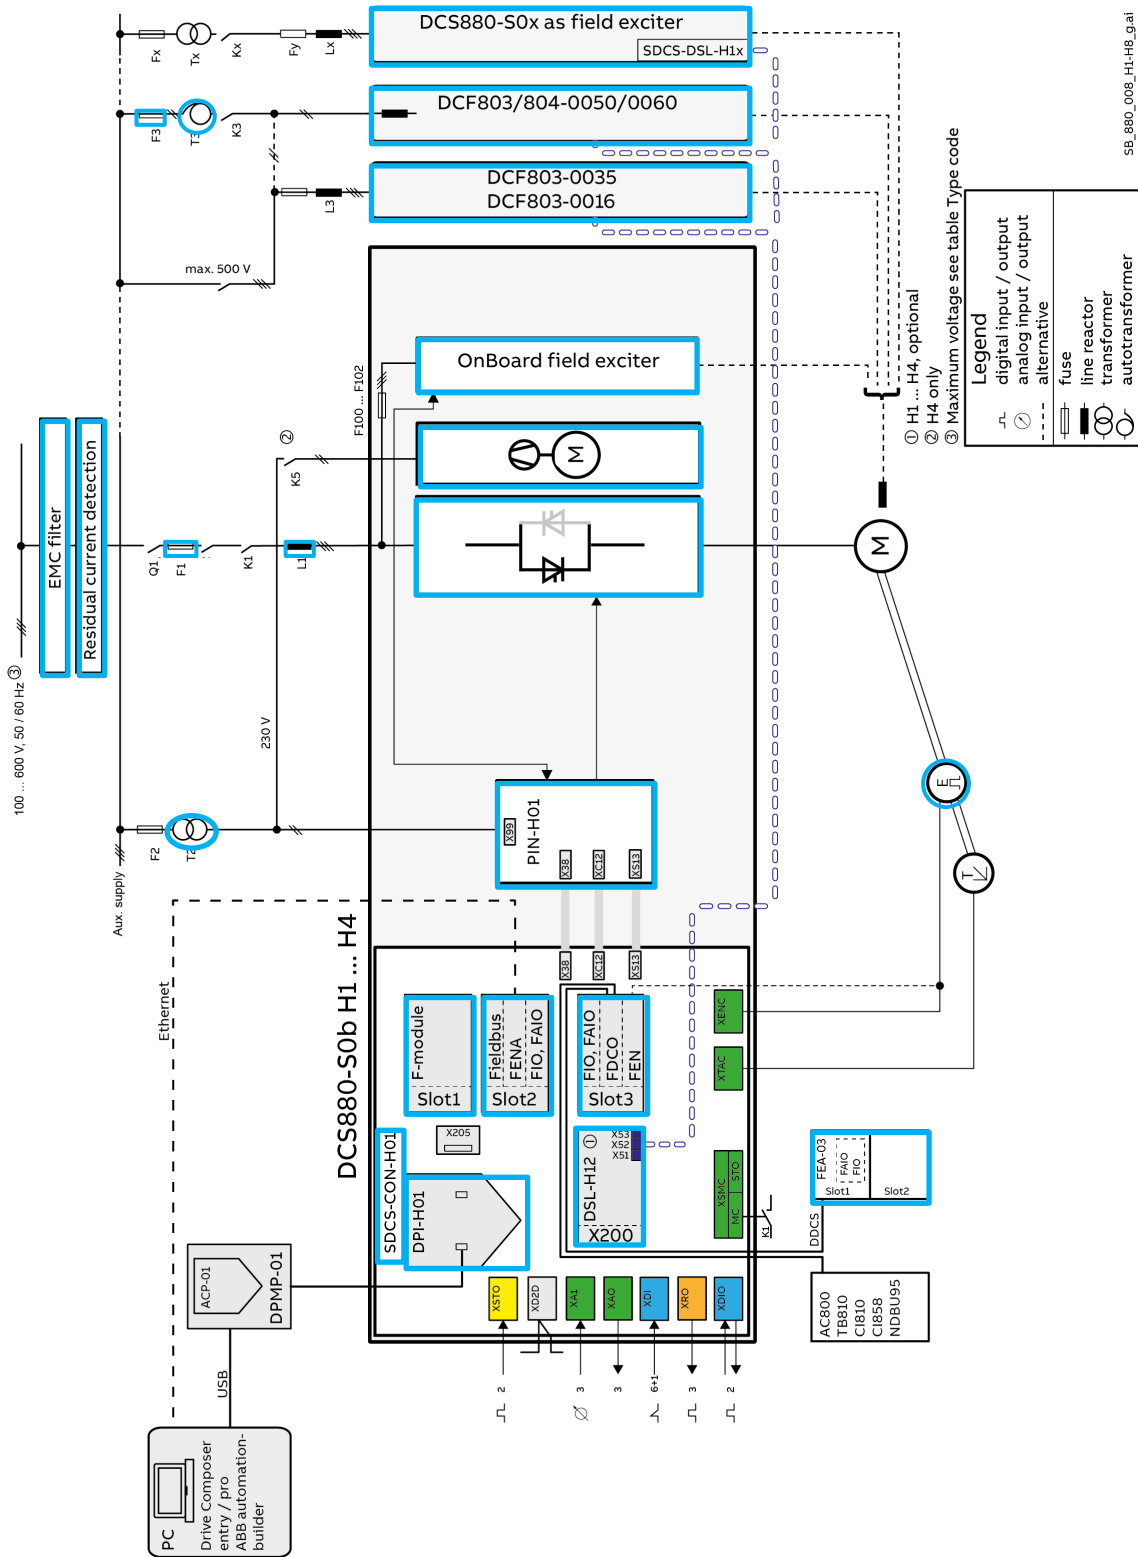


Armature converter DCS880 H5


H5 units with optional internal field exciter.

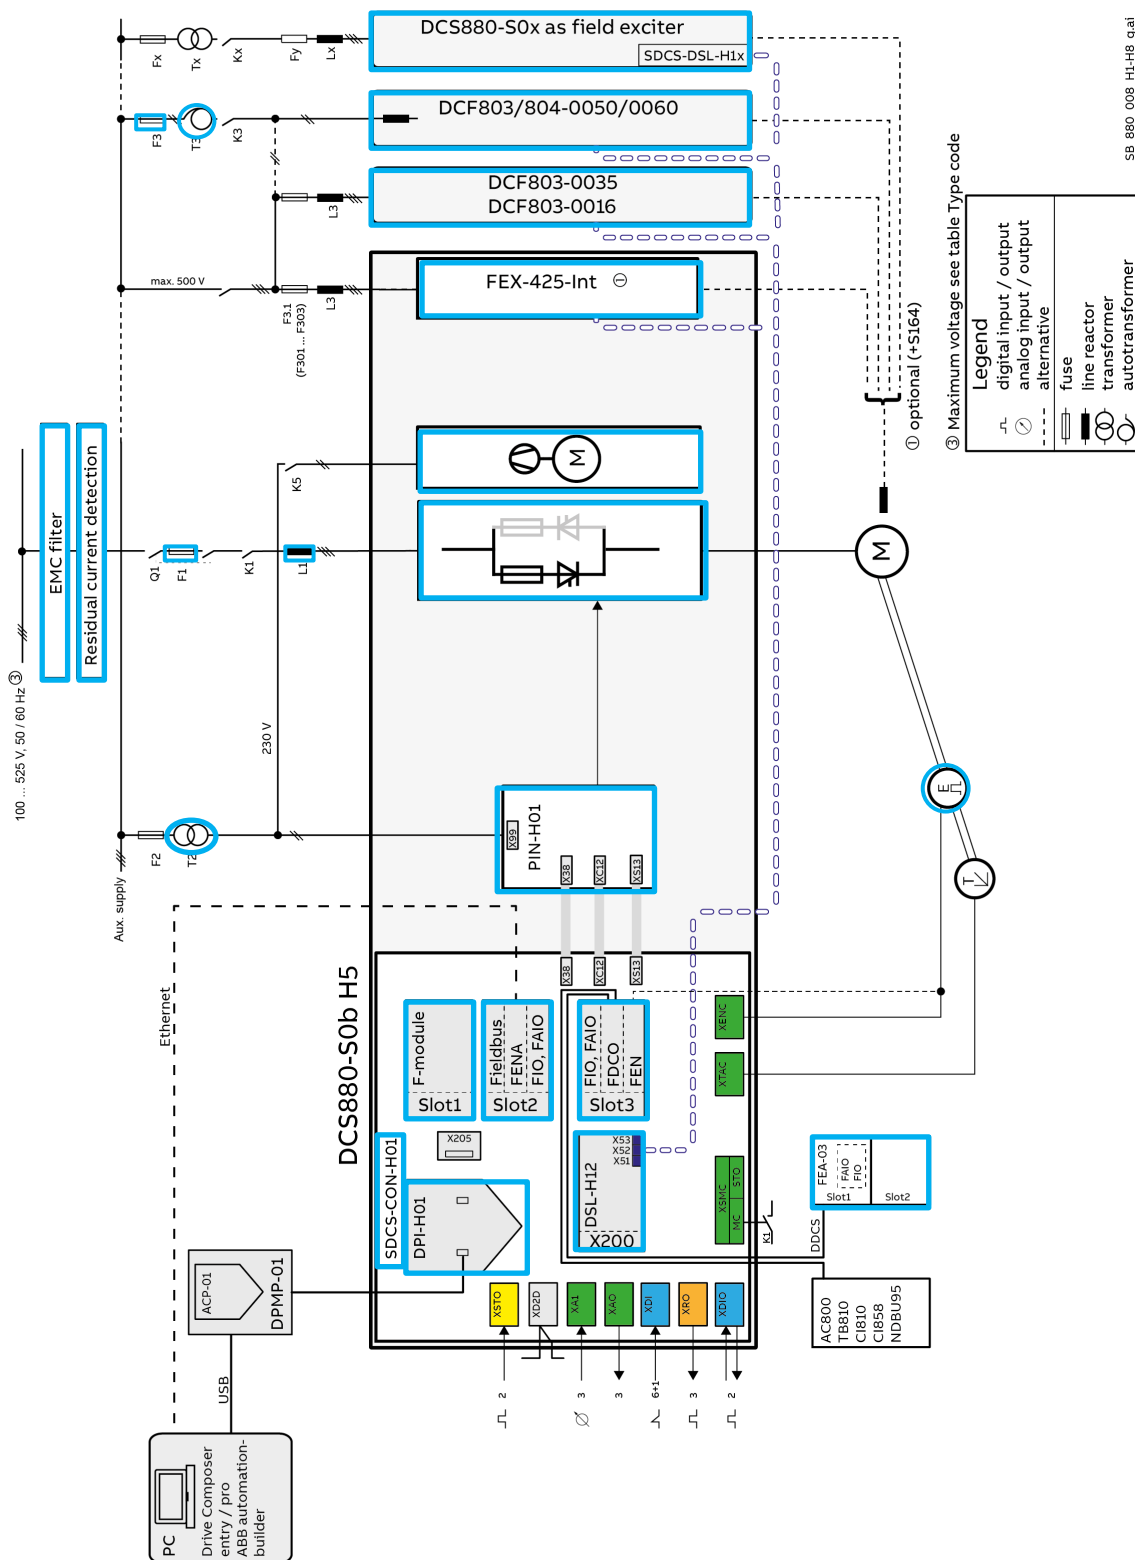

Armature converter DCS880 H6

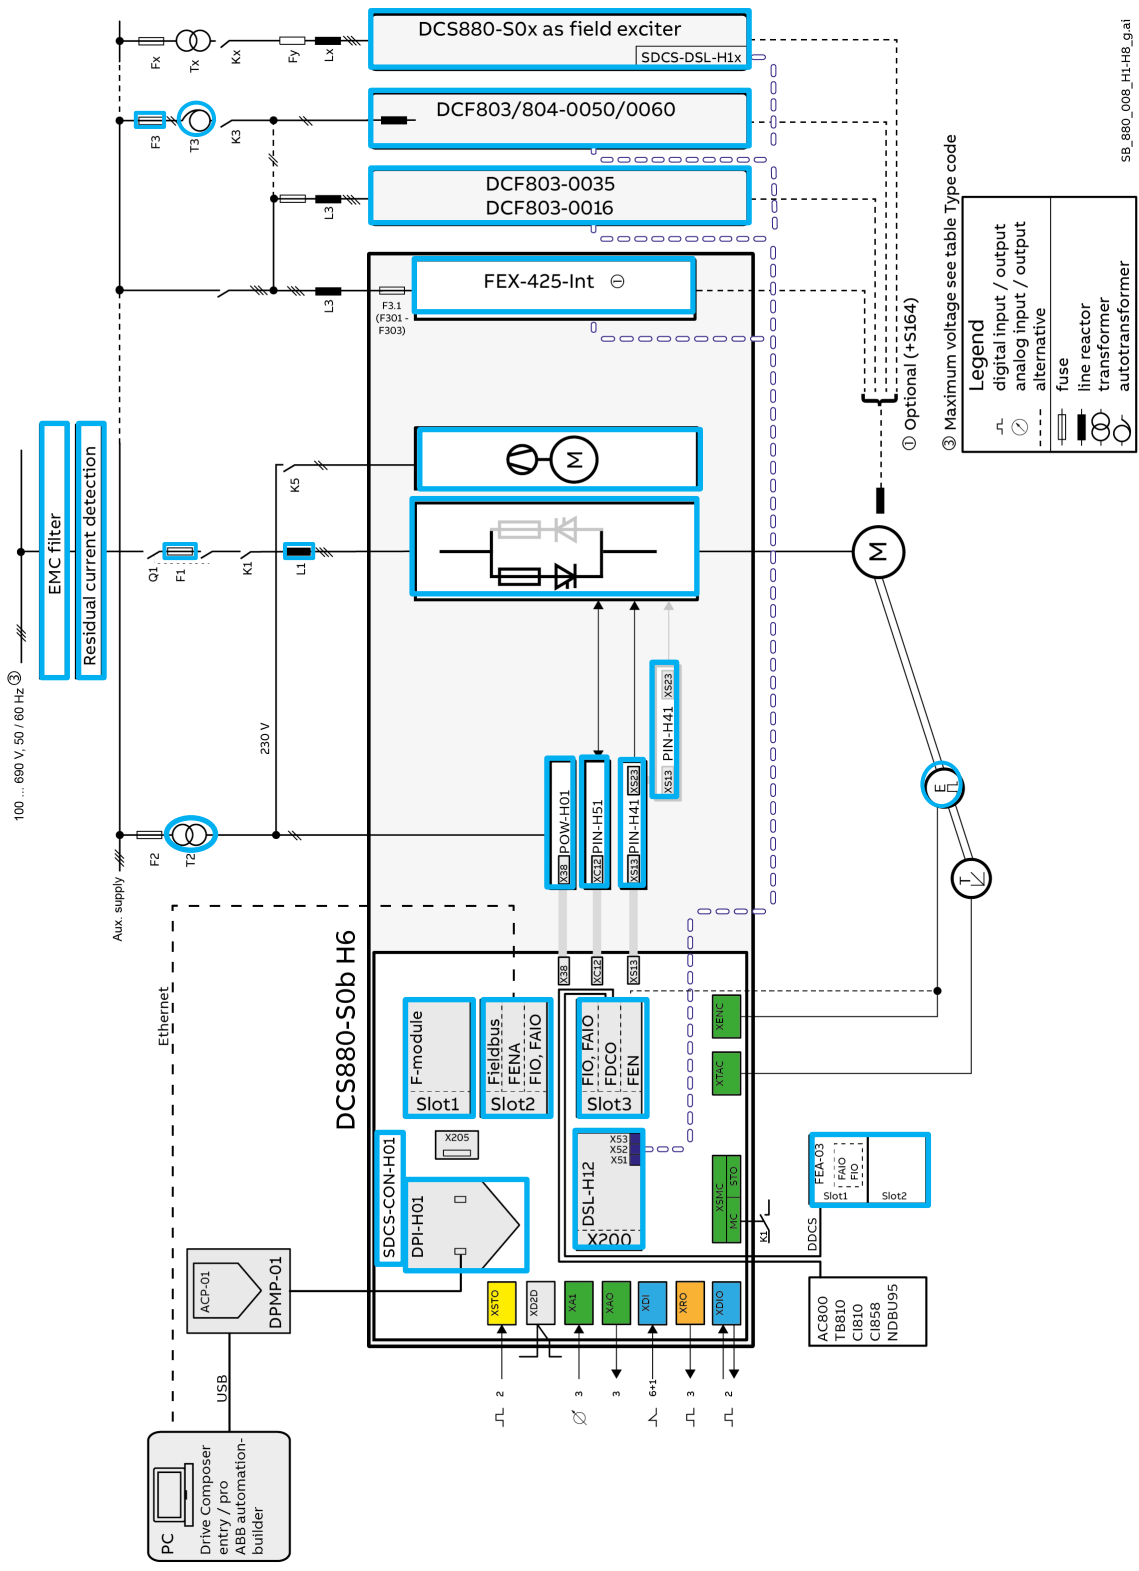

Armature converter DCS880 H7 and H8

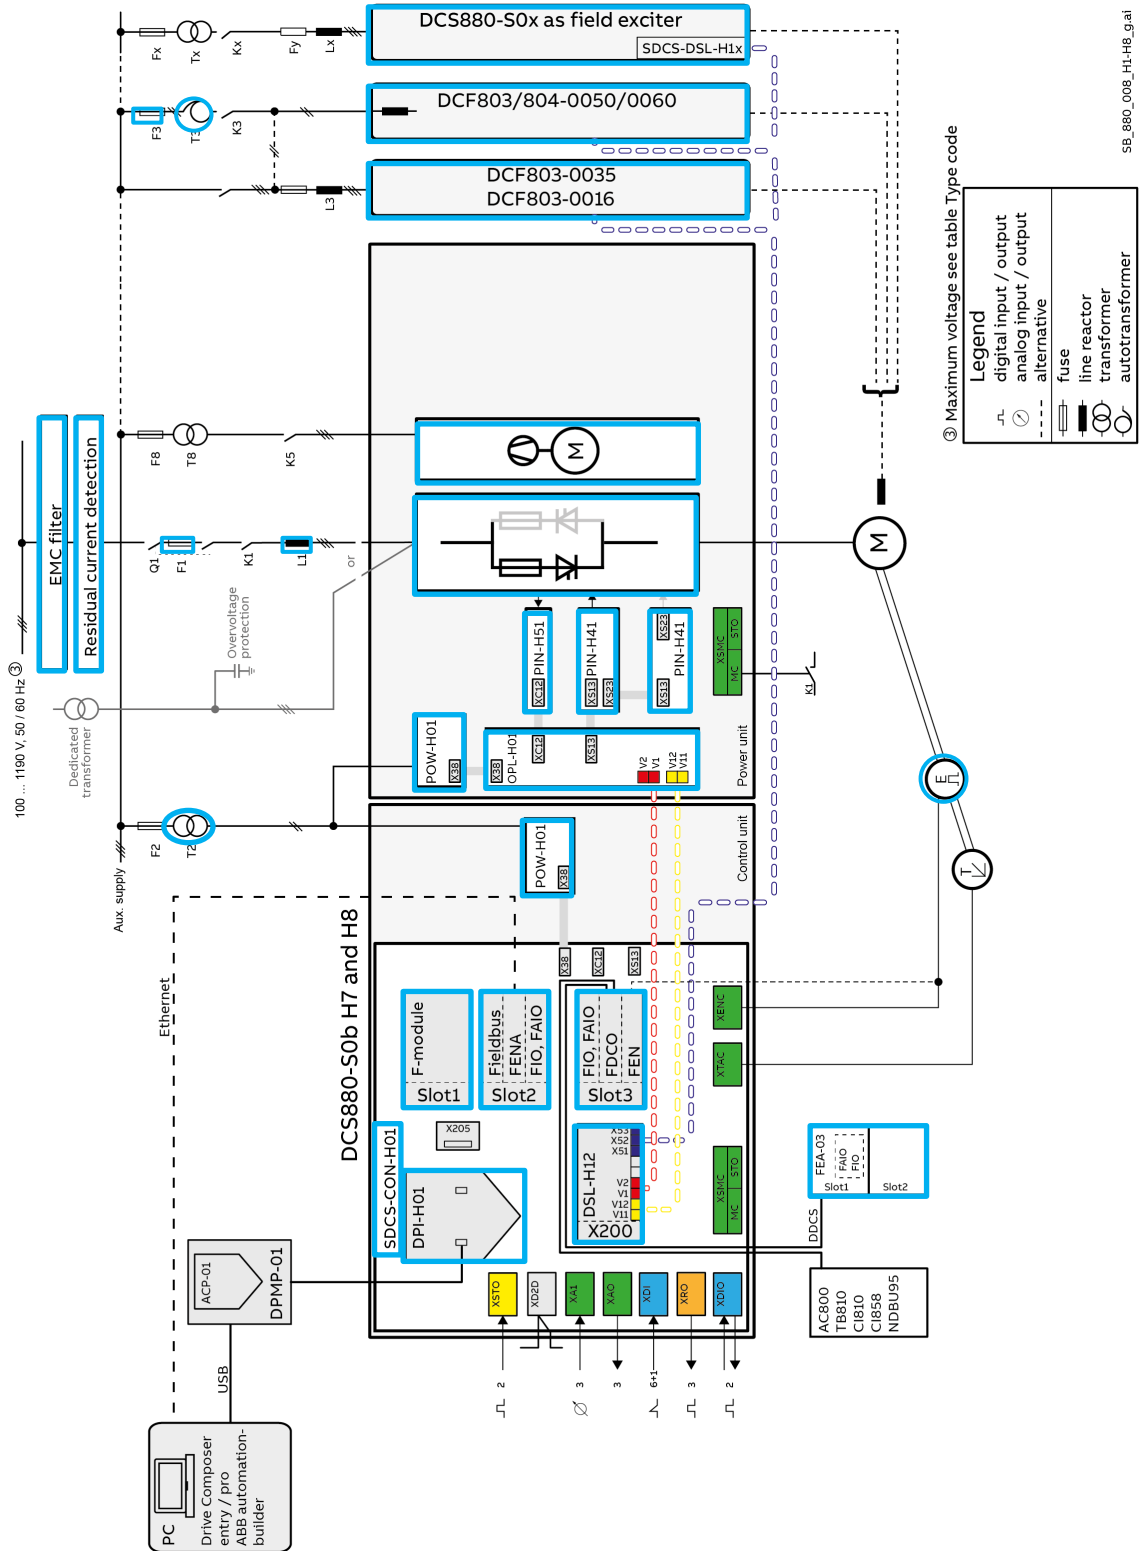

Mechanical installation

Chapter overview


This chapter describes the mechanical installation of the DCS880.

Safety



WARNING

- DCS800 sizes H4 ... H8:
 - The drive is heavy. Lift the drive by lifting lugs only.
 - The drive's center of gravity is high. Do not tilt the unit. The unit will overturn from a tilt of about 6 degrees. An overturning drive can cause physical injury.
 - Do not lift the unit by the front cover.
 - Place units H4 ... H6 only on their back.

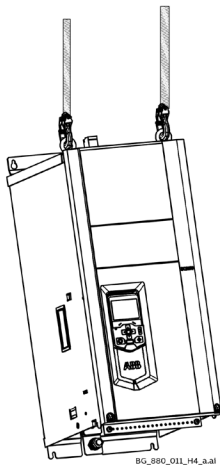

Examining the installation site

The drive must be installed in an upright position with the cooling section against a wall.

Make sure that the installation site agrees with these requirements:

- The installation site has sufficient ventilation to prevent overheating of the drive. See chapter [Current ratings](#).
- The operation conditions of the drive agree with the specifications in chapter [Environmental Conditions](#).
- The wall is vertical, not flammable, and strong enough to hold the weight of the drive.
- The material below the installation is not flammable.
- There is enough free space above, beside and below the drive for cooling air flow, service, and maintenance.

There is enough free space in front of the drive for operation, service, and maintenance. See chapter [Dimensions and weights](#).

Necessary tools

- Drill and drill bits.
- Screwdriver and/or wrench with bits. Some drive covers have torx screws.


Moving the drive

Move the transport package by pallet truck to the installation site.

Unpacking and examining the delivery (H1 ... H3)

This illustration shows the layout of the transport package. Examine that all items are present.

Item	Description
1	Drive with factory installed options.
2	Cardboard box.
3	Shock damper.
4	Shock dampers.
5	Tray.
6	Package containing documentation, plugs, mounting material, etc.

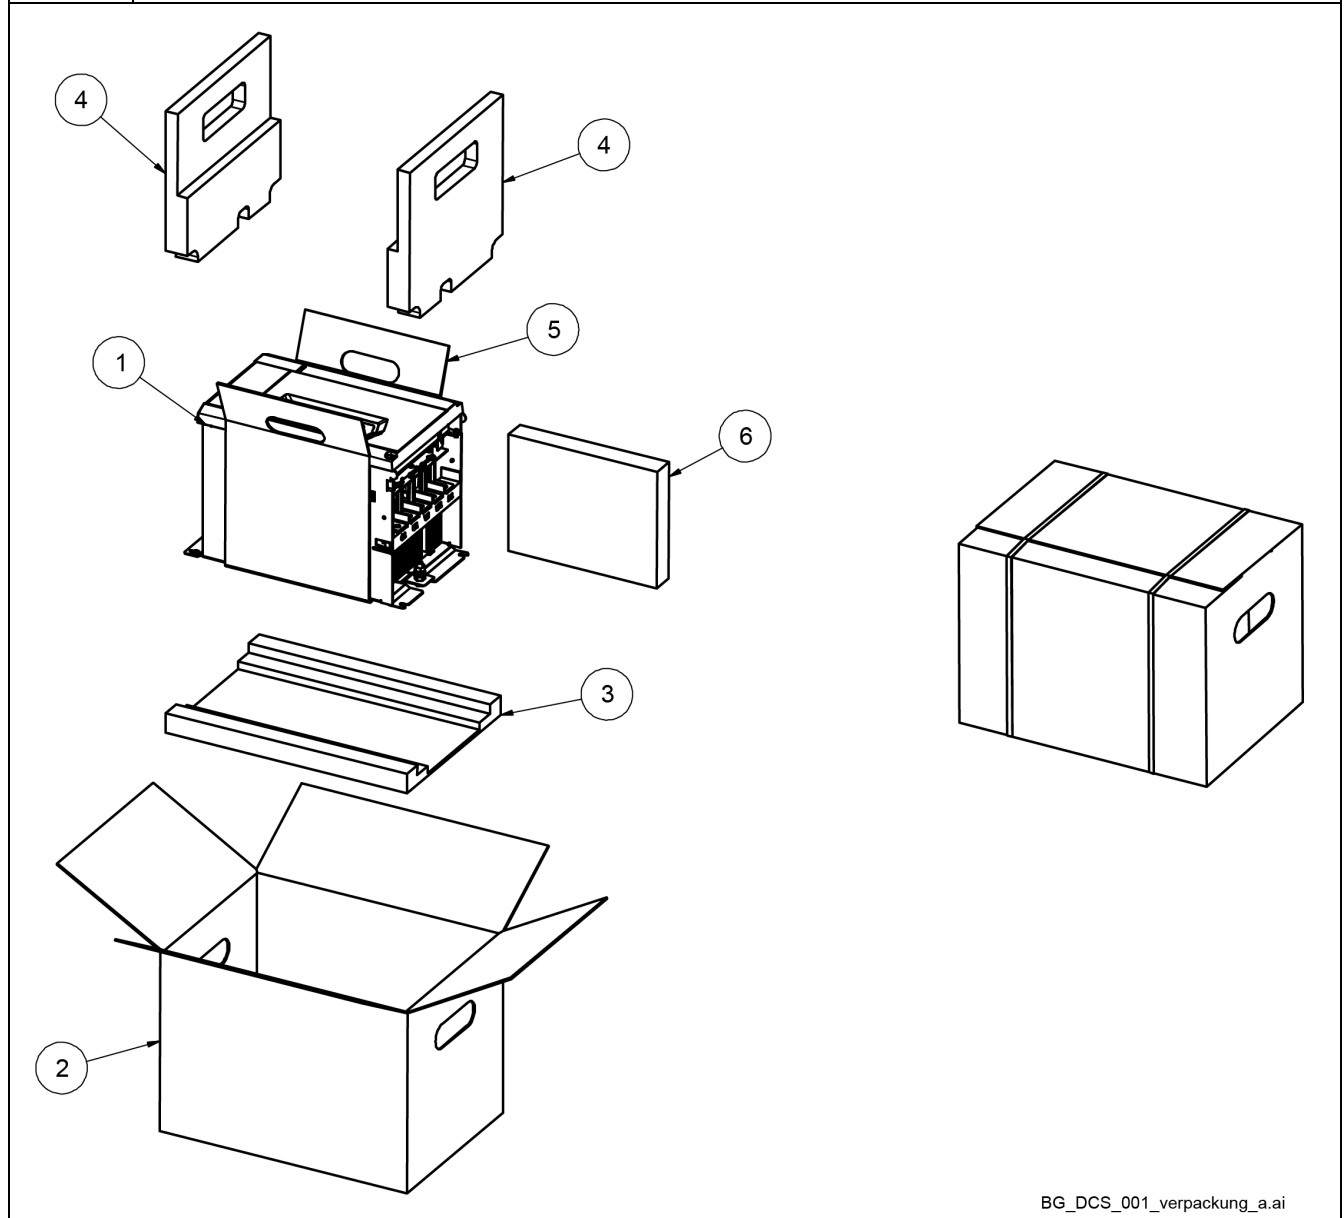


BG_DCS_001_verpackung_a.ai

Unpacking and examining the delivery (H4)

This illustration shows the layout of the transport package. Examine that all items are present.

Item	Description
1	Drive with factory installed options.
2	Cardboard box.
3	Shock damper.
4	Shock dampers.
5	Shock damper.
6	Package containing documentation, plugs, mounting material, etc.

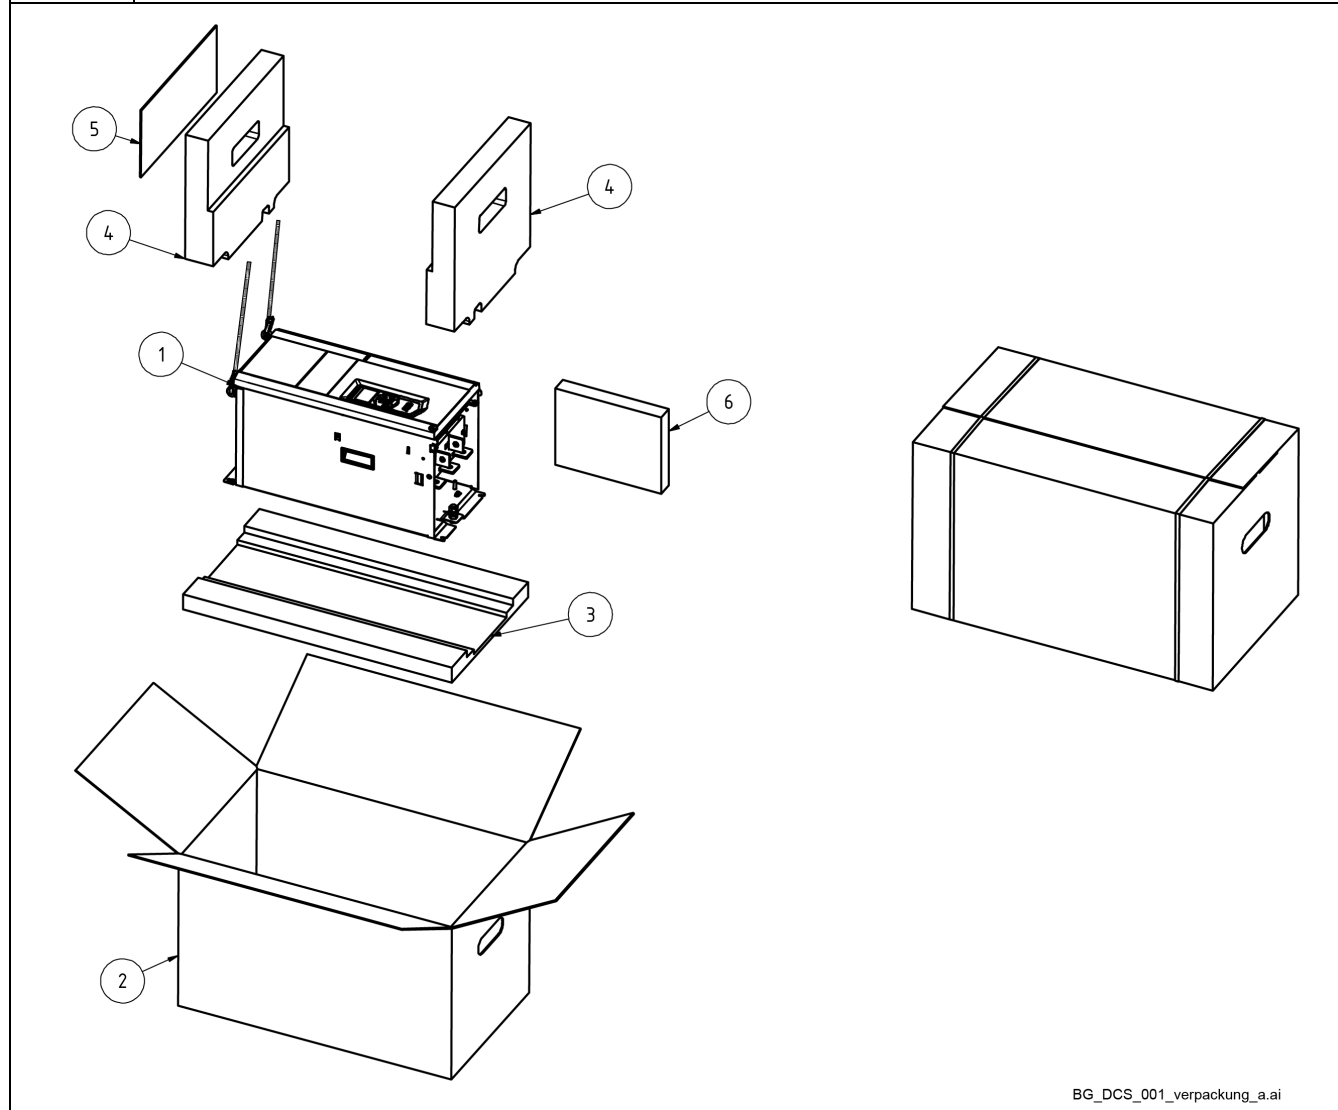


BG_DCS_001_verpackung_a.ai

Unpacking and examining the delivery (H5)

This illustration shows the layout of the transport package. Examine that all items are present.


Item	Description
1	Drive with factory installed options.
1.a	Converter fan, remove before installation.
1.b	Lifting lugs bracket.
1.c	Lifting lugs bracket, attach before installation.
2	Cardboard box.
3	Shock damper.
4	Package containing documentation, plugs, mounting material, etc.

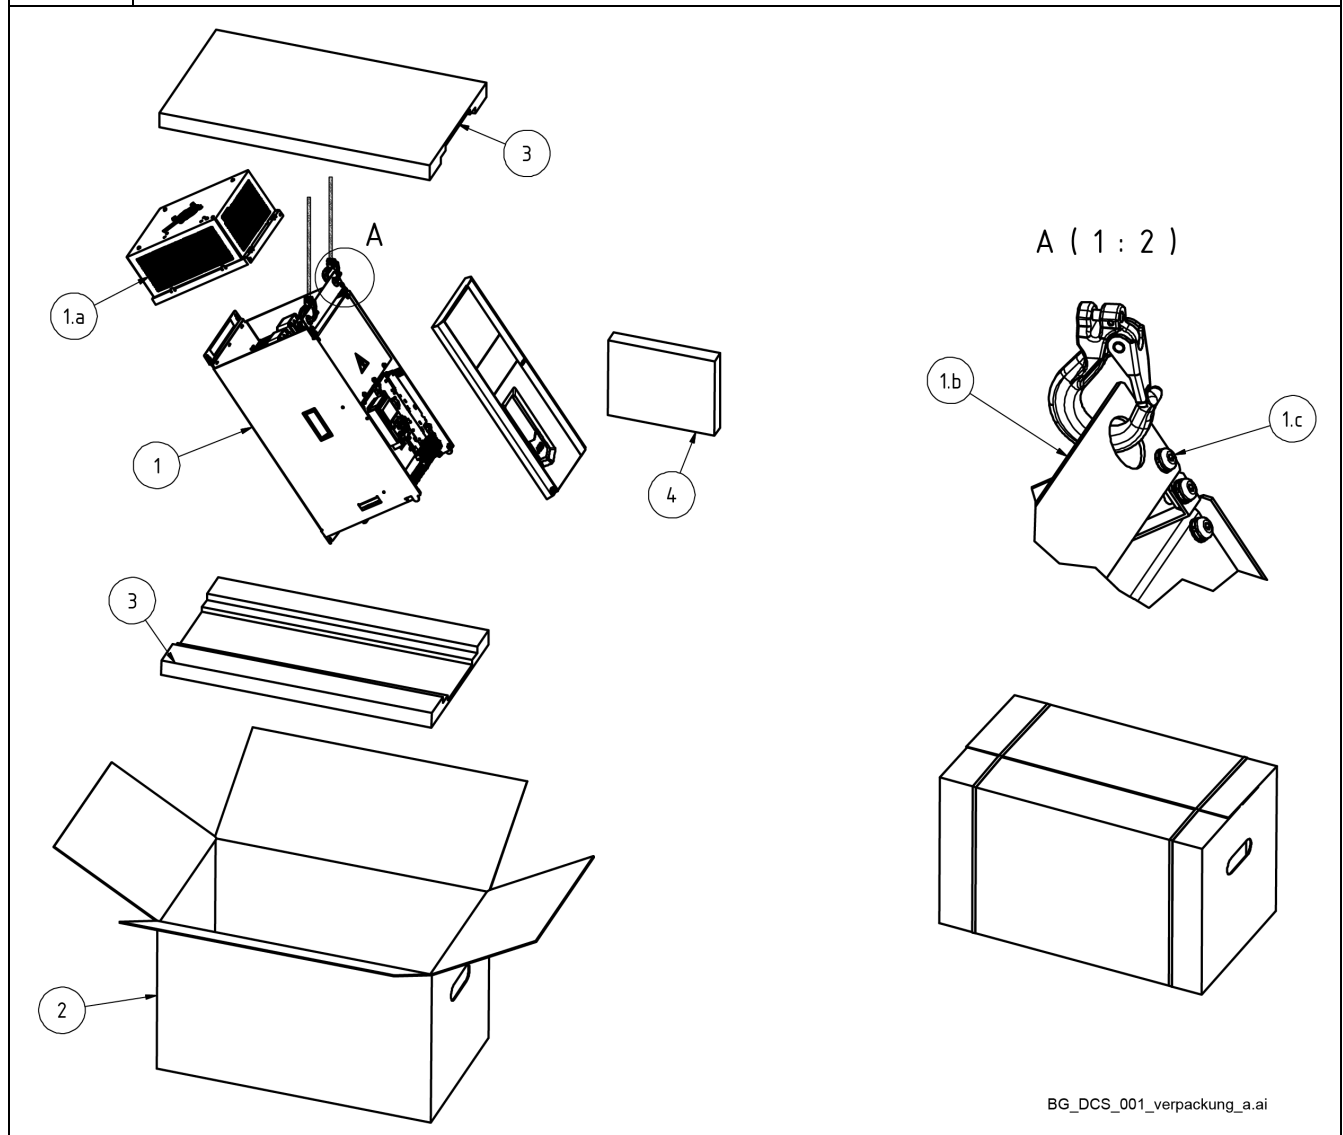

Unpacking and examining the delivery (H6)

This illustration shows the layout of the transport package. Examine that all items are present.


Item	Description
1	Drive with factory installed options.
2	Cardboard box.
3	Shock damper.
4	Lower and upper cardboard box cover.
5	Shock dampers.
6	Package containing documentation, plugs, mounting material, etc.

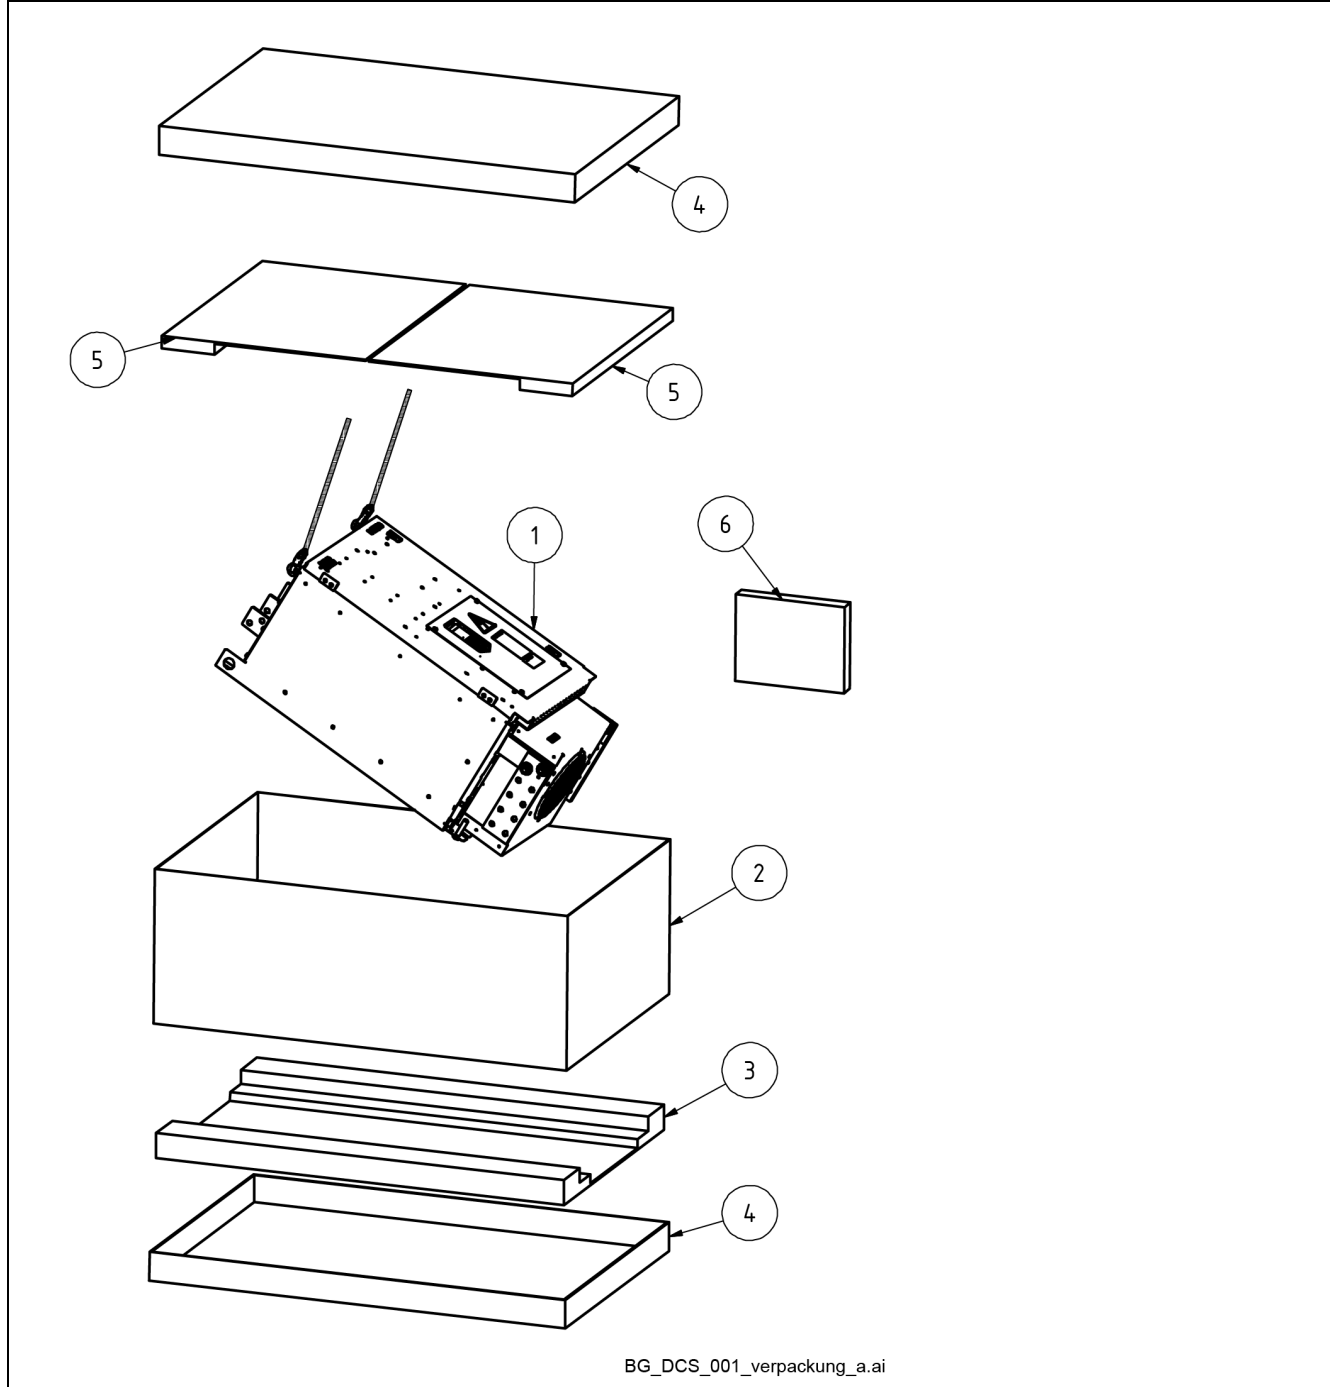

Unpacking and examining the delivery (H7, H8)


This illustration shows the layout of the transport package. Examine that all items are present.

Item	Description
1	Drive with factory installed options.
2	Cardboard box.
3	Lower cardboard box cover.
4	Brackets to fasten the drive, remove before installation.
5	Shock dampers.
6	Package containing documentation, plugs, mounting material, etc.

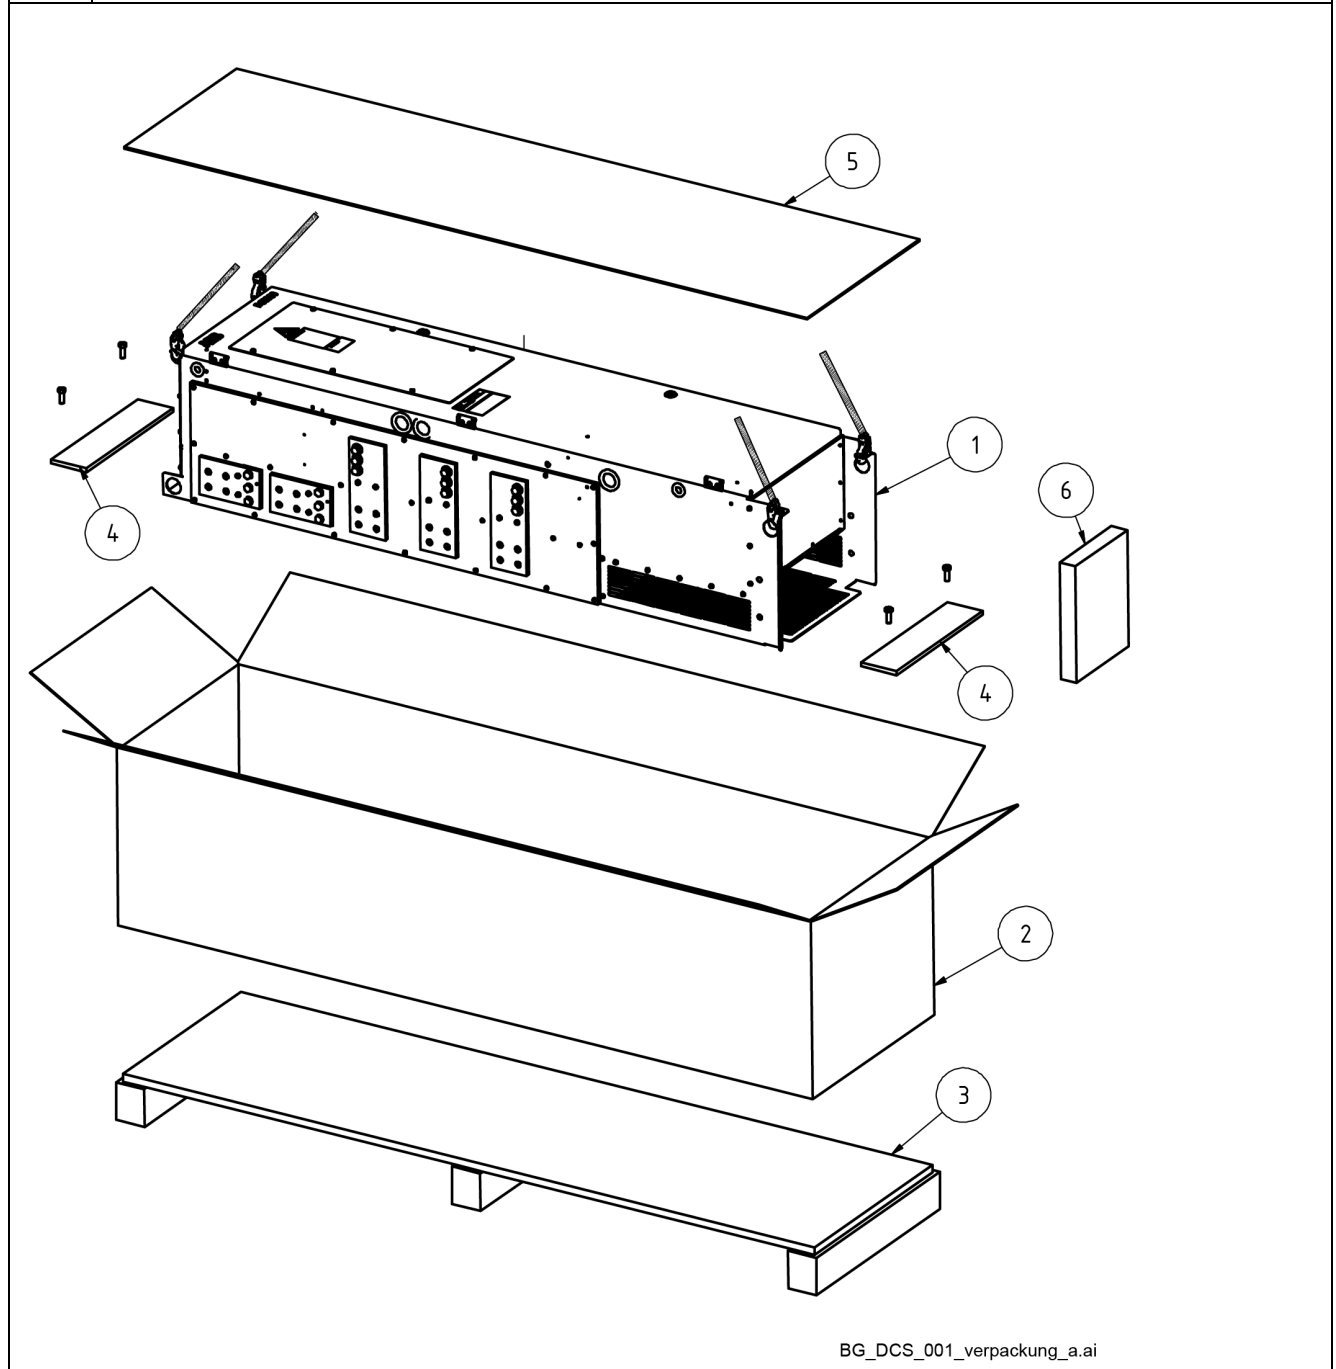





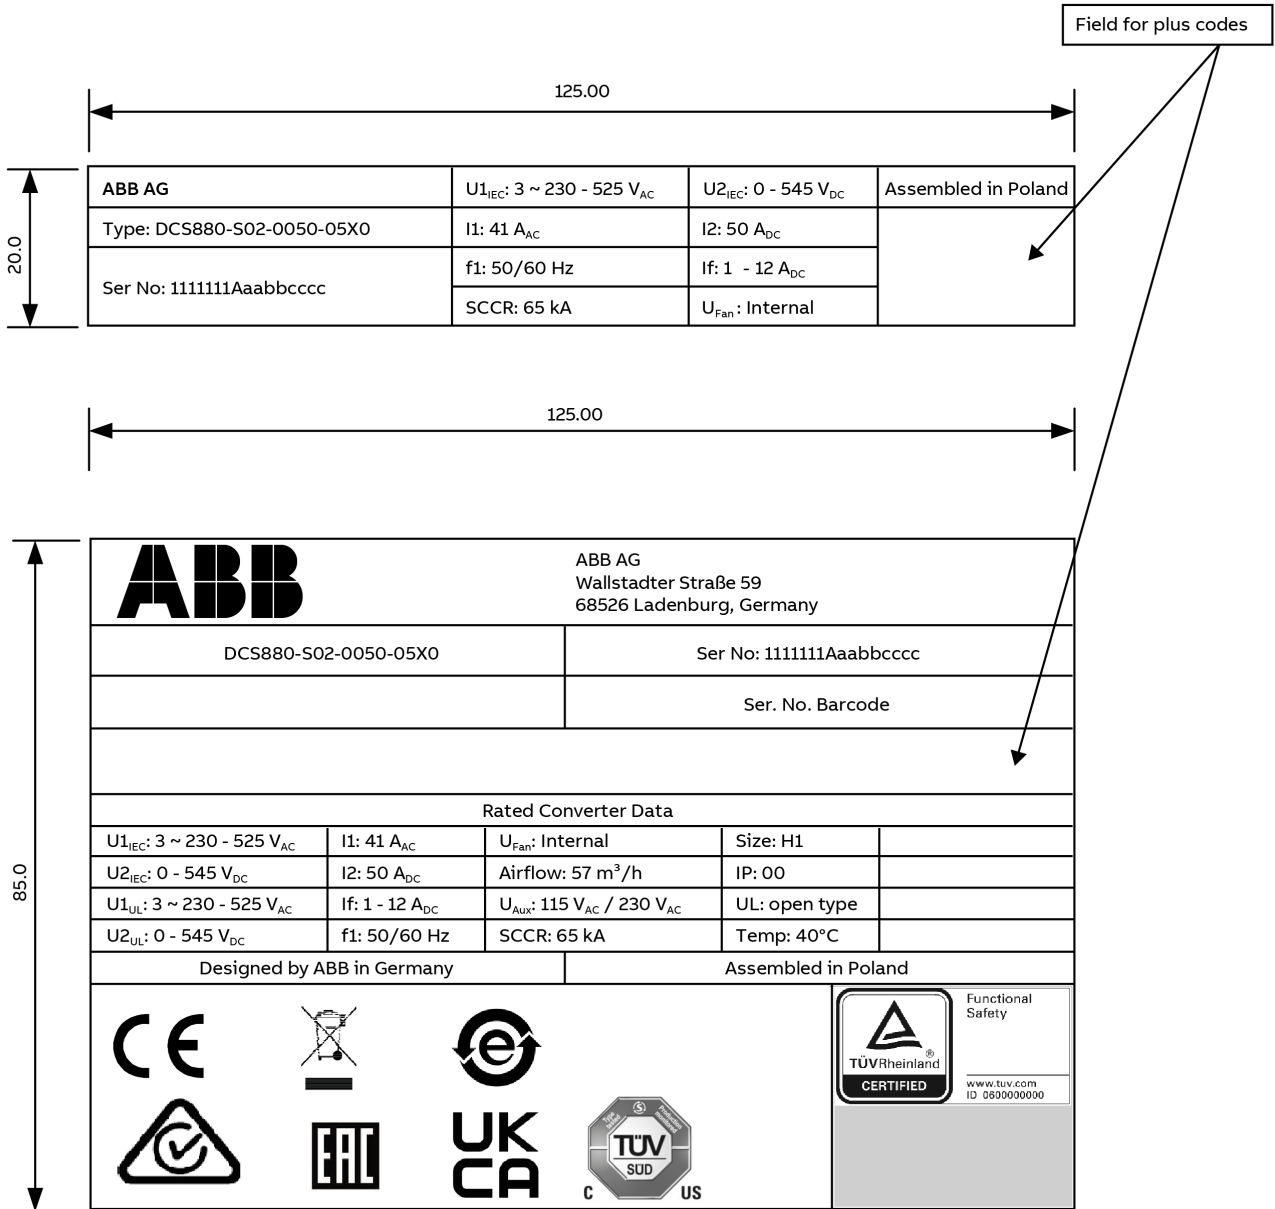



Delivery check

Check that there are no signs of damage. Before attempting installation and operation, check the information on the nameplate of the converter module to verify that the unit is of the correct type. The label includes an IEC rating, cTÜVus, C-tick (N713) and CE markings, a type code, and a serial number, which allow individual identification of each unit. The remaining digits complete the serial number so that there are no two units with the same serial number. See an example nameplate below.



LG_DCS_001_name plates_c.ai


Ser. No.	E.g., 0025421A17294264. 1729 = Production year 2017 and week 29.
U _{1IEC}	Rated input voltage according to IEC.
U _{2IEC}	Rated output voltage according to IEC.
U _{1UL}	Rated input voltage according to UL.
U _{2UL}	Rated output voltage according to UL.
I ₁	Rated input current.
I ₂	Rated output current.
I _f	Rated internal field exciter current.
f ₁	Rated frequency of mains voltage.
U _{Fan}	Rated fan voltage.
Airflow	Rated cooling air flow.
U _{Aux}	Rated auxiliary voltage.
Size	Unit size.
SCCR	Short circuit current ratio.
IP: 00	Protection class according to ISO20653.
UL: open type	Protection class according to UL.
Temp	Max. permissible cooling air temperature.

Label	Description
	DCS880 Declaration of Conformity, Machinery Directive
	DCS880 Declaration of Conformity, RoHs II
	China RoHs
	DCS880 Declaration of conformity, RCM, Australia
	EAC Certificate for Russian market
	DCS880 Declaration of Conformity UK, Machinery DCS880 Declaration of Conformity UK, RoHs DCS880 Declaration of Conformity UK, single DCS880 Declaration of Conformity UK, Safety and EMC
	DCS880-DCS800-DCS550 Certificate, UL, TÜV-SÜD NRTL DCF505-DCF506-DCF80x Certificate, UL, TÜV-SÜD NRTL TÜV SÜD is NRTL listed.
	EC Type-Examination Certificate

Installing the drive (H1 ... H3)

This section tells you how to install the drive on wall without vibration dampers. The degree of protection is IEC: IP00 and UL: open type.

1. See the dimensions in chapter [Dimensions and weights](#). Mark the locations for the four mounting holes.
2. Drill the mounting holes.
3. Insert wall plugs into the holes and start to screw bolts into the plugs. Drive the bolts deep enough into the wall to make them carry the weight of the drive.
4. Position the drive onto the bolts on the wall.
5. Tighten the bolts securely in the wall.

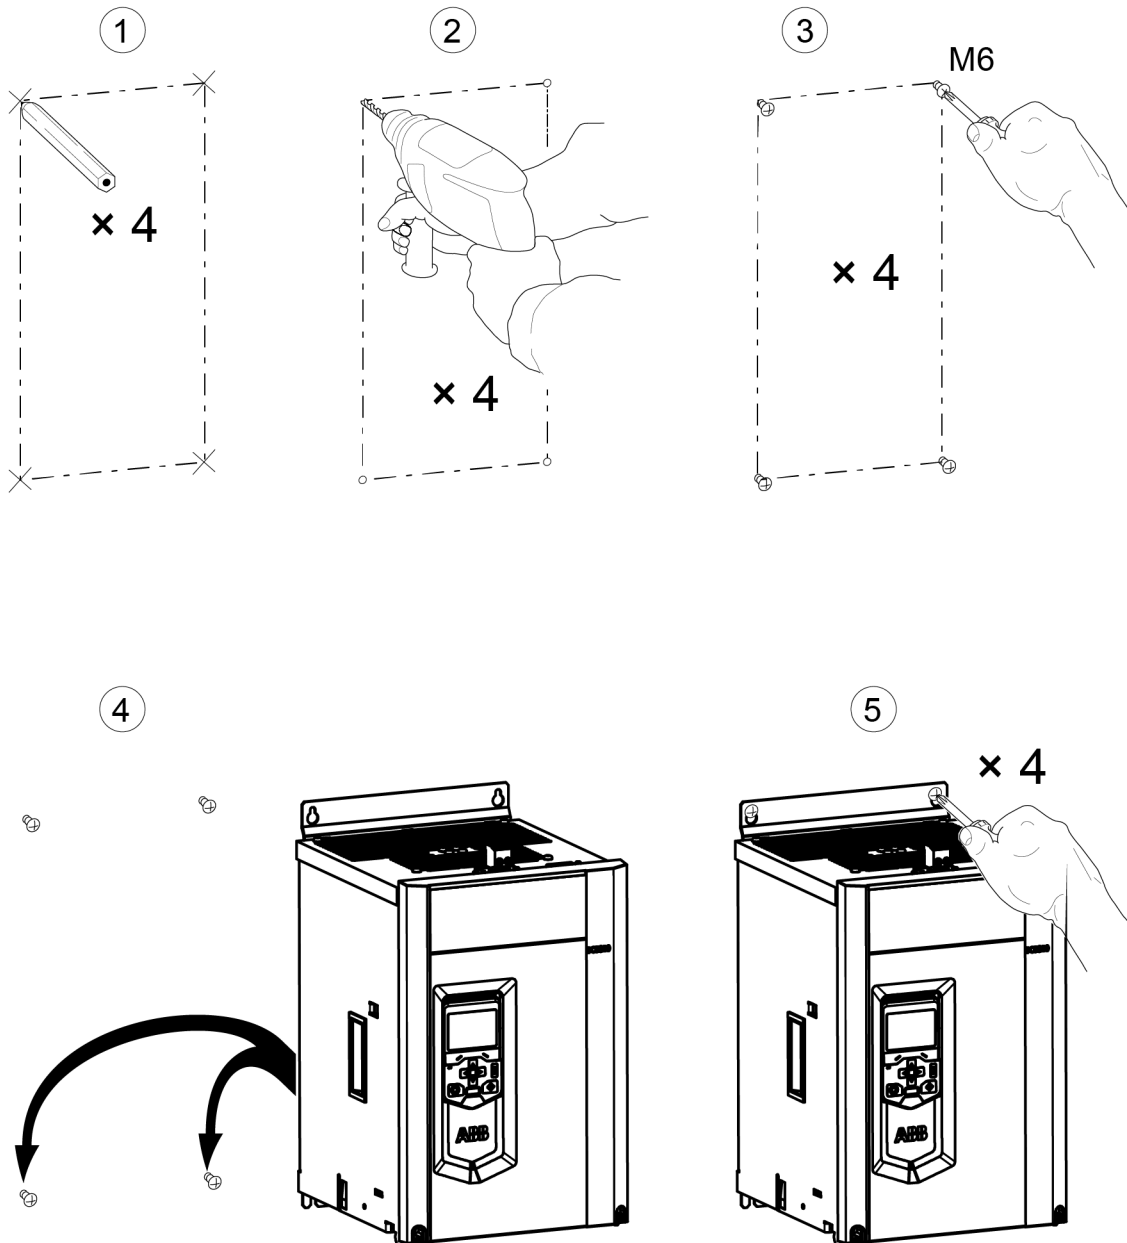


BG_880_013_H3-Bef_a.ai

Installing the drive (H4, H5)

This section tells you how to install the drive on wall without vibration dampers. The degree of protection is IEC: IP00 and UL: open type.

1. See the dimensions in chapter [Dimensions and weights](#). Mark the locations for the four mounting holes.
2. Drill the mounting holes.
3. Insert wall plugs into the holes and start to screw bolts into the plugs. Drive the bolts deep enough into the wall to make them carry the weight of the drive.
4. Position the drive onto the bolts on the wall.
5. Tighten the bolts securely in the wall.
6. For H5 re-install the converter fan.

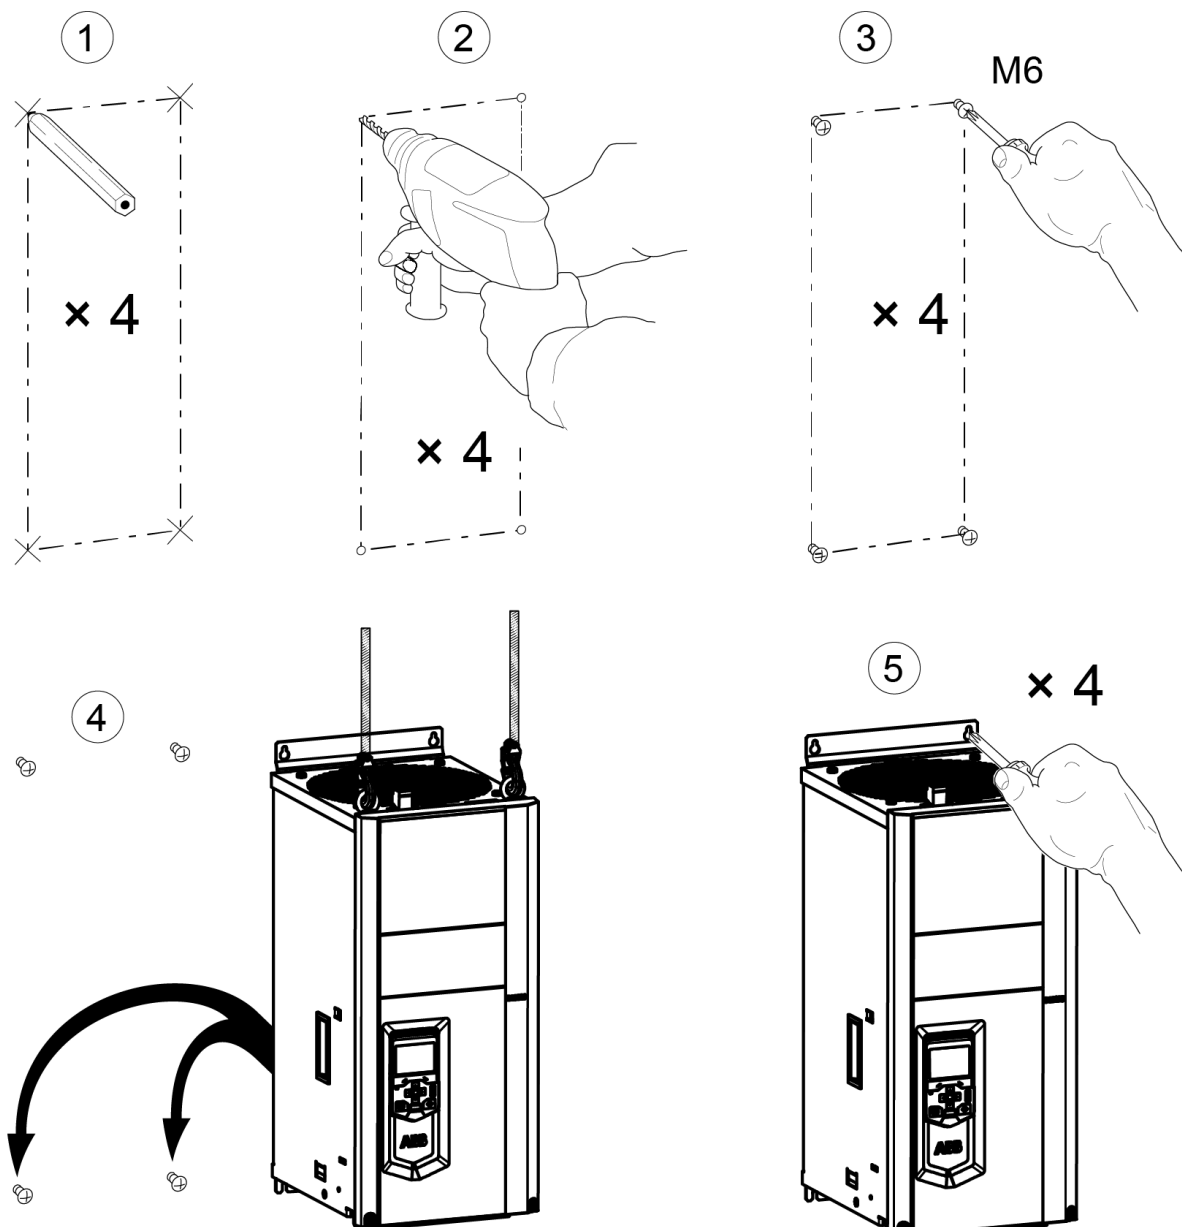

BG_880_011_H4-Bef_a.ai

Installing the drive (H6 ... H8)

Drives of sizes H6 ... H8 are for cabinet mounting only.


Cabinet installation

The required distance between parallel units is five millimeters (0.2 in.) in installations without the front cover.

The cooling air entering the unit must not exceed +40 °C (+104 °F).


Preventing cooling air recirculation

Prevent air recirculation inside and outside the cabinet.

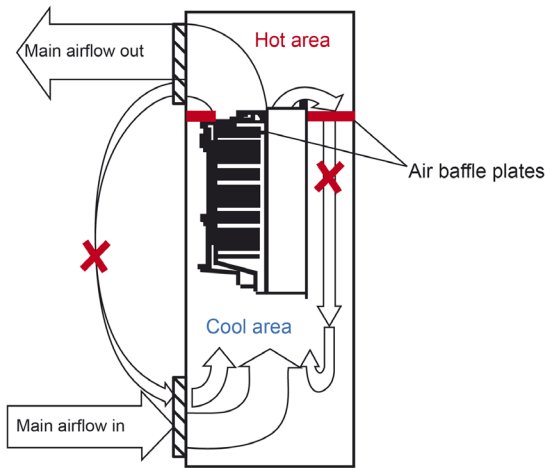

BG_800_004_luft_b.ai

Units above another

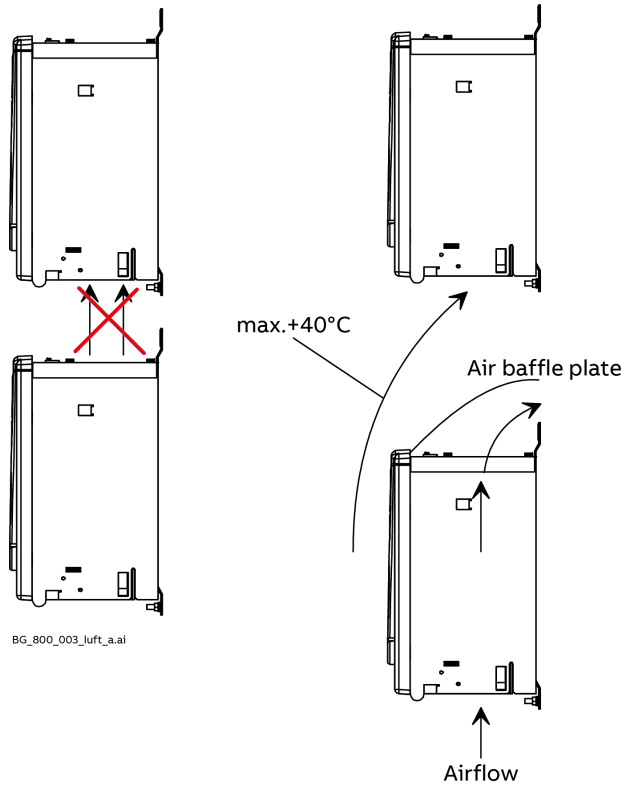

BG_800_003_luft_a.ai

Lead the exhaust cooling air away from the unit above.

Distances see chapter [Dimensions and weights](#).

Recommended air entry / exit sizes in case of filters (IP22).


Size	Nominal converter current [A]	Air entry size [m2]	Air exit size [m2]
H1	20 ... 100	0.22	0.11
H2	135 ... 300		
H3	290 ... 350		
H3	405 ... 520	0.31	0.15
H4	590 ... 1000	0.22	0.11
H5	1190		
H6	900 ... 2000		
H7	1900 ... 3000	0.44	0.31
H8	2050 ... 5200	0.52	

Terminal options for converter modules size H1 ... H4


There are different options to protect and connect the terminals.

Connection of H4 converter module DC terminals

In some cases, it is beneficial to use lug bars for easy DC cable connection.

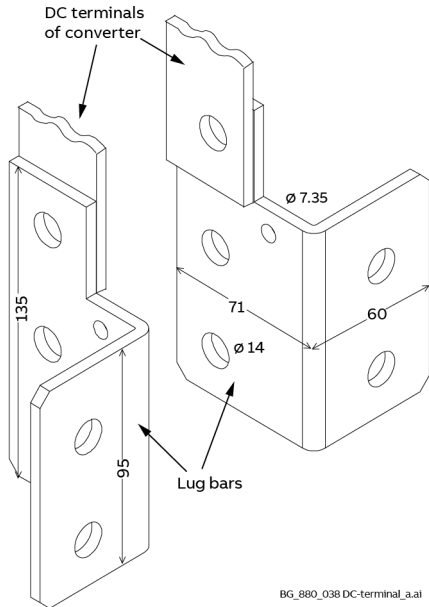


Id No.	Remark
3ADV280706P0001	right
3ADV280706P0002	left

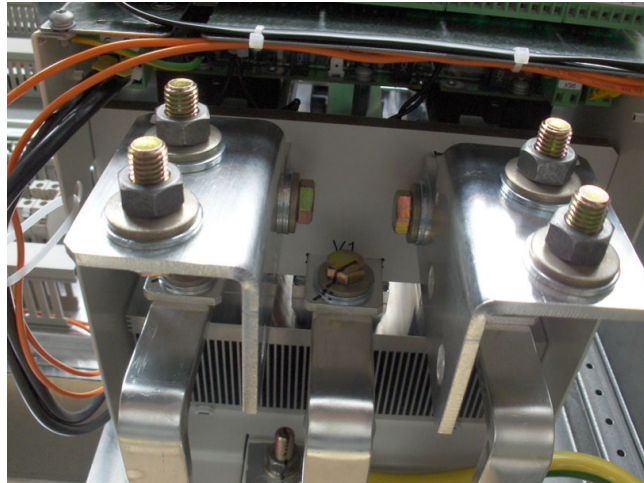


Bottom view

Terminal cover according to VBG 4 regulations (H1 ... H4 only)

For converter modules size H1 ... H4 shrouds for protection against contact are provided.

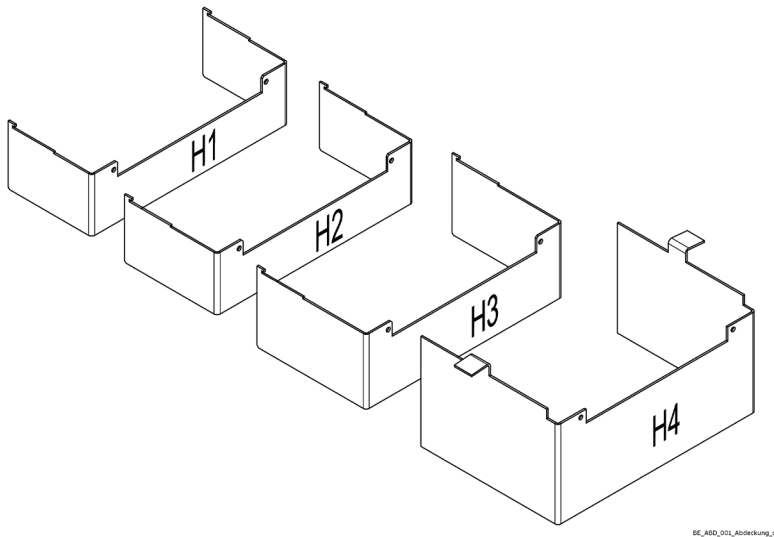

Id No.	Remark
3ADT631236P0001	H1
3ADT631237P0001	H2
3ADT631238P0001	H3
3ADT631239P0001	H4

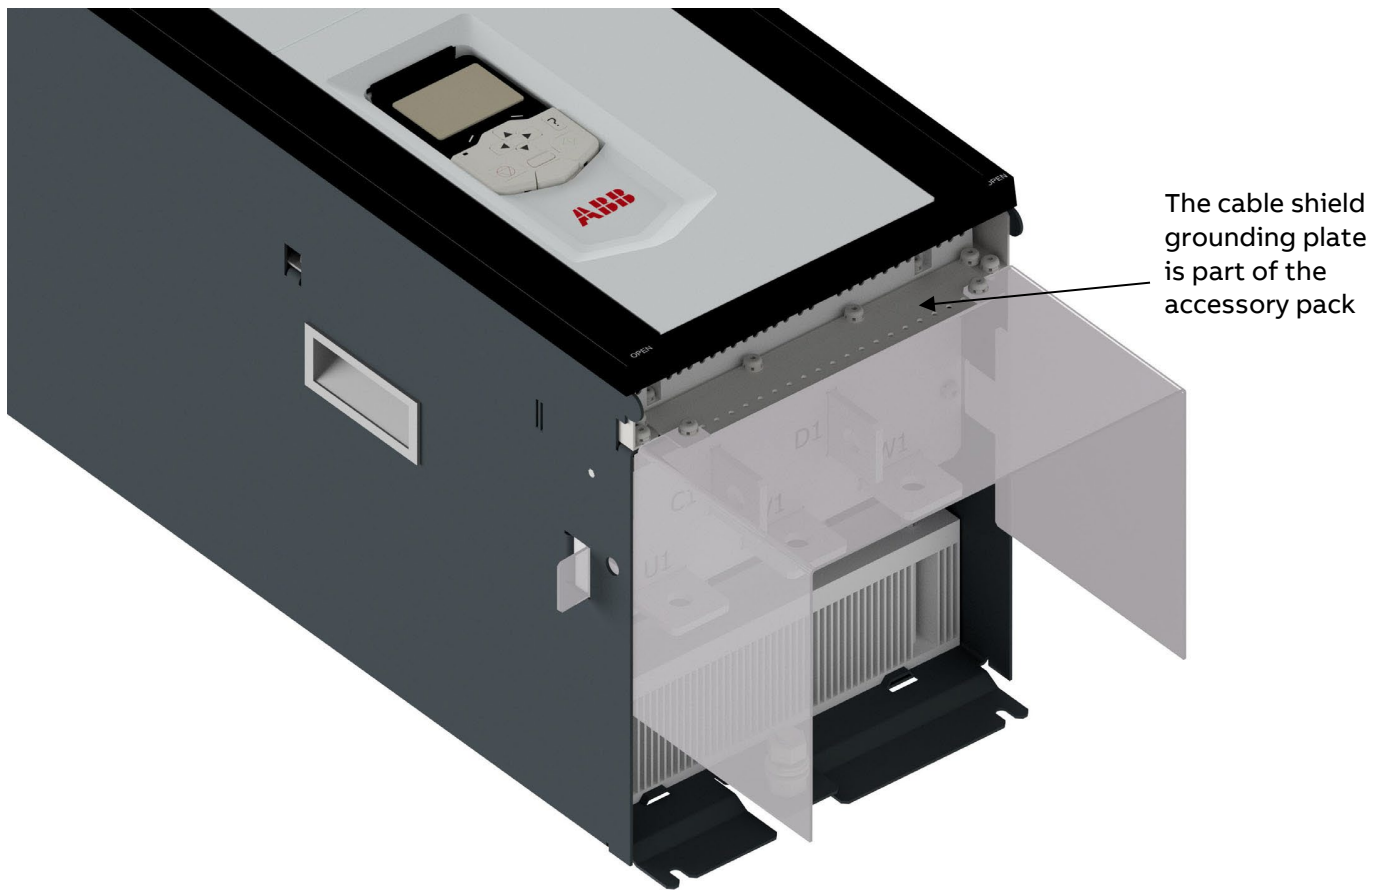


Example for a DC main terminal cover for H4 converter modules.

Mounting the converter module H5 inside an enclosure


Cooling air inlet

The cooling fan blows the air out of the front, right and left side of the converter module. View from:


Right side
air flow



Front side
air flow




Left side
air flow



BG_880_015_H5_air_flow_b.ai

Free space around the converter module in mm:

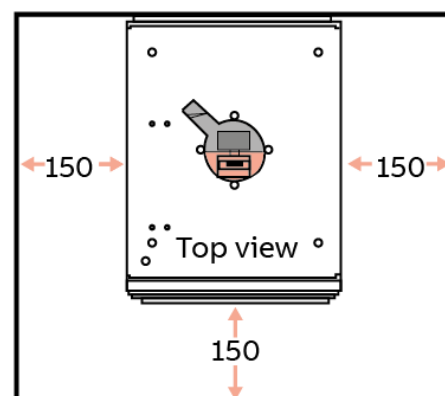

Cooling air outlet

To avoid circulating air inside the enclosure make sure the exhaust air leaves the enclosure.

Mounting the converter module:

1. Remove the control panel and front cover:



2. Remove screws (T20) and pull out the fan box:



3. Now all mounting holes are accessible:
Detail top (fan box removed):



Detail bottom:





Mounting the H7 power unit inside an enclosure

Cooling air inlet

The cooling fan takes the air from the back, left, right side and from the bottom of the converter module. View from:

Free space around the converter module

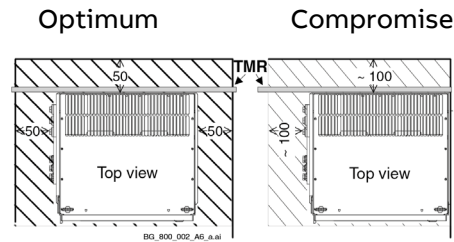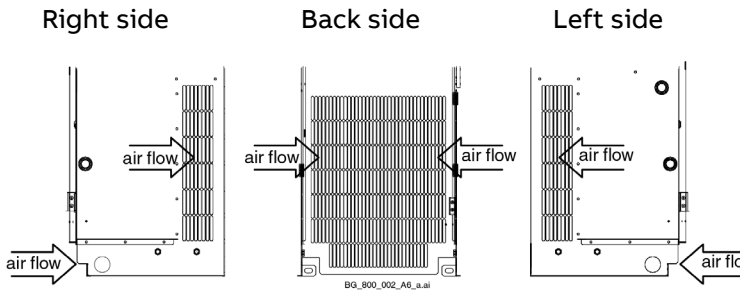

Cooling air outlet



To avoid circulating air inside the enclosure make sure the exhaust air leaves the enclosure.

Cable entries




Power cable connection

The power cable connection is done via option 3ADT786223. This option consists of 5 rectangular copper busbars with screws. The mechanical details are shown in the figure below.

The figure below gives an example, how the rectangular busbars can be mounted in case all cable connections are made at the left side of the converter module. This results in four layers of power cables. In case the AC or DC connection or perhaps both of them have to be made at the right side of the converter module use the space behind the converter. Move the power terminals via rectangular busbars to the final connection points. In this case the busbars need to be fixed at the enclosure, not at the converter module! The figures below give a rough example, how connections can be made.

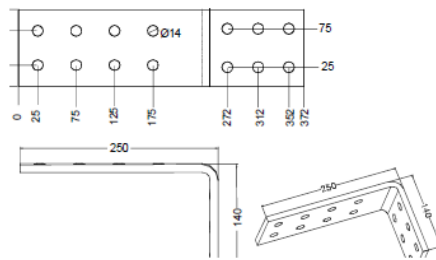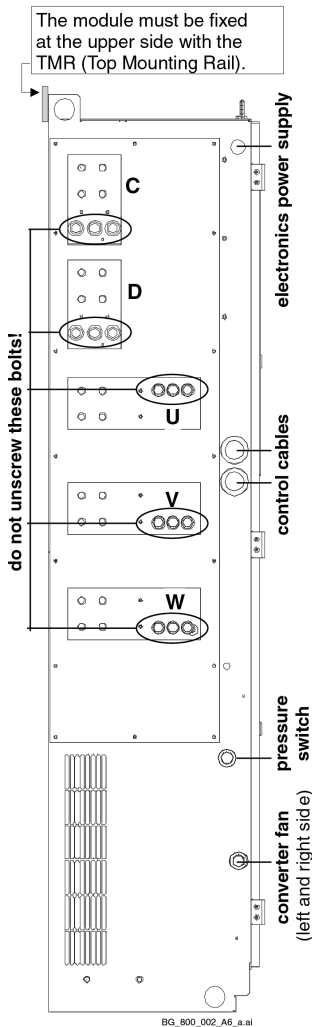

When mounting the rectangular busbars or connecting cables directly please make sure the correct bolts are used. The converter module is equipped with threaded holes at its left side. Because of that the length of the screw threads is limited to 35 mm (see drawing below).

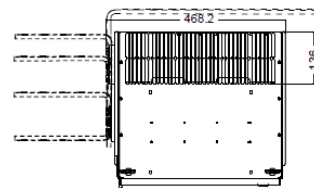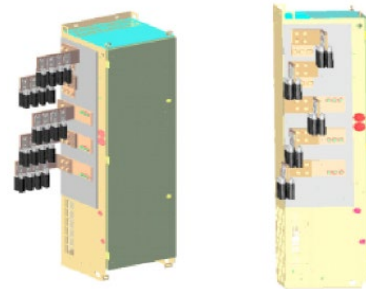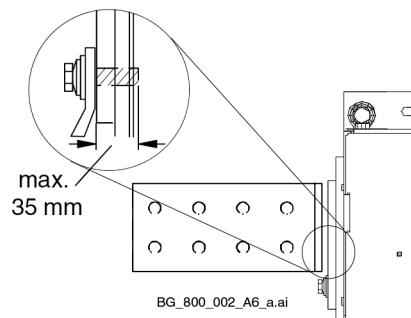


Example: Right side connection

Mounting the H8 power unit inside an enclosure


Cooling air inlet

The cooling fan takes the air from the back, left, right side and from the bottom of the converter module.

View from:

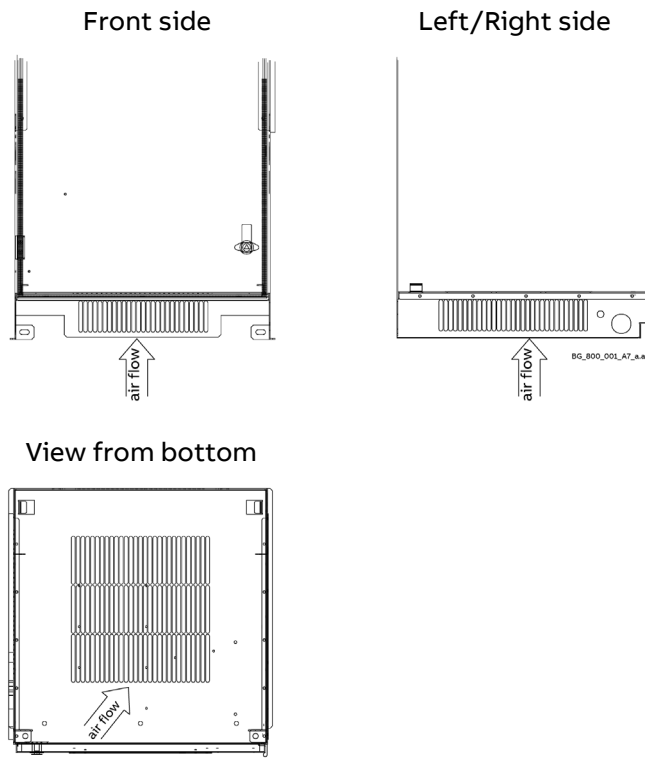

Free space around the converter module Do not place the converter module in a corner. In case the fan cannot take the air through the bottom plate of the enclosure none of the remaining entries must be blocked.




Air entry through the bottom plate Make sure the converter module gets clean air, because there is no air filter in front of the converter fan.

Cooling air outlet

To avoid circulating air inside the enclosure make sure the exhaust air leaves the enclosure.

Cable entries

The cable entries are symmetric on both sides. Nevertheless, only the entries on the left side should be used for cables connected to the electronic power supply (SDCS-POW-H01) or the controller board (SDCS-CON-H01).

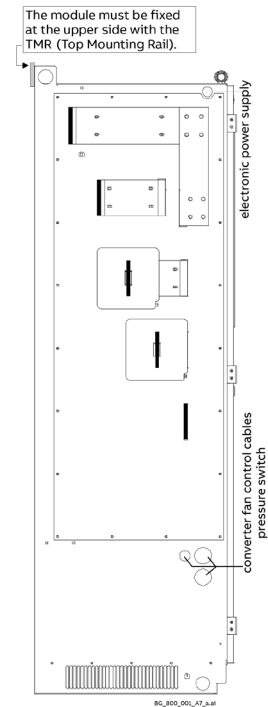

Internal cable ducts are used for the snubber cables. Do not use these cable ducts for other cables e.g., process signals!

Use cable ties to fix the fan cable!

Fasten all cables, otherwise the air flow from fan will destroy them!

Planning the electrical installation

Chapter overview

This chapter contains the instructions that must be followed when selecting the motor, cables, protections, cable routing and way of operation for the drive system. Always follow local regulations. This chapter applies to all DCS880 converter modules.



Attention: If the recommendations given by ABB are not followed, the drive may experience problems not covered by warranty. See also [Technical guide](#).




Options

Line reactors (L1)

For armature and field supply.

When thyristor converters operate, the line voltage is short-circuited during commutation from one thyristor to the next. This operation causes voltage dips in the mains PCC (point of common coupling). For the connection of a power converter system to the mains, one of the following configurations applies:

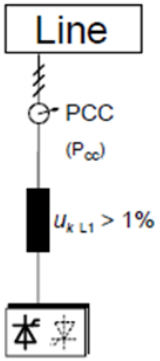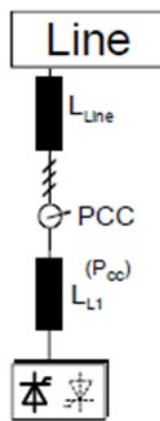 <p>The diagram shows a 'Line' connected to a PCC (Point of Common Coupling) through a line reactor L1. The voltage drop across L1 is indicated as $u_{kL1} > 1\%$. The PCC is labeled (P∞). Below the PCC, there is a symbol for a thyristor converter.</p>	<p>Configuration A</p> <p>When using a converter, a minimum of impedance is required to ensure proper performance of the snubber circuit. Use a line reactor to meet this minimum impedance requirement. The value must therefore not drop below 1 % u_k (relative impedance voltage). It should not exceed 10 % u_k, due to considerable voltage drops at the converters outputs.</p>
 <p>The diagram shows a 'Line' connected to a PCC (Point of Common Coupling) through a line reactor L_{Line}. The PCC is labeled (P∞). Below the PCC, there is a line reactor L_{L1} connected to a thyristor converter.</p>	<p>Configuration B</p> <p>If special requirements have to be met at the PCC (standards like EN 61 800-3, DC and AC drives at the same line, etc.), different criteria must be applied for selecting a line reactor. These requirements are often defined as a voltage dip in percent of the nominal supply voltage. The combined impedance of $Z_{L_{line}}$ and Z_{L1} constitute the total series impedance of the installation.</p> <p>The ratio between the line impedance and the line reactor impedance determines the voltage dip at the PCC. In such cases, line chokes with an impedance around 4 % are often used.</p> <p>Example calculation with $u_{kLine} = 1\%$ and $u_{kL1} = 4\%$: Voltage dip = $Z_{L_{line}} / (Z_{L_{line}} + Z_{L1}) = 20\%$. Detailed calculations see Technical guide.</p>

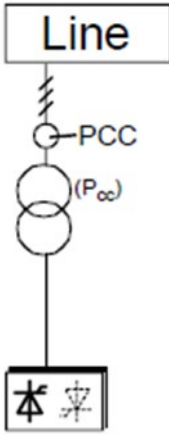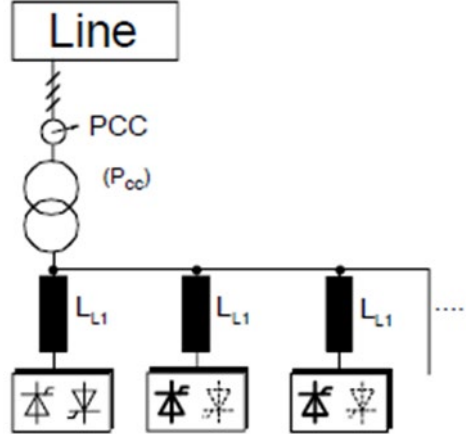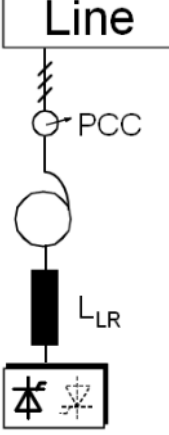	<p>Configuration C</p> <p>If a dedicated transformer/isolation transformer is used, it is possible to comply with certain connecting conditions per Configuration B without using an additional line reactor. The condition described in Configuration A will then likewise be satisfied, since the u_k is $> 1\%$.</p> <p>On their secondary side dedicated transformers/isolation transformers always require an additional switching protection. See chapter Overvoltage protection at the secondary side of high voltage transformers.</p>
 <p>Netzdr_g.dsf</p>	<p>Configuration C1</p> <p>If 2 or more converters should be supplied by one transformer the final configuration depends on the number of drives in use and their power capability.</p> <p>Configuration A or B has to be used, if the drive system consists of any of the converters H1, H2, H3, H4, H5, H6, H7, H8. In case if only two converters of type H8 are used no line reactors are necessary because the design of these converters allows that configuration.</p>
	<p>Configuration D</p> <p>In the case of thyristor converters, frequently transformers are used for voltage matching. When using an autotransformer for this purpose, additionally install a line reactor, because the u_k of commonly used autotransformers is too small.</p> <p>In case of converters size H1 ... H5 the allowed voltage at the PCC is $\leq 600 V_{AC}$.</p>

Line reactors (L1) for converters

The line reactors listed in table below:

- Have been sized to the units nominal current and frequency (50/60 Hz).
- Are independent of converter's voltage classification. At some converter types the same line choke is used up to 690 V line voltage.
- Are based on a duty cycle.
- Can be used for DCS880 as armature converter as well as field converter, but the rated line choke current must be considered.

For further information see also the [Technical guide](#).

Line reactors (L1) selection

Size	Converter type (2-Q)	Converter type (4-Q)	Line reactor (uk = 1 %)	Design figure	Line reactor (uk = 4 %)	Design figure
H1	DCS880-S01-0020-04/05	DCS880-S02-0025-04/05	ND01	1	ND401	4
	DCS880-S01-0045-04/05	DCS880-S02-0050-04/05	ND02	1	ND402	4
	DCS880-S01-0065-04/05	DCS880-S02-0075-04/05	ND04	1	ND403	5
	DCS880-S01-0090-04/05	DCS880-S02-0100-04/05	ND06	1	ND404	5
H2	DCS880-S01-0135-04/05	DCS880-S02-0150-04/05	ND06	1	ND405	5
	DCS880-S01-0180-04/05	DCS880-S02-0200-04/05	ND07	2	ND406	5
	DCS880-S01-0225-04/05	DCS880-S02-0250-04/05	ND07	2	ND407	5
	DCS880-S01-0270-04/05	DCS880-S02-0300-04/05	ND09	2	ND408	5
H3	DCS880-S01-0290-06	DCS880-S02-0320-06	ND08	2	On request	-
	DCS880-S01-0315-04/05	DCS880-S02-0350-04/05	ND09	2	ND408	5
	DCS880-S01-0405-04/05	DCS880-S02-0450-04/05	ND10	2	ND409	5
	DCS880-S01-0470-04/05	DCS880-S02-0520-04/05	ND10	2	ND410	5
H4	DCS880-S01-0590-06	DCS880-S02-0650-04/06	ND13	3	On request	-
	DCS880-S01-0610-04/05	DCS880-S02-0680-04/05	ND12	2	ND411	5
	DCS880-S01-0740-04/05	DCS880-S02-0820-04/05	ND13	3	ND412	5
	DCS880-S01-0900-04/05	DCS880-S02-1000-04/05	ND13	3	ND413	5
H5	DCS880-S01-1190-04/05	DCS880-S02-1190-04/05	ND14	3	On request	-
H6	DCS880-S01-0900-06/07	DCS880-S02-0900-06/07	ND13	3	On request	-
	DCS880-S01-1200-04/05	DCS880-S02-1200-04/05	ND14	3	On request	-
	DCS880-S01-1500-04/05/06/07	DCS880-S02-1500-04/05/06/07	ND15	3	On request	-
	DCS880-S01-2000-04/05	DCS880-S02-2000-04/05	ND16 ①	3	On request	-
	DCS880-S01-2000-06/07	-	ND16 ①	3	On request	-
H7	DCS880-S01-1900-08	DCS880-S02-1900-08	ND17 ②	-	-	-
	DCS880-S01-2050-05/06/07	DCS880-S02-2050-05/06/07	ND17 ②	-	-	-
	DCS880-S01-2500-04/05/06/07/08	DCS880-S02-2500-04/05/06/07/08	ND17 ②	-	-	-

① With forced cooling (1 m/s)

② On request

Line reactors (details see chapter [Line reactors IEC](#))




Fig. 1



Fig. 2



Fig. 3



Fig. 4



Fig. 5


Semiconductor fuses (F1)

Aspects of fusing for the armature and field circuit of DC drives.

Unit configuration

Protection elements such as fuses, or overcurrent trip circuits are required in all cases to protect against further damage. In some configurations, this will entail the following questions:

1. Where to place which protective element?
2. In the event of what faults will the element in question provide protection against damage?

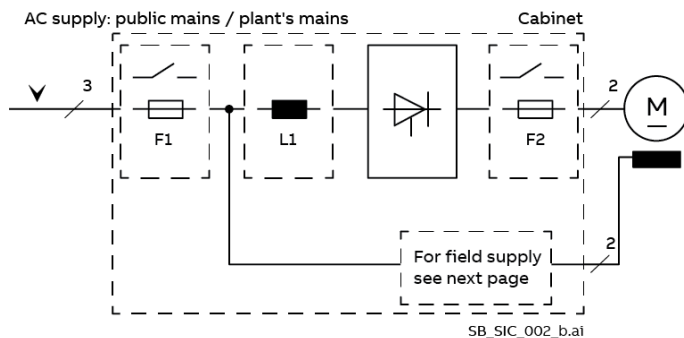


The figure shows the arrangement of the switch-off elements in the armature-circuit. Further information is available in the [Technical guide](#).

Conclusion for the armature circuit

Never use standard fusing instead of semiconductor fusing in order to save money on the installation. In the event of a fault condition, the small amount of money saved can cause the semiconductors or other devices to explode and cause fires. Adequate protection against short circuit and earth fault, as depicted in the EN50178 standard, is possible only with appropriate semiconductor fuses.

Use DC fuses (2 of them) for all regenerative drives of sizes H1 ... H4 to protect the motor in case of a fault during regeneration. DC fuses must be rated for the same current and voltage as AC fuses, thus follows DC fuses = AC fuses.

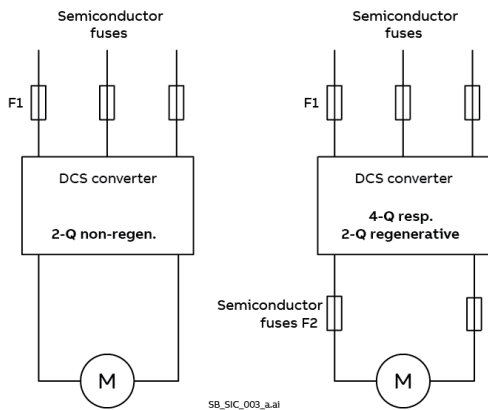

Typical selection of DC fuses/DC-breakers.

Operation mode	H1 ... H4	H5 ... H8
No regeneration	-	-
Seldom regeneration (< 10 %)	-	-
Regeneration (10 % ... 30 %)	DC fuses recommended	DC-breaker recommended
Often regeneration (> 30 %)	DC fuses strongly recommended	DC-breaker strongly recommended

Conclusion for the field circuit


Basically, similar conditions apply for both field and armature circuit. Depending on the converter used, half-controlled bridge or fully controlled bridge, some of the fault sources may not always be applicable. Due to special system conditions, such as supply via an autotransformer or an isolating transformer, new protection conditions may occur.

The following configurations are very often used:

In contrast to the armature circuit, fuses are never used on the DC side of the field circuit, since a fuse trip might lead to additional damage e.g., small, but long-lasting overcurrent, contact problems, explosions, fires, etc.


Semiconductor fuses F3.1 (super-fast acting) should be used, in case of similar conditions compared to the armature circuit (4-Q operation). E.g., protection of the field circuit and the field winding.

Configuration for the field circuit.

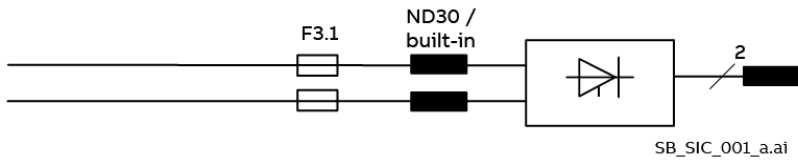

Fuses F3.2 and F3.3 are used as line protectors and **cannot protect the field supply** unit. Only pure HRC fuses or miniature circuit-breakers must be used. Semiconductor fuses will be tripped, for example, by the transformer's inrush current.

Configuration for the field circuit.

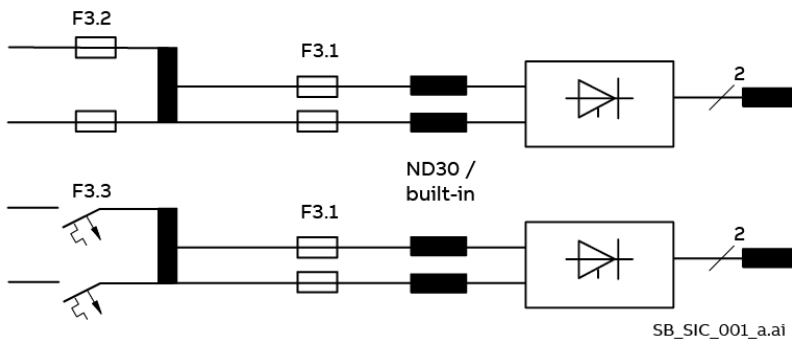

Semiconductor fuses (F1) and fuse holders for the armature circuit

The converters are subdivided into two groups:

- Units size H1 ... H4 with rated currents up to 1000 A require external fuses.
- In units size H5 ... H8 with rated currents from 900 A ... 5200 A, branch fuses are internally installed (no additional external AC or DC fuses are needed).

The fourth column of the table below assigns the AC fuse to the unit. In case the converter should be equipped with DC fuses, use the same type of fuse as on the AC side.

Size	Converter type (2-Q)	Converter type (4-Q)	Fuse	Fuse holder	North America	
					Fuse type	Fuse holder
H1	DCS880-S01-0020-04/05	DCS880-S02-0025-04/05	50A 660V UR	OFAZ00 S3L	FWP-50B	1BS101
	DCS880-S01-0045-04/05	DCS880-S02-0050-04/05	80A 660V UR	OFAZ00 S3L	FWP-80B	1BS101
	DCS880-S01-0065-04/05	DCS880-S02-0075-04/05	125A 660V UR	OFAZ00 S3L	FWP-125A	1BS103
	DCS880-S01-0090-04/05	DCS880-S02-0100-04/05	125A 660V UR	OFAZ00 S3L	FWP-125A	1BS103
H2	DCS880-S01-0135-04/05	DCS880-S02-0150-04/05	200A 660V UR	OFAZ1 S3	FWP-200A	1BS103
	DCS880-S01-0180-04/05	DCS880-S02-0200-04/05	250A 660V UR	OFAZ1 S3	FWP-250A	1BS103
	DCS880-S01-0225-04/05	DCS880-S02-0250-04/05	315A 660V UR	OFAZ1 S3	FWP-300A	1BS103
	DCS880-S01-0270-04/05	DCS880-S02-0300-04/05	500A 660V UR	OFAZ1 S3	FWP-500A	1BS103
H3	DCS880-S01-0290-06	DCS880-S02-0320-06	500A 660V UR	OFAZ3 S3	FWP-500A	1BS103
	DCS880-S01-0315-04/05	DCS880-S02-0350-04/05	500A 660V UR	OFAZ1 S3	FWP-500A	1BS103
	DCS880-S01-0405-04/05	DCS880-S02-0450-04/05	700A 660V UR	OFAZ1 S3	FWP-700A	①
	DCS880-S01-0470-04/05	DCS880-S02-0520-04/05	700A 660V UR	OFAZ1 S3	FWP-700A	①
H4	DCS880-S01-0590-06	DCS880-S02-0650-06	900A 660V UR	3 x 170H 3006	FWP-900A	①
	DCS880-S01-0610-04/05	DCS880-S02-0680-04/05	900A 660V UR	3 x 170H 3006	FWP-900A	①
	DCS880-S01-0740-04/05	DCS880-S02-0820-04/05	900A 660V UR	3 x 170H 3006	FWP-900A	①
	DCS880-S01-0900-04/05	DCS880-S02-1000-04/05	1250A 660V UR	3 x 170H 3006	FWP-1200A	①

① No fuse holder is available; attach the fuses directly to the busbar.

Fuses and fuse holders for the armature circuit (details see chapter [Fuses and fuse holders IEC](#)).

Fuses (F3.x) and fuse holders for the field circuit

Depending on the protection strategy different types of fuses are used. The fuses can be sized according to the maximum field current. In this case take the fuse, which fits to the rated field current levels. If the field converter is connected to two phases of a network, two fuses should be used. In case the unit is connected to one phase and neutral only one fuse at the phase can be used. The table below lists the fuse currents depending on the table above.

Field converter type	Field current	F3.1	F3.2	F 3.3
DCF803-0016	$I_F \leq 6 \text{ A}$	10 A 660 V UR ①	OFAA 00 H10	10 A
FEX-425-Int ①	$I_F \leq 12 \text{ A}$	16 A 660 V UR ①	OFAA 00 H16	16 A
DCF803-0035	$I_F \leq 16 \text{ A}$	25 A 660 V UR ①	OFAA 00 H25	25 A
DCF803-0050				
DCF804-0050				
FEX-425-Int ①	$I_F \leq 25 \text{ A}$	50 A 660 V UR ①	OFAA 00 H50	35 A
DCF803-0035				
DCF803-0050	$I_F \leq 35 \text{ A}$			50 A
DCF804-0050				
DCF803-0035	$I_F \leq 50 \text{ A}$	80 A 660 V UR	OFAA 00 H80	63 A
DCF803-0050				
DCF804-0050	$I_F \leq 60 \text{ A}$			80 A
DCF803-0060				
DCF804-0060				
Type of protection elements		Semiconductor fuse fuse holder OFAZ 00 S3L	LV HRC type for 690 V, fuse holder OFAZ 00 S3L	Circuit breaker for 500 V or 690 V

① Fuse (F3.1) KTK25 included in FEX-425-Int package. H5 field fuses are external. H6 field fuses are internal.

Fuses and fuse holders for the field circuit.

Single-phase autotransformer (T3) for the excitation (adapt voltage)

The field converters insulation voltage is higher than its rated voltage (see chapter [Accessories](#)). This provides the possibility in systems with more than 500 V mains voltage to supply the field converter directly. An autotransformer is used to match the mains voltage to the field voltage. Moreover, the autotransformer reduces the voltage ripple. Different autotransformer types (primary voltages from 400 ... 500 V and from 525 ... 690 V) with several rated currents are available.

Field converter type	Field current	Autotransformer type
DCF803-0016 FEX-425-Int	$I_F \leq 6 \text{ A}$	$U_{\text{prim}} \leq 500 \text{ V}$
DCF803-0035		T 3.01
DCF803-0050		T 3.02
DCF804-0050		T 3.03
FEX-425-Int DCF803-0035 DCF803-0050 DCF804-0050	$I_F \leq 30 \text{ A}$	T 3.04
DCF803-0050 DCF804-0050		T 3.05
DCF803-0060 DCF804-0060		T 3.16 (on request)
DCF803-0016 FEX-425-Int		$U_{\text{prim}} \leq 600 \text{ V}$
DCF803-0035	$I_F \leq 6 \text{ A}$	T 3.11
DCF803-0050	$I_F \leq 12 \text{ A}$	T 3.12
DCF804-0050	$I_F \leq 16 \text{ A}$	T 3.13
FEX-425-Int DCF803-0035 DCF803-0050 DCF804-0050	$I_F \leq 30 \text{ A}$	T 3.14
DCF803-0050 DCF804-0050		T 3.15
DCF803-0060 DCF804-0060		T 3.16 (on request)
DCF803-0050 DCF804-0050		$U_{\text{prim}} \leq 690 \text{ V}$
DCF803-0060 DCF804-0060	$I_F \leq 6 \text{ A}$	T 3.11
	$I_F \leq 12 \text{ A}$	T 3.12
	$I_F \leq 16 \text{ A}$	T 3.13
	$I_F \leq 30 \text{ A}$	T 3.14
	$I_F \leq 50 \text{ A}$	T 3.15
DCF803-0060 DCF804-0060	$I_F \leq 60 \text{ A}$	T 3.16 (on request)



Autotransformer (T3)

Autotransformer data, details see chapter [Autotransformer \(T3\)](#).

Line reactors for single- and 3-phase connection of the excitation

Field converters DCF803-0016, FEX-425-Int and DCF803-0035 need additional external line reactors.

Field converters DCF803-0050, DCF804-0050, DCF803-0060 and DCF804-0060 do not need additional line reactors since they already have internal line reactors.

Field converter type	Field current	Line reactor type			
		IEC		US	
		Single-phase	3-phase	Single-phase	3-phase
DCF803-0016 FEX-425-Int. DCF803-0035	$I_f \leq 16 \text{ A}$	ND30	ND401 ①	KLR 45 CTB ①	
FEX-425-Int. DCF803-0035	$I_f \leq 25 \text{ A}$	ND402 ①			
DCF803-0035	$I_f \leq 35 \text{ A}$				



ND30



ND401

ND402


① 3-phase operation or single-phase operation.

Line reactors (details see chapter [Line reactors IEC](#)).

Auxiliary transformer (T2) for electronic system/fan supply

The drives size H1 ... H8 require various auxiliary voltages. E.g., the drives' electronics require 115 V or 230 V single-phase.


The fans require 230 V single-phase or 400 V/460 V/500 V 3-phase supply, according to their size. The auxiliary transformer (T2) is designed to supply the drives' electronic system and all the single-phase fans for drives size H4 ... H6.

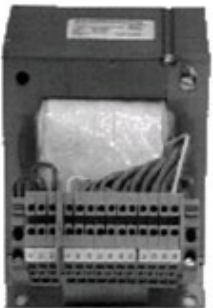	Input voltage: 230/380 ... 690 V single-phase; 50/60 Hz. Output voltage: 115/230 V single-phase. Power: 1400 VA.
	Auxiliary transformer data, details see chapter Auxiliary transformer (T2) .

Overvoltage protection at the secondary side of high voltage transformers

Drives size H7 and H8 are typically connected to a dedicated transformer. That means no other consumer is connected in parallel between the dedicated transformer and the drive. For details see chapter [Line reactors \(L1\)](#).

Configurations without a load switching device between the dedicated transformer and the drive but switching on the high voltage side using a high voltage circuit breaker (HVCB) are very typical.

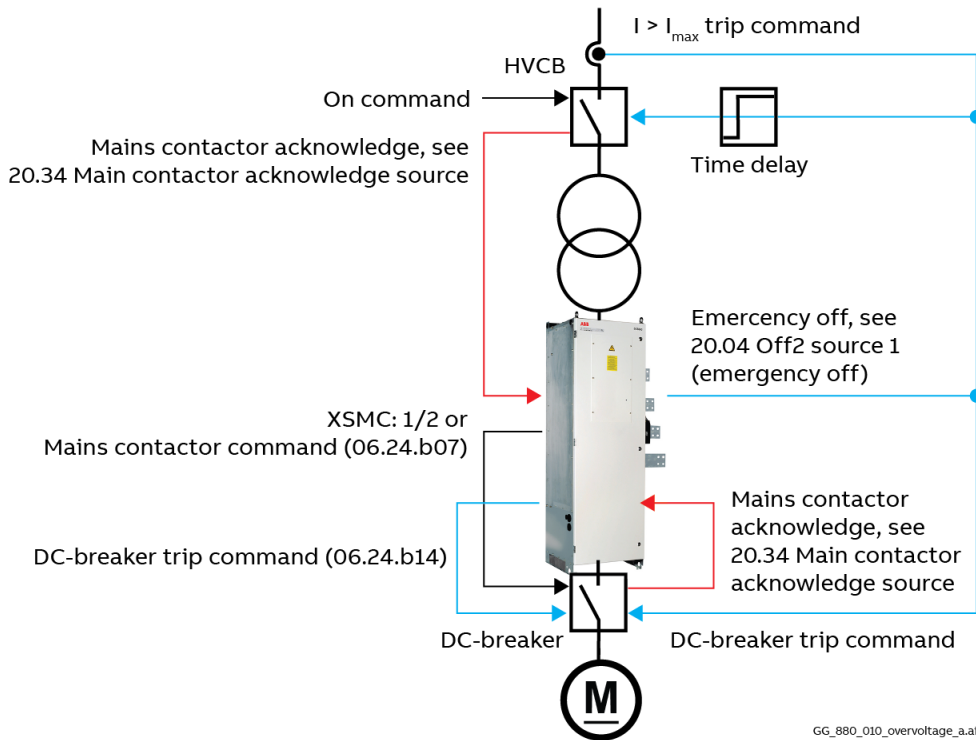

Switching the HVCB

Switching at the primary side using a HVCB in combination with high-speed DC-breaker requires additional protection of the drive against voltage transients.

Switching the HVCB influences the secondary side of the transformer and can create dangerous transients (voltage spikes). These transients are transmitted due to the capacitive coupling between primary and secondary side of the transformer. The size of the transients depends on:

- The winding configuration between primary and secondary side of the transformer.
- The existence of a shield winding between primary and secondary side of the transformer.
- The type of HVCB.
- The switching behavior of the HVCB.

Capacitive clamping

The most common solution to get rid of the transients are capacitors. They need to be dimensioned and must fit to the drive operation. During operation the drive creates cyclic commutation notches and commutation spikes. The typical size is about 2 ... 2.5 times of the mains voltage. The maximum blocking voltage of the thyristors is 3 times its nominal voltage or higher.

Capacitive suppression is not really suppression, it is capacitive clamping or damping.

Capacitors connected direct at the input of the drive create additional high current spikes when the thyristors are switched on. This current must be limited during normal operation to prevent damage to the thyristors. The current limitation is made by limiting the capacitance. The value of the capacitance depends on experience and is a compromise between:

- Clamping the voltage spikes which are generated by the HVCB.
- To avoid overloading the drive's thyristors.

The capacitive clamping is not sensitive to isolated secondary supply and voltage shift to ground. Therefore, it is preferred the solution for the drives.




Example

The below selected capacitors are only valid for drives size H7 and H8.

Note: Smaller drives will be overloaded and damaged by such capacitance clamping.

Capacitor type:

- The capacitors must be built for cyclic high peak currents, like inverter switching capacitors.
- $C = 120 \text{ nF}$.
- $U_{\text{nominal voltage}} = 4 \text{ kV}$.

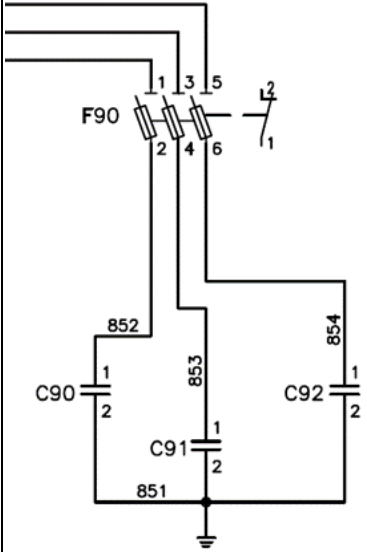Capacitor type	Fuse type	Circuit diagram
		

Such Capacitor to ground connection is a so call “Y capacitor” configuration. It is very efficient because towards ground the full capacitance is active but between the phases only 50 % of the capacitance is active.

All parts needed for this “Y capacitor” configuration can be ordered from ABB with the order number: 3ADT200081R0001. Parts list:

- F90: 1 x fuse holder with 3 branches.
3 x fuse 10 A, 1500 V_{AC}, SCCR 100 kA, size 125 mm, Ø 20 mm, e.g., Ferraz FD20GB100V10T.
- C90: 3 x capacitor 4 kV, 120 nF.

EMC filters (E1)

Filter in a grounded line (earthed TN or TT network)

The filters are suitable for grounded lines only, for example in public European 400 V_{AC} lines. According to EN 61800-3 filters are not needed in insulated industrial networks with own supply transformers. Furthermore, they could cause safety risks in such floating lines (IT networks). According to EN 61800-3 filters are not needed in industrial zone (Second Environment) for DCS880 drives above 100 A_{DC} rated current. For rated currents below 100 A_{DC} the filter requirement is identical to Light Industry (First Environment).

Three-phase filters

EMC filters are necessary to fulfil the standard for emitted interference if a converter shall be run at a public low voltage line, in Europe for example with 400 V_{AC}. Such lines have a grounded neutral conductor. ABB offers suitable three-phase filters for 400 V_{AC}. For 440 V_{AC} public low voltage lines outside Europe 500 V_{AC} filters are available. Optimize the filters for the real motor currents:


$I_{\text{Filter}} = 0.8 \times I_{\text{MOT max}}$; the factor 0.8 respects the current ripple.

Lines with 500 V_{AC} up to 1000 V_{AC} are not public. They are local networks inside factories, and they do not supply sensitive electronics. Therefore, converters do not need EMC filters if they shall run with 500 V_{AC} and more.

Size	Converter type (2-Q)	IDC [A]	Converter type (4-Q)	IDC [A]	Filter type for d = 4	Filter type for d = 5
H1	DCS880-S01-0020-0d	20	DCS880-S02-0025-0d	25	NF3-440-25	NF3-500-25
	DCS880-S01-0045-0d	45	DCS880-S02-0050-0d	50	NF3-440-50	NF3-500-50
	DCS880-S01-0065-0d	65	DCS880-S02-0075-0d	75	NF3-440-64	NF3-500-64
	DCS880-S01-0090-0d	90	DCS880-S02-0100-0d	100	NF3-440-80	NF3-500-80
H2	DCS880-S01-0135-0d	135	DCS880-S02-0150-0d	150	NF3-440-110	NF3-500-110
	DCS880-S01-0180-0d	180	DCS880-S02-0200-0d	200	NF3-500-320	NF3-500-320
	DCS880-S01-0225-0d	225	DCS880-S02-0250-0d	250	NF3-500-320	NF3-500-320
	DCS880-S01-0270-0d	270	DCS880-S02-0300-0d	300	NF3-500-320	NF3-500-320
H3	DCS880-S01-0315-0d	315	DCS880-S02-0350-0d	350	NF3-500-320	NF3-500-320
	DCS880-S01-0405-0d	405	DCS880-S02-0450-0d	450	NF3-500-600	NF3-500-600
	DCS880-S01-0470-0d	470	DCS880-S02-0520-0d	520	NF3-500-600	NF3-500-600
H4	DCS880-S01-0610-0d	610	DCS880-S02-0680-0d	680A	NF3-500-600	NF3-500-600
	DCS880-S01-0740-0d	740	-	-	NF3-500-600	NF3-500-600
	-	-	DCS880-S02-0820-0d	820	NF3-690-1000 ①	NF3-690-1000 ①
	DCS880-S01-0900-0d	900	DCS880-S02-1000-0d	1000	NF3-690-1000 ①	NF3-690-1000 ①
H5	DCS880-S01-1190-0d	1190	DCS880-S02-1190-0d	1190	NF3-690-1000 ①	NF3-690-1000 ①
H6	DCS880-S01-0900-0d	900	DCS880-S02-0900-0d	900	NF3-690-1000 ①	NF3-690-1000 ①
	DCS880-S01-1200-0d	1200	DCS880-S02-1200-0d	1200	NF3-690-1000 ①	NF3-690-1000 ①
	DCS880-S01-1500-0d	1500	DCS880-S02-1500-0d	1500	NF3-690-1600 ①	NF3-690-1600 ①
	DCS880-S01-2000-0d	2000	DCS880-S02-2000-0d	2000	NF3-690-1600 ①	NF3-690-1600 ①
H7		≤ 3000		≤ 3000	NF3-690-2500 ①	NF3-690-2500 ①

① EMC filter on request.

EMC filters	<p>The paragraphs below describe selection of the electrical components in conformity with the EMC Guideline. The aim of the EMC Guideline is, as the name implies, to achieve electromagnetic compatibility with other products and systems. The guideline ensures that the emissions from the product concerned are so low that they do not impair another product's interference immunity. In the context of the EMC Guideline, two aspects must be borne in mind:</p> <ul style="list-style-type: none"> – The product's interference immunity. – The product's actual emissions. 	<p>The EMC Guideline expects EMC to be considered when a product is being developed; however, EMC cannot be designed in, it can only be quantitatively measured.</p> <p>Note on EMC conformity: The conformity procedure is the responsibility of both the power converter's supplier and the manufacturer of the machine or system concerned, in proportion to their share in expanding the electrical equipment involved.</p>
-------------	---	--

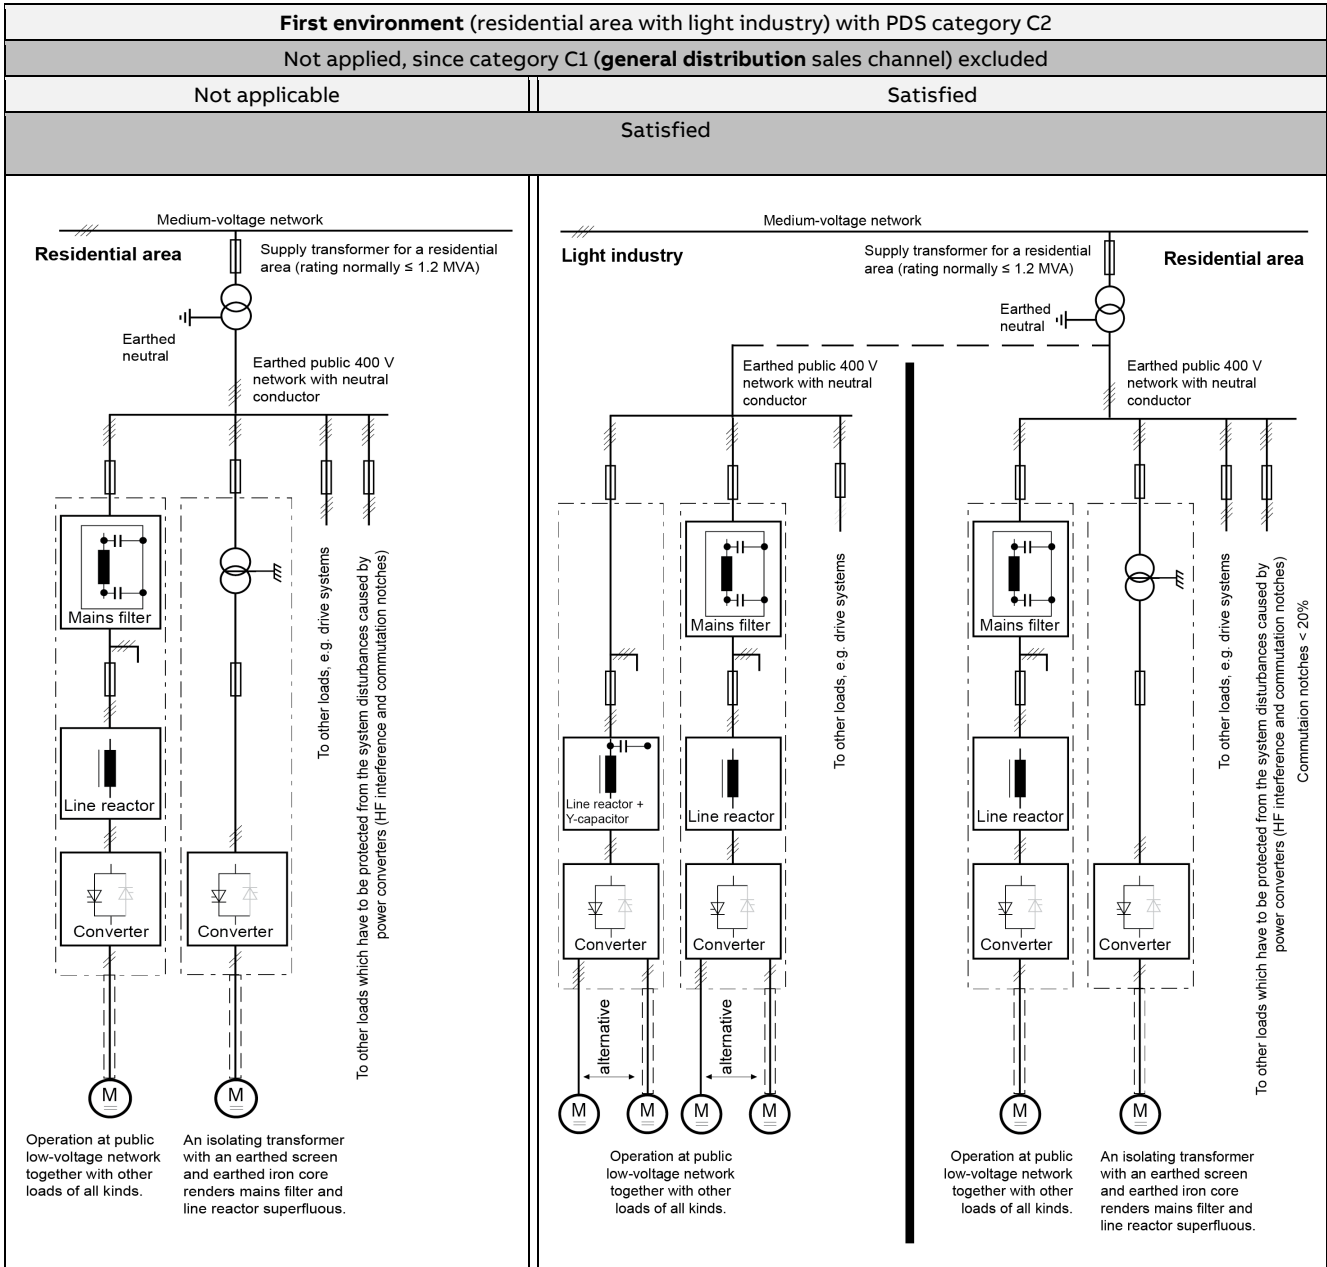


<p>For compliance with the protection objectives of the German EMC Act (EMVG) in systems and machines, the following EMC standards must be satisfied:</p> <p>Product Standard EN 61800-3 EMC standard for drive systems (PowerDriveSystem), interference immunity and emissions in residential areas, enterprise zones with light industry and in industrial facilities. This standard must be complied with in the EU for satisfying the EMC requirements for systems and machines!</p>	<p>For emitted interference, the following apply: EN 61000-6-3: Specialized basic standard for emissions in light industry can be satisfied with special features (mains filters, screened power cables) in the lower rating range *(EN 50081-1). EN 61000-6-4: Specialized basic standard for emissions in industry* (EN 50081-2). For interference immunity, the following apply: EN 61000-6-1: Specialized basic standard for interference immunity in residential areas*(EN 50082-1). EN 61000-6-2: Specialized basic standard for interference immunity in industry. If this standard is satisfied, then the EN 61000-6-1 standard is automatically satisfied as well *(EN 50082-2). * The old generic standards are given in brackets.</p>
---	--

			Standards
Second environment (industry) with PDS categories C3, C4			EN 61800-3
Not applicable			EN 61000-6-3
Satisfied	On customer's request	Satisfied	EN 61000-6-4
Satisfied			EN 61000-6-2 EN 61000-6-1
<p style="font-size: small;">Medium-voltage network Industrial zone Supply transformer for a residential area (rating normally ≤ 1.2 MVA) Earthed neutral Earthed 400 V network with neutral conductor ; 3~ ≤ 400 A I_{bc} < 100 A I_{bc} < 100 A I_{bc} > 100 A Mains filter Line reactor + Y-capacitor Line reactor Line reactor Converter Converter Converter alternative M M M M M M To other loads, e.g. drive systems Commutation notches < 40% Operation at low-voltage network together with other loads of all kinds, apart from some kinds of sensitive communication equipment.</p>		<p style="font-size: small;">Medium-voltage network Industrial zone Converter transformer Converter transformer with earthed iron core (and earthed screen where appropriate) I > 400 A and / or U > 500 V Case-referenced EMC analysis Line reactor Converter Converter alternative M M M M To other loads, e.g. drive systems Operation with separate power converter transformer. If there are other loads at the same secondary winding, these must be able to cope with the commutation gaps caused by the power converter. In some cases, commutating reactors will be required.</p>	
<p>Classification The following overview utilizes the terminology and indicates the action required in accordance with Product Standard. EN 61800-3 For the DCS880 series, the limit values for emitted interference are complied with, provided the measure indicated is carried out. PDS of category C2 (formerly restricted distribution in first environment) is intended to be installed and commissioned only by a professional (person or organization with necessary skills in installing and/or commissioning PDS including their EMC aspects). For power converters without additional components, the following warning applies: This is a product of category C2 under IEC 61800-3:2004. In a domestic/residential environment this product may cause radio interference in which case supplementary mitigation measures may be required. The field supply is not depicted in this overview diagram. For the field current cables, the same rules apply as for the armature-circuit cables.</p>			
<p>Legend</p> <ul style="list-style-type: none"> Screened cable Unscreened cable with restriction 			

Converters size H1 ... H4 configuration using an OnBoard field exciter

Wiring the drive according to this diagram offers the highest degree of monitoring functions done by the drive.

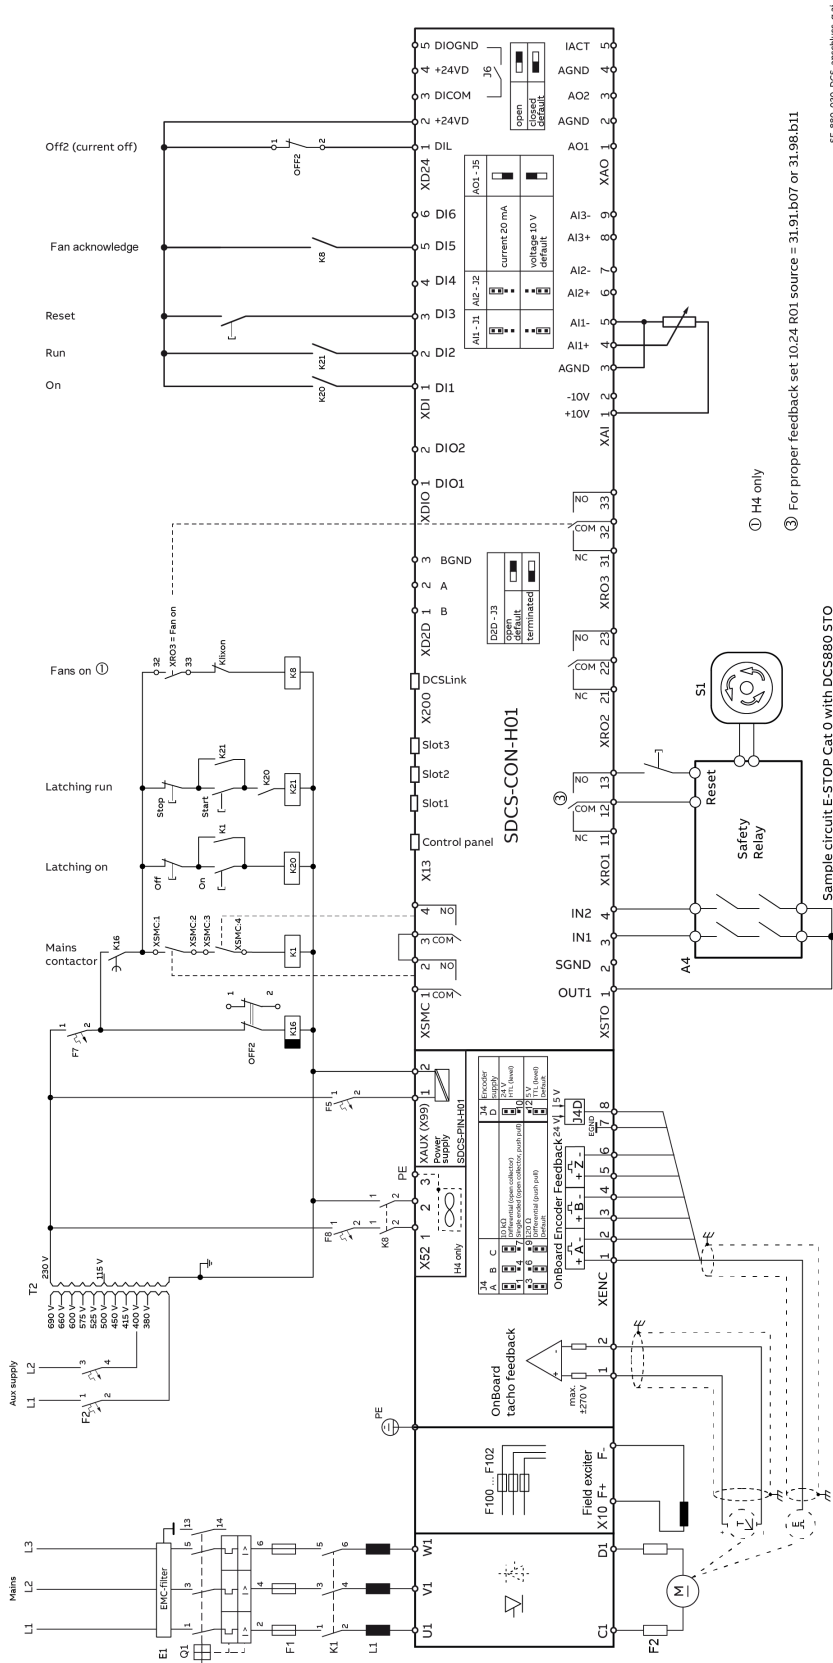

① H4 only


③ For proper feedback set I0.24 R01 source = 31.91.b07 or 31.98.b11

Sample circuit E-STOP Cat 0 with DCS880 STO

5F_880_020_DCS_amechukus_gal

Converters size H5 configuration using FEX-425-Int field exciter

Wiring the drive according to this diagram offers the highest degree of monitoring functions done by the drive. Field converters FEX-425-Int are equipped with their own synchronization and must be supplied from independent mains supply voltage max. 500 V (single-phase or 3-phase).

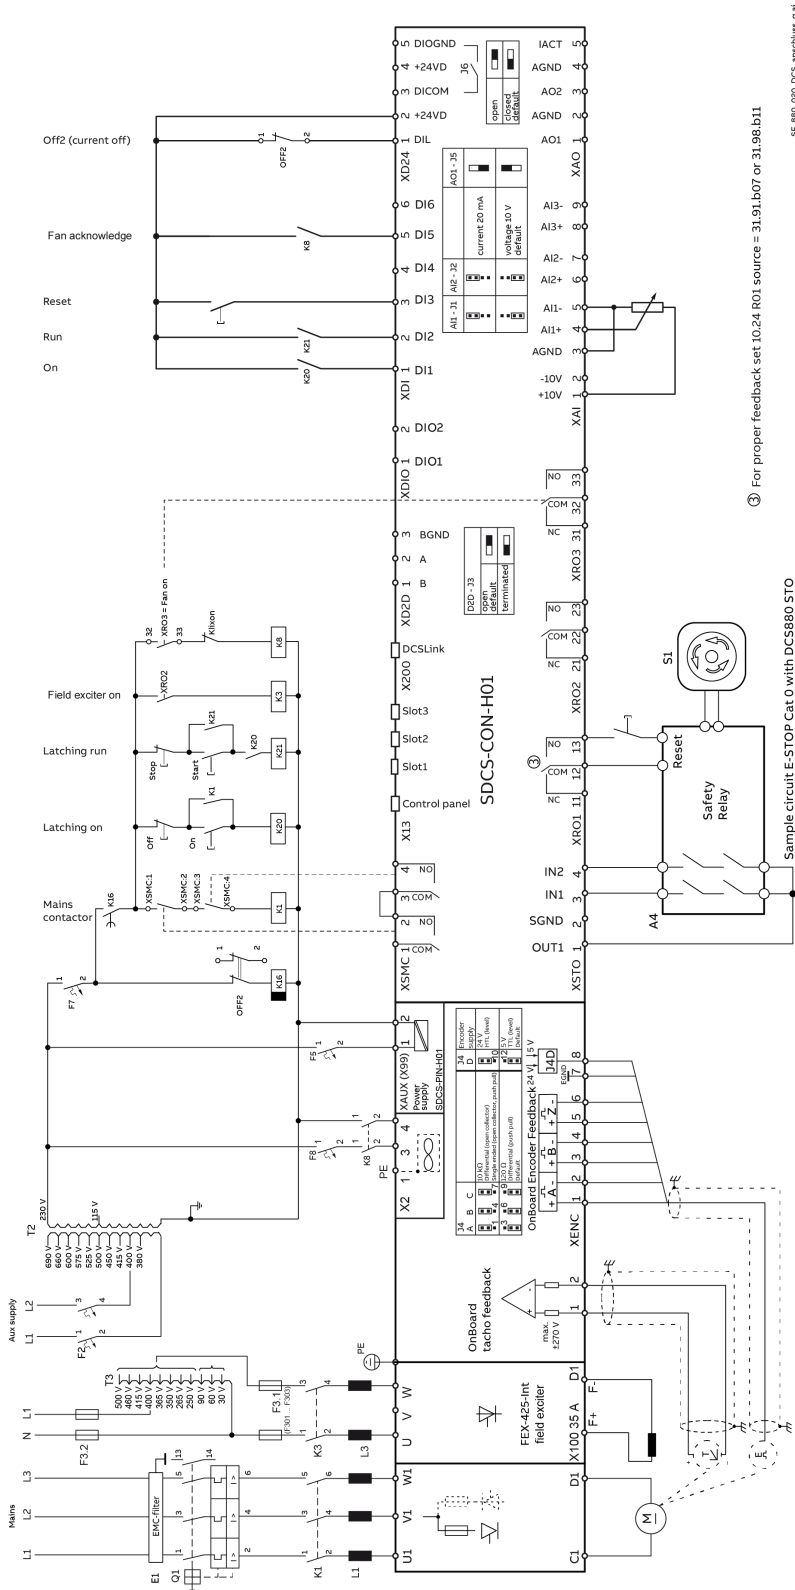


SE_080_030_DCS_amechm4a_gal

3 For proper feedback set I0.24 R01 source = 31.91.b07 or 31.98.b11

Sample circuit: E-STOP Cat 0 with DCS880 STO

Converters size H6 configuration using a FEX-425-Int field exciter

Wiring the drive according to this diagram offers the highest degree of monitoring functions done by the drive. Field converters FEX-425-Int are equipped with their own synchronization and must be supplied from independent mains supply voltage max. 500 V (single-phase or 3-phase).

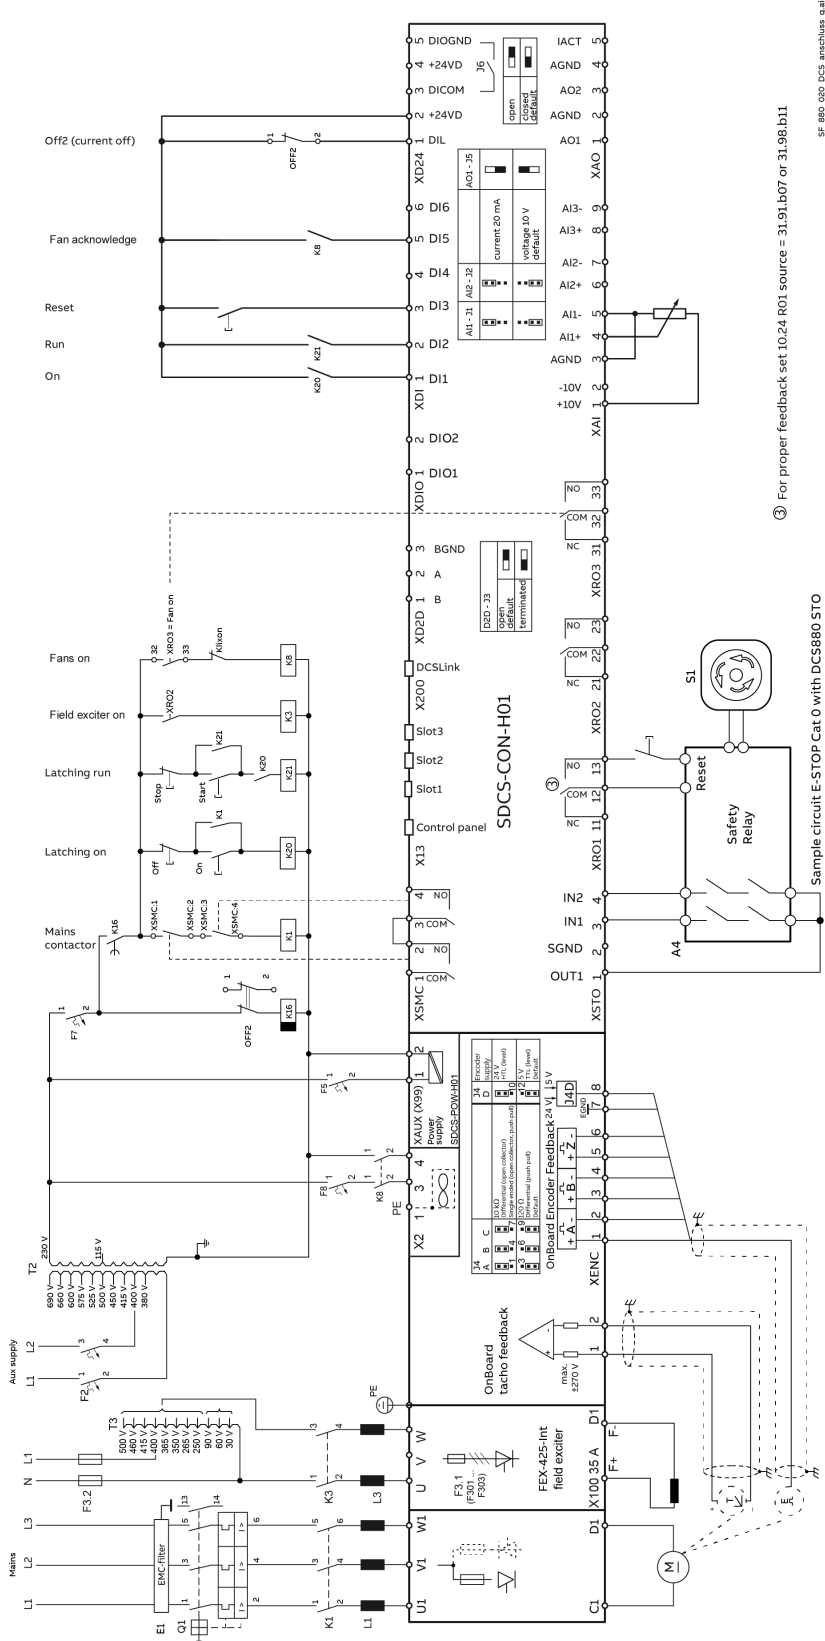


③ For proper feedback set 10.24 R01 source = 31.91.b07 or 31.98.b11

SF_880_OEG_DCS_anschluss_31.ai

Converters size H1 ... H6 configuration using external field exciters DCF803, DCF804

Wiring the drive according to this diagram offers the highest degree of monitoring functions done by the drive. Field converters DCF803/DCF804 are equipped with their own synchronization and must be supplied from independent mains supply voltage max. 500 V (single-phase or 3-phase).

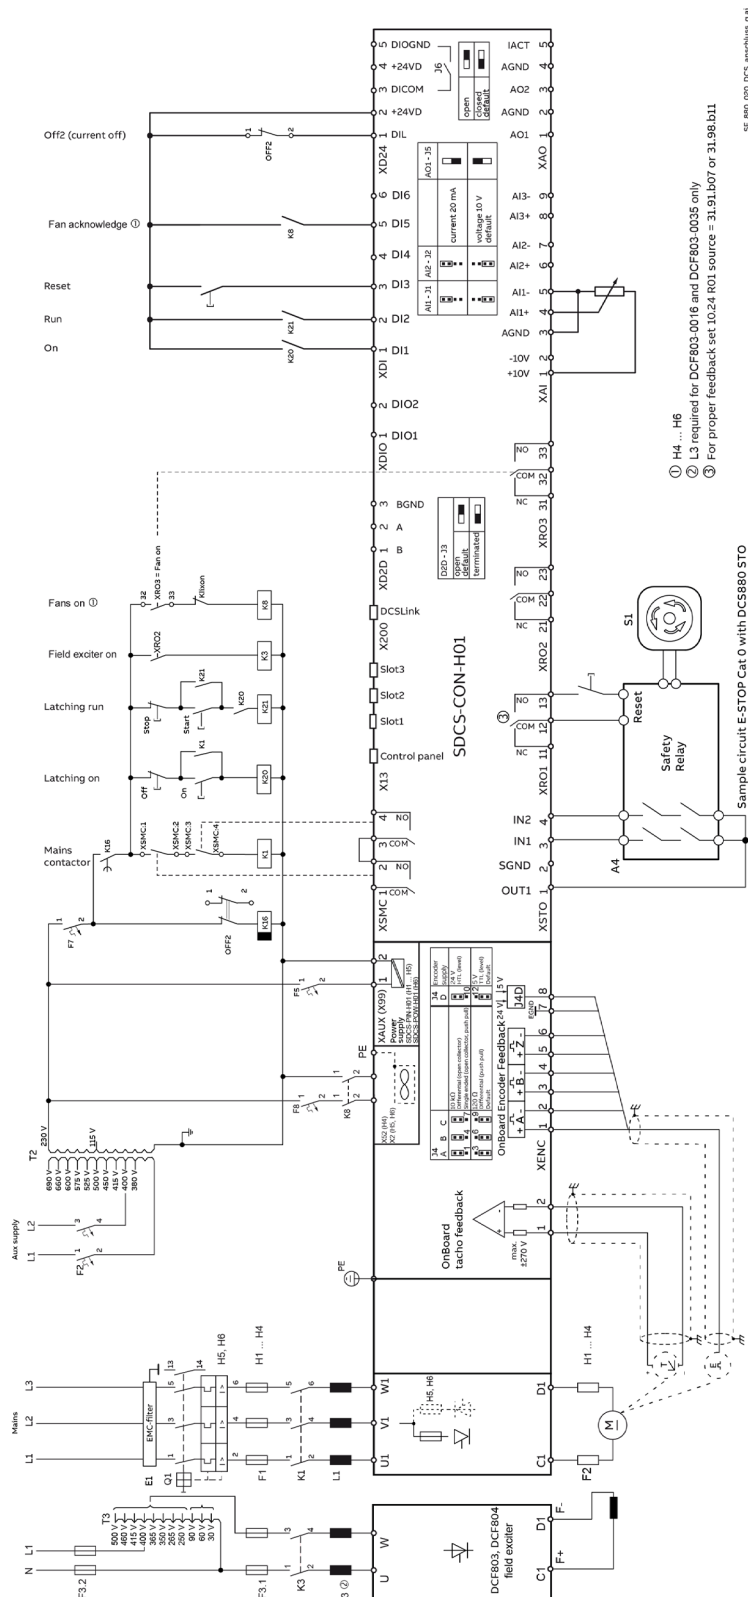


- ① H4 ... H6
- ② L3 required for DCF803-0016 and DCF803-0035 only
- ③ For proper feedback set.1024 ROI source = 31.91.B07 or 31.98.B11

sf_880_003_DCC_mwhchius_3.ai

Converters size H7 and H8 configuration using external field exciters DCF803, DCF804

Wiring the drive according to this diagram offers the highest degree of monitoring functions done by the drive. Field converters DCF803/DCF804 are equipped with their own synchronization and must be supplied from independent mains supply voltage max. 500 V (single-phase or 3-phase).

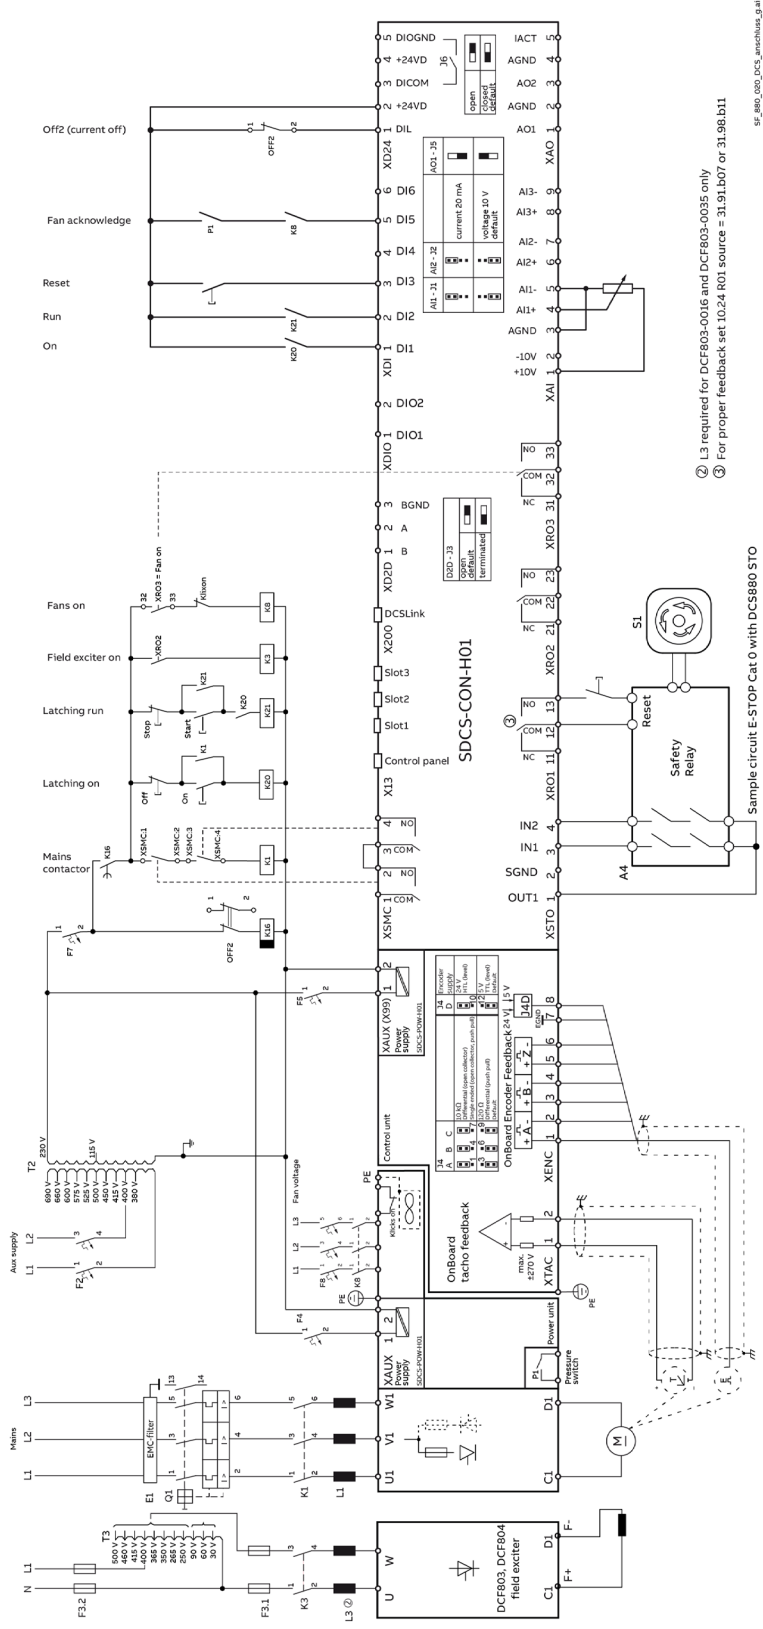


9F_880_000_DCS_mechanics_gal

- ② L3 required for DCF803-0016 and DCF803-0035 only
- ③ For proper feedback set 10.24 R01 source = 31.91.b07 or 31.98.b11

Converters size H1 ... H3 as large field exciter

Wiring the drive according to this diagram offers the highest degree of monitoring functions done by the drive.

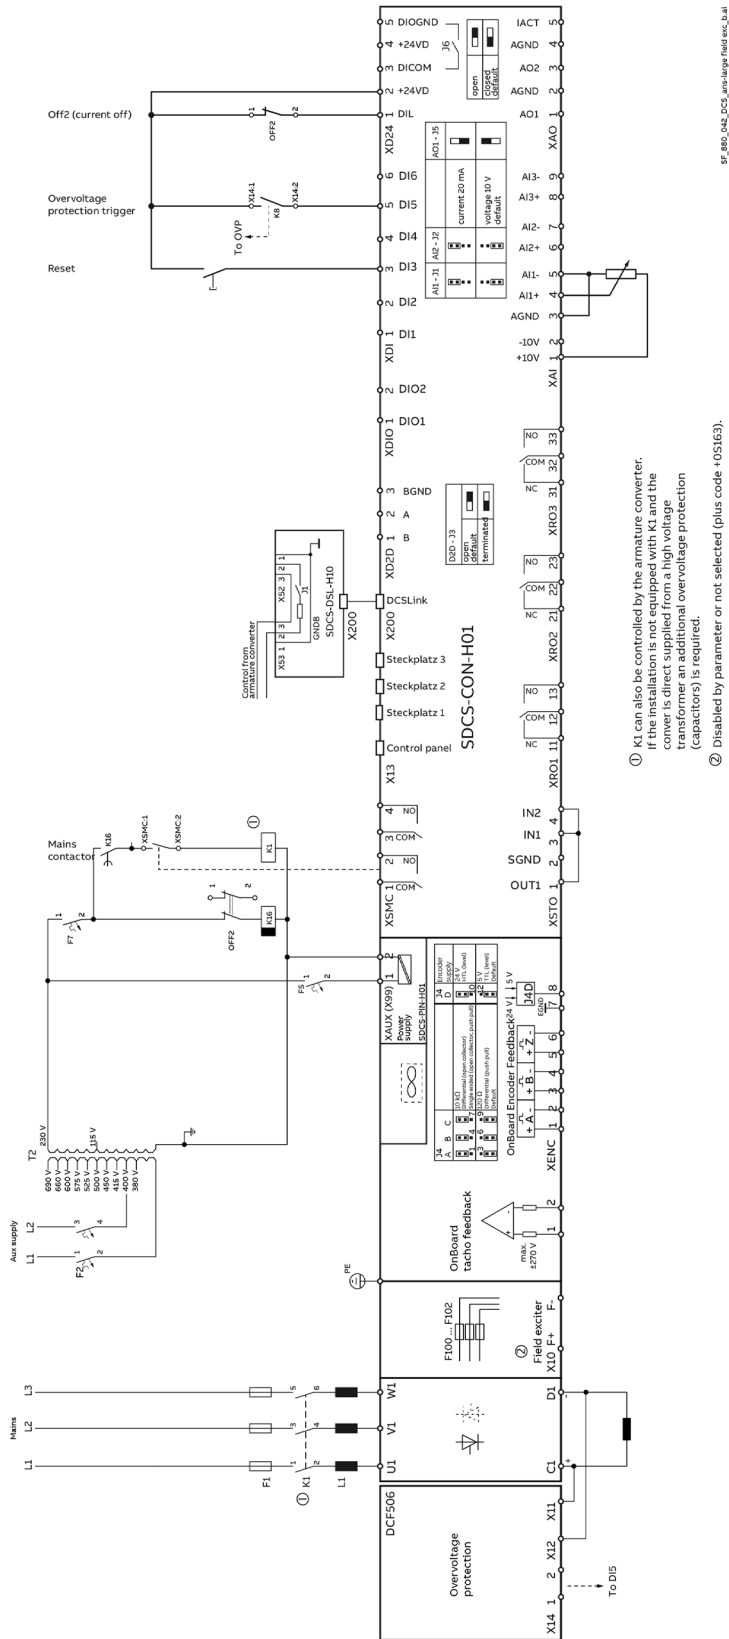


Start, Stop and E-Stop control

The relay logic is split into four parts:

1: Generation of the On/Off and Start/Stop commands:

The commands represented by K20 and K21 (latching interface relays) can also be generated by a PLC and transferred to the terminals of the converter either by relays, using galvanic isolation or directly via 24 V_{DC} signals.

There is no need to use hardwired signals. Transfer these commands via serial communication. Even a mixed solution can be realized by selecting different possibilities for the one or the other signal (see parameter groups 06 and 20):

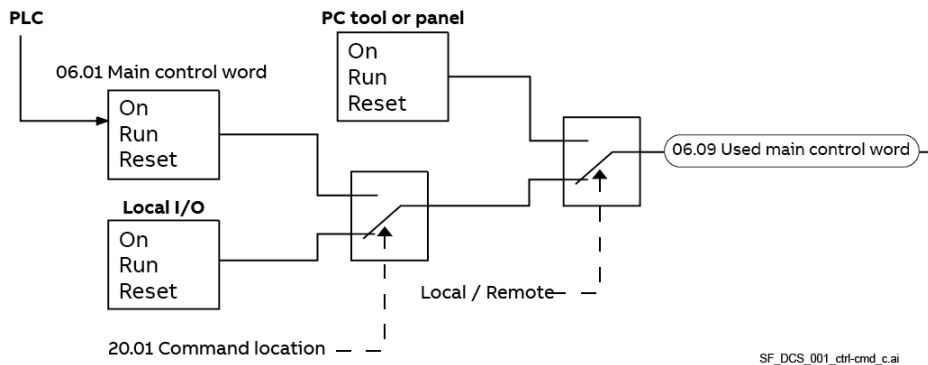

2: Generation of control and monitoring signals:

Control the mains contactor (K1) of the armature circuit by the relay contact of XSMC. The status of the drive and/or motor fans (K8) can be monitored by means of 20.38 Drive fan acknowledge source and 20.39 Motor fan acknowledge source.

3: Off2 (emergency off/electrical disconnect/fast current off) and Off3 (emergency stop):


Beside On/Off and Start/Stop the drive is equipped with two additional stop functions Off2 and Off3 according to Profibus standard.

Off3 is scalable via 21.03 Emergency stop mode to perform a stop according to category 1. Connect this function to the E-stop push button (Off3) without any time delay. In case of 21.03 Emergency stop mode = Ramp stop the timer relay (K15) must be set longer than 23.23 Emergency stop time. For 21.03 Emergency stop mode = Coast stop the drive opens the mains contactor immediately.


Off2 switches the DC current off as fast as possible and prepares the drive to open the mains contactor or drop the mains supply. For a normal DC motor load, the time to force the DC current to zero is below 20 ms. This function should be connected to all signals and safety functions opening the mains contactor. This function is important for 4-Q drives. Do not open mains contactor during regenerative current. The correct sequence is:

1. Switch off regenerative current.
2. Then open the mains contactor.

In case the E-stop push button is hit, the information is transferred to a digital input of the converter. In case 21.03 Emergency stop mode = Ramp stop, or Torque limit the converter will decelerate the motor and then open the mains contactor. If the drive has not finished the function within the timer relay (K15) setting, the drive must get the command to switch off the current via timer relay (K16). After the timer relay (K16) has elapsed, the mains contactor is opened immediately, independent of the drive's status.

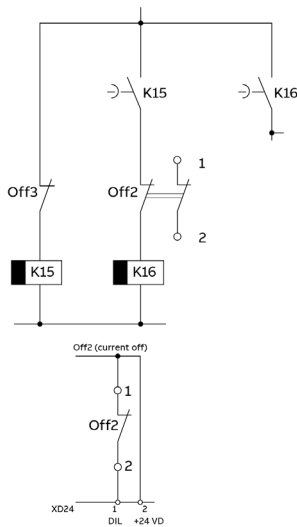


SF_CON4_001_E-stop_bal

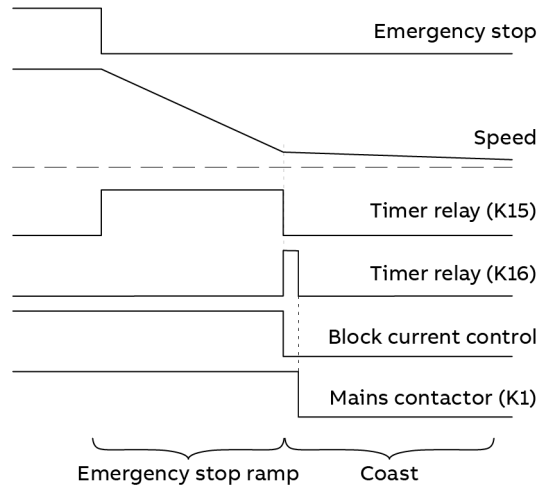


DZ_LIN_006_E-stop_d.ai

4: DC contactor (US style):

The DC contactor (US style) K1.1 is a special designed DC contactor with one normally closed contact for the dynamic braking resistor R_B and two normally open contacts for C1 and D1. The DC contactor should be controlled by 06.24.b10 Current controller status word 1. The acknowledge signal can be connected to either 20.34 Mains contactor acknowledge source, or 20.35 DC breaker acknowledge source. Use 20.33 Mains contactor control mode = DC contactor.

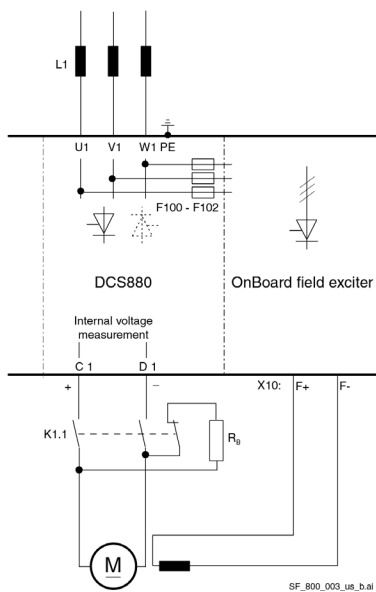

SF_800_003_us_b.ai

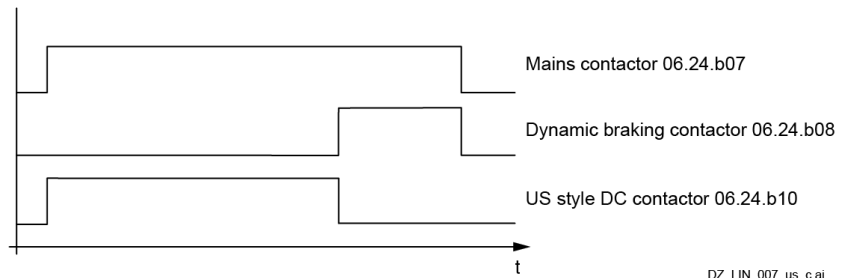

DZ_LIN_007_us_c.ai

	Internal DC voltage measurement	DC voltage measurement at the motor terminals
Without field weakening	20.44 Dynamic braking delay ≥ 0.1 s.	20.44 Dynamic braking delay ≤ -0.1 s.
With field weakening	Not allowed.	

Cooling fans

Fan assignment for DCS880

Converter type	Size	Configuration	Fan type	Airflow built in [m ³ /h]
DCS880-S0b-0045-04/05 ... DCS880-S0b-00100-04/05	H1	1	1 x 3110UL	57
DCS880-S0b-0135-04/05 ... DCS880-S0b-0300-04/05	H2	2	2 x AFB122	170
DCS880-S01-0290-06 DCS880-S02-0320-06 DCS880-S0b-0315-04/05 ... DCS880-S0b-0450-04/05	H3	3	2 x 3110UL 2 x AFB122	255
DCS880-S0b-0470-04/05 ... DCS880-S0b-0520-04/05				
DCS880-S01-0590-06 DCS880-S02-0650-06 DCS880-S0b-0610-04/05 ... DCS880-S0b-0820-04/05	H4	4	1 x W2E200 230 V; 1~	388
DCS880-S0b-0900-04/05 ... DCS880-S0b-1000-04/05			1 x W2E250 230 V; 1~	425
DCS880-S0b-1190-04/05	H5	5	R2E250-RB 230 V; 1~	800
DCS880-S0b-0900-0dX0 ... DCS880-S0b-2000-0dX0	H6 (classic)	5	R2E250-RE04-10 230 V; 1~	850
DCS880-S0b-0900-0dXB ... DCS880-S0b-2000-0dXB	H6 (ErP fan)			
DCS880-S0b-1900-0d ... DCS880-S0b-3000-0d	H7	6	GR28C-2DK 400 V/500 V @ 50 Hz or 460 V @ 60 Hz	1700
DCS880-S0b-2050-dd ... DCS880-S0b-5200-dd	H8	7	GR35C-2DD 400 V @ 50 Hz or 460 V @ 60 Hz	4500

b = Bridge type

d = Rated AC voltage

Fan cable sizes and tightening torque connected at the fan terminals

Fan terminals are X52 for H4, X2 for H5/H6 and U1, V1, W1 for H7/H8.

Converter type	Flexible cable		Solid cable	
	max [mm ²]	Torque [Nm]	max [mm ²]	Torque [Nm]
DCS880-S0b-0610-dd ... DCS880-S0b-1000-dd	0.5 ... 1.5	0.5 ... 0.6	0.5 ... 1.0	0.5 ... 0.6
DCS880-S0b-1190-dd ... DCS880-S0b-2000-dd	0.5 ... 1.5	0.5 ... 0.6	0.5 ... 1.0	0.5 ... 0.6
DCS880-S0b-1900-dd ... DCS880-S0b-3000-dd	0.5 ... 1.5	Push in	0.5 ... 1.5	Push in
DCS880-S0b-2050-dd ... DCS880-S0b-5200-dd	0.5 ... 1.5	0.6 ... 0.8	0.5 ... 1.5	0.6 ... 0.8

b = Bridge type


d = Rated AC voltage


Fan data for DCS880 (H1 ... H4)

Fan	3110UL	AFB122	W2E200		W2E250	
Rated voltage [V _{AC}]	24 V internal	24 V internal	230; 1~		230; 1~	
Tolerance [%]			+6/-10		+6/-10	
Frequency [Hz]			50	60	50	60
Power consumption [W]			64	80	135	185
Current consumption [A]			0.29	0.35	0.59	0.82
Blocking current [A]			< 0.7	< 0,8	< 0.9	< 0.9
Air flow [m ³ /h] freely blowing	50	190	925	1030	1835	1910
Max. ambient temperature [°C]	< 70	< 70	< 75		< 60	
Useful lifetime of grease	70,000 H @ 25°	100,000 H @ 25°	appr. 45,000 h @ 60°		appr. 40,000 h	
Protection	Internal temperature detectors					


Fan connection for DCS880 (H1 ... H4)

----- Terminals are located on top of the converter housing -----


Converter housing: 

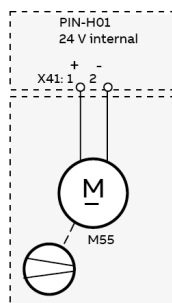


Configuration 1
H1

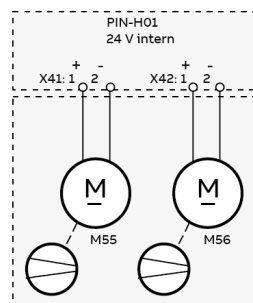

Configuration 2
H2 ... H3

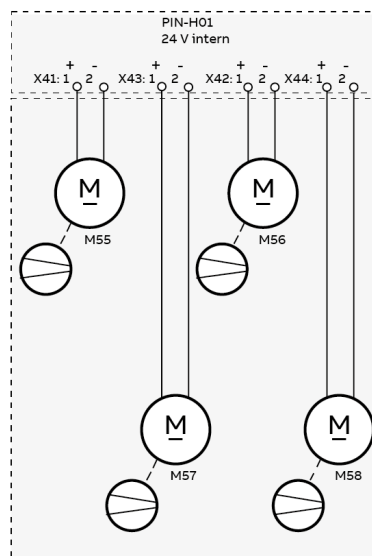

Configuration 3
H3



SA_880_011_DCS_FAN_c.ai

Configuration 4
H4

Fan data for DCS880 (H5 ... H8)

Sizes H5 and H6

Fan	R2E250-RB (classic fan)		R2E250-RE04-10 (ErP fan)	
Rated voltage [V _{AC}]	230; 1~		230; 1~	
Tolerance [%]	±10		+10/-15	
Frequency [Hz]	50	60	50	60
Power consumption [W]	227	390	220	348
Current consumption [A]	1.10	1.70	1.00	1.57
Blocking current [A]	3.1	3.1	2.5	2.4
Air flow [m ³ /h] freely blowing	800 1.0 A	850 1.6 A	800 0.9 A	850 1.5 A
Max. ambient temperature [°C]	< 55		< 80	< 50
Useful lifetime of grease	appr. 40,000 h @ 40°C		appr. 40,000 h @ 40°C	
Protection	Internal			


Sizes H7 and H8

Fan	GR28C-2DK		GR35C-2DD	
Rated voltage [V _{AC}]	400 Δ 500 λ	460 Δ	400/460 ①/ 500 ①	460 ②
Tolerance [%]	±10			
Frequency [Hz]	50	60	50	60
Power consumption [W]	660 Δ 600 λ	1100 Δ	2100	3000
Current consumption [A]	1.4 Δ 0.8 λ	1.8 Δ	4.0 Δ	5.3 Δ
Blocking current [A]	@ 400 V Δ 8.0 @ 500 V λ 2.8	@ 460 V Δ 8.0	@ 400 V > 17	@ 460 V > 15
Air flow [m ³ /h] freely blowing	1600 @ 1.2 A (400 V Δ) 1500 @ 0.7 A (500 V λ)	1700 @ 1.6 A (460 V Δ)	4000 @ 4 A (400 V)	4500 @ 5.3 A (400 V)
Max. ambient temperature [°C]	< 55			
Useful lifetime of grease	appr. 30,000 h @ 40°C			
Protection	Temperature detector: U _N ≤ 230 V~; I _N ≤ 2.5 A~			

- ① The fan needs an input voltage of 400 V_{AC} @ 50 Hz. For 460 V_{AC}/500 V_{AC} use autotransformer (T8).
 ② The fan needs an input voltage of 460 V_{AC} @ 60 Hz.

Fan connection for DCS880 (H5 ... H8)

Converter housing:

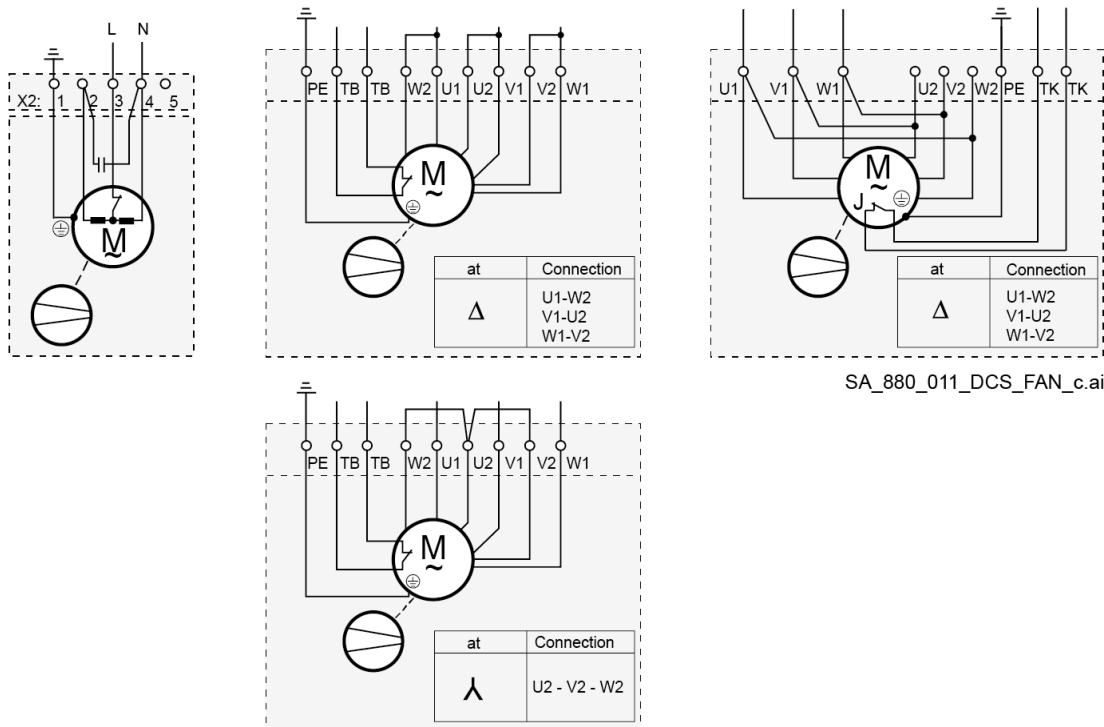

Configuration 5
H5, H6

Configuration 6
H7

Configuration 7
H8

Monitoring the DCS880 power section

The power part of converters size H1 ... H6 is monitored by means of a galvanic isolated PTC thermistor. The PTC is installed on the heat sink in an isolated configuration. The PTC's resistance and protective effect correspond to the maximum temperature defined by the type code.

The air entry temperature at the power part of converters size H7 and H8 is monitored by means of a galvanic isolated PTC thermistor. The sensor measures the power part's radiated heat and any changes in the cooling air temperature and volume.

The PTC's resistance change is proportional to the temperature. It is read and evaluated in the drive's firmware. If the temperature increases above the preset value, then first a warning and, if the temperature continues to rise, a fault message is generated. The preset value must not be set more than 5 degrees above the permissible ambient temperature.


For converters size H7 and H8 the cooling air volume can only be detected indirectly. Thus, additionally a differential-pressure switch has been installed at the unit's housing. It is always located close to the power terminals.

The differential-pressure switch compares the pressure inside the drive with the normal air pressure. If the fan is switched on, the drive's door is closed, no covers have been removed and the pressure switch signals 'cooling conditions ok' it is possible to release the converter. There is no need to set a specific differential pressure (recommendation: use the center setting). The differential-pressure switch should be connected to the converter fan acknowledge signal.

Implementing thermal overload and short-circuit protection

Protecting drive and input power cables in case of short-circuits

Protect drive and input cables using fuses as follows:

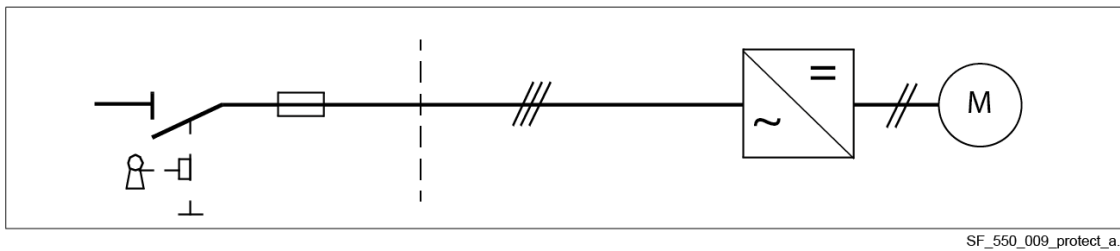

Size the fuses at the distribution board according to instructions given in chapter [Technical data](#). The fuses will protect the input cables in short-circuit situations, restrict drive damage, and prevent damage to adjoining equipment in case of a short-circuit inside the drive.

Circuit breakers

The protective characteristics of circuit breakers depend on their type, construction, and settings. There are also limitations regarding to the short-circuit capacity of the supply network. Your local ABB representative can help you in selecting the breaker type when the supply network characteristics are known.

WARNING

Due to the inherent operating principle and construction of circuit breakers, independent of the manufacturer, hot ionized gases can escape from the breaker enclosure in case of a short-circuit. To ensure safe use, pay special attention to the installation and placement of the breakers. Obey the manufacturer's instructions.

Protecting the motor and motor cable in case of short-circuits

The drive protects the motor cables and motor in a short-circuit situation when the motor cables are sized according to the nominal current of the drive. No additional protection devices are needed.

Protecting the drive and the input power and motor cables against thermal overload

The drive protects itself, its mains- and the motor cables against thermal overload when the cables are sized according to the nominal current of the drive. No additional thermal protection devices are needed.

WARNING

If the drive is connected to multiple motors, use a separate circuit breaker or fuses for protecting each motor cable and motor against overload. The drive overload protection is set to the total motor load. It may not trip due to an overload in one motor circuit only.

Protecting the motor against thermal overload

According to regulations, the motor must be protected against thermal overload and the current must be switched off when overload is detected. The drive includes a measured motor temperature function and a motor thermal model function. They protect the motor and switch off the current when necessary.

Measured motor temperature:

For safety, the actual temperature indication is given by motor temperature sensors. The most common temperature sensors are:

- Motor sizes IEC180 ... 225: Thermal switch, e.g., klixon.
- Motor sizes IEC200 ... 250 and larger: PTC or PT100.

See the [DCS880 Firmware Manual](#) for more information on the connection and use of the temperature sensors.

Motor thermal model (motor overload protection):

Additionally, depending on drive parameter settings, an implemented function monitors a calculated temperature value (based on a motor thermal model). The user can tune the thermal model by feeding in additional motor and load data.

See the [DCS880 Firmware Manual](#) for more information on the motor thermal model.

WARNING

The motor thermal model function shall not be used solely as electronic motor overload protection safety function.

Protecting the drive against ground faults

The drive is **not** equipped with an internal ground fault protective function to protect the unit against ground faults in the motor and motor cables.

Residual current device compatibility







The drive is suitable to be used with residual current devices of Type B.

Note: The EMC filter in front of the drive includes capacitors connected between the main circuit and the frame. These capacitors and long motor cables increase the ground leakage current and may cause fault current circuit breakers to function.

Cross-sectional areas - Tightening torques

Recommended cross-sectional area according to **DIN VDE 0276-1000** and **DIN VDE 0100-540 (PE)** in a trefoil arrangement, up to 50°C ambient temperature. The necessary wire torque at 60°C wire temperature is the same as recommended in the following table.

Armature:

Converter type	C1, D1			U1, V1, W1		PE		
	I_{DC} [A-]	1  [mm ²]	(2.)  [mm ²]	I_{AC} [A~]	 [mm ²]	 [mm ²]		
DCS880-S02-0025-0d	25	1 x 6	-	21	1 x 4	1 x 10	1 x M6	6
DCS880-S02-0050-0d	50	1 x 10	-	41	1 x 6	1 x 10	1 x M6	6
DCS880-S02-0075-0d	75	1 x 25	-	61	1 x 25	1 x 16	1 x M6	6
DCS880-S02-0100-0d	100	1 x 25	-	82	1 x 25	1 x 16	1 x M6	6
DCS880-S02-0150-0d	150	1 x 35	-	114	1 x 35	1 x 16	1 x M10	25
DCS880-S02-0200-0d	200	2 x 35	1 x 95	163	2 x 25	1 x 25	1 x M10	25
DCS880-S02-0250-0d	250	2 x 35	1 x 95	204	2 x 25	1 x 25	1 x M10	25
DCS880-S02-0300-0d	300	2 x 70	1 x 95	220	2 x 50	1 x 50	1 x M10	25
DCS880-S0b-0320-0d	320	2 x 70	1 x 95	220	2 x 50	1 x 50	1 x M10	25
DCS880-S02-0350-0d	350	2 x 70	-	286	2 x 50	1 x 50	1 x M10	25
DCS880-S02-0450-0d	450	2 x 95	-	367	2 x 95	1 x 95	1 x M10	25
DCS880-S02-0520-0d	520	2 x 95	-	424	2 x 95	1 x 95	1 x M10	25
DCS880-S0b-0650-0d	650	2 x 120	-	555	2 x 120	1 x 120	1 x M12	50
DCS880-S02-0680-0d	680	2 x 120	-	555	2 x 120	1 x 120	1 x M12	50
DCS880-S02-0820-0d	820	2 x 150	-	669	2 x 120	1 x 120	1 x M12	50
DCS880-S0b-0900-06/07	900	4 x 95	3 x 150	734	4 x 70	1 x 150	2 x M12	50
DCS880-S02-1000-0d	1000	2 x 185	-	816	2 x 150	1 x 150	1 x M12	50
DCS880-S0b-1190-0d	1190	4 x 120	-	971	4 x 95	2 x 95	2 x M12	50
DCS880-S0b-1200-0d	1200	4 x 120	-	979	4 x 95	2 x 95	2 x M12	50
DCS880-S0b-1500-0d	1500	4 x 185	-	1224	4 x 150	2 x 150	2 x M12	50
DCS880-S0b-1500-0d	1500	4 x 185	-	1224	4 x 150	2 x 150	2 x M12	50
DCS880-S0b-1900-0d	1900	8 x 120	6 x 185	1550	4 x 240	2 x 240	4 x M12	50
DCS880-S0b-2050-dd	2050	8 x 120	6 x 185	1673	6 x 120	3 x 120	4 x M12	50
DCS880-S0b-2500-0d	2500	7 x 185	-	2040	8 x 120	4 x 120	4 x M12	50
DCS880-S0b-2600-dd	2600	7 x 185	-	2122	8 x 120	4 x 120	4 x M12	50
DCS880-S0b-3000-0d	3000	8 x 185	-	2448	7 x 185	4 x 185	4 x M12	50
DCS880-S0b-3300-dd	3300	8 x 185	-	2693	7 x 185	4 x 185	4 x M12	50
DCS880-S0b-4000-dd	4000	7 x 300	-	3264	8 x 240	4 x 240	4 x M12	50
DCS880-S0b-4800-0d ①	4800	8 x 300	-	3876	6 x 300	3 x 300	4 x M12	50
DCS880-S0b-5200-0d ①	5200	8 x 300	-	4202	6 x 300	3 x 300	4 x M12	50

① Reduced ambient temperature 40°C.

You will find instructions on how to calculate the PE conductor's cross-sectional area in VDE 0100 or in equivalent national standards. We would remind you that power converters may have a current-limiting effect.

Excitation:

Size	H1		H2	H3, H5, H6	H4	DCF803-0035
DC output current	6 A	12 A	18 A	25 A	30 A	35 A
Max. cross sectional area	6 mm ² /AWG 10	6 mm ² /AWG 10	6 mm ² /AWG 10	6 mm ² /AWG 10	6 mm ² /AWG 10	6 mm ² /AWG 10
Min. cross sectional area	1 mm ² /AWG 16	2.5 mm ² /AWG 13	4 mm ² /AWG 11	6 mm ² /AWG 10	6 mm ² /AWG 10	6 mm ² /AWG 10
Tightening torque	1.5 ... 1.7 Nm					

Selecting the power cables

General rules

- Select the input power and motor cables according to local regulations.
- Select a cable capable of carrying the drive nominal current. See chapter [Current ratings](#).
- Select a cable rated for at least 60°C maximum permissible temperature of conductor in continuous use.
- The inductance and impedance of the PE conductor/cable (grounding wire) must be rated according to permissible touch voltage appearing under fault conditions (so that the fault point voltage will not rise excessively when a ground fault occurs).
- A 600 V_{AC} cable is accepted for up to 500 V_{AC}.
- A 750 V_{AC} cable is accepted for up to 600 V_{AC}.
- For 690 V_{AC} rated equipment, the rated voltage between the conductors (L1, L2, L3) of the cable should be at least 1 kV.
- For mains voltages exceeding 690 V_{AC} and DC voltages exceeding 850 V_{DC} select power cables which comply with local regulations.

It is recommended to select following cables:

- UL: 2 kV voltage class.
- EN: Rated voltage conductor to earth 1000 V_{AC}/1500 V_{DC} and rated voltage conductor to conductor 1600 V_{AC}/3000 V_{DC}.
- The protective conductor must always have an adequate conductivity.
Unless local wiring regulations state otherwise, the cross-sectional area of the protective conductor must agree with the conditions that require automatic disconnection of the supply required in 411.3.2. of IEC 60364-4-41:2005 and be capable of withstanding the prospective fault current during the disconnection time of the protective device. The cross-sectional area of the protective conductor can either be selected from the table below or calculated according to 543.1 of IEC 60364-5-54. The table below shows the minimum cross-sectional area related to the phase conductor size according to IEC 61800-5-1 when the phase conductor and the protective conductor are made of the same metal. If this is not so, the cross-sectional area of the protective earthing conductor shall be determined in a manner which produces a conductance equivalent to that which results from the application of this table.

Cross-sectional area of the phase conductors S (mm ²)	Minimum cross-sectional area of the corresponding protective conductor Sp (mm ²)
$S \leq 16$	S
$16 < S \leq 35$	16
$35 < S$	$S/2$

Additional US requirements

Use type MC continuous corrugated aluminum armor cable with symmetrical grounds or shielded power cable for the motor cables if metallic conduit is not used. For the North American market, 600 V_{AC} cable is accepted for up to 500 V_{AC}. 1000 V_{AC} cable is required above 500 V_{AC} (below 600 V_{AC}). For drives rated over 100 amperes, the power cables must be rated for 75°C (167°F).

Conduit

Couple separate parts of a conduit together. Bridge the joints with a ground conductor bonded to the conduit on each side of the joint. Also bond the conduits to the drive enclosure and motor frame. Use separate conduits for input power, motor, brake resistor and control wiring. When a conduit is employed, type MC continuous corrugated aluminum armor cable or shielded cable is not required. A dedicated ground cable is always required.

Note: Do not run motor wiring from more than one drive in the same conduit.

Armored cable/shielded power cable

Six conductor (3 phases and 3 ground) type MC continuous corrugated aluminum armor cable with symmetrical grounds is available from the following suppliers (trade names in parentheses):

- Anixter Wire & Cable (Philsheath).
- BICC General Corp (Philsheath).
- Rockbestos Co. (Gardex).
- Oaknite (CLX).

Shielded power cables are available from Belden, LAPPKABEL (ÖLFLEX) and Pirelli.


Selecting the control cables

Shielding


All control cables must be shielded.

Use a double-shielded twisted pair cable (figure A below) for analog signals. This type of cable is also recommended for the pulse encoder signals. Employ one individually shielded pair for each signal. Do not use common return for different analog signals.

A double-shielded twisted pair cable (figure A below) is the best alternative for low-voltage digital signals, but a single-shielded twisted pair cable (figure B below) is also acceptable.

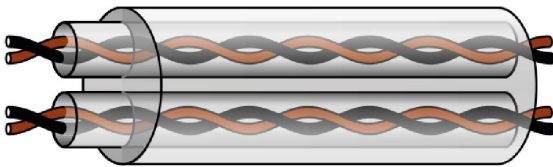

GE_KAB_001_shielded_a.ai

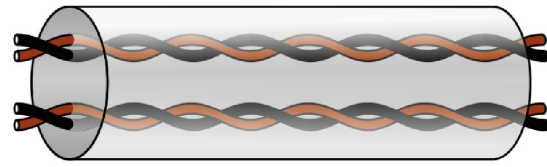

GE_KAB_001_shielded_b.ai

A: Double-shielded twisted pair cable.

B: Single-shielded twisted multi pair cable.

The pairs should be twisted as close to the terminals as possible.

Signals in separate cables

Run analog and digital signals in separate, shielded cables. Never mix 24 V_{DC} and 115/230 V_{AC} signals in the same cable.

Signals allowed to be run in the same cable

Relay-controlled signals, providing their voltage does not exceed 48 V, can be run in the same cables as digital input signals. The relay-controlled signals should be run as twisted pairs too.

Relay cable type

The cable type with braided metallic screen (for example ÖLFLEX by LAPPKABEL, Germany) has been tested and approved by ABB.

Control Panel cable length and type

In remote use, the cable connecting the control panel to the drive must not exceed three meters (10 ft). Cable type: Shielded CAT 5e or better Ethernet patch cable with RJ-45 ends.

Connection of a motor temperature sensor to the drive I/O



WARNING

IEC 60664 requires double or reinforced insulation between live parts and the surface of accessible parts of electrical equipment which are either nonconductive or conductive but not connected to the protective earth.

To fulfill this requirement, the connection of a thermistor (or other similar components) to the inputs of the drive can be implemented by 3 alternate ways:

- There is double or reinforced insulation between the thermistor and live parts of the motor.
- Circuits connected to all digital and analogue inputs of the drive are protected against contact and insulated with basic insulation (the same voltage level as the drive main circuit) from other low voltage circuits.
- An external thermistor relay is used. Rate the insulation of the relay for the same voltage level as the main circuit of the drive.

Also see section Fault Tracing/Motor Protection in [DCS580 Firmware manual](#).

Electrical installation

Chapter overview

This chapter describes the electrical installation procedure of the DCS880.



WARNING

A qualified electrician may only carry out the work described in this chapter. Follow the [Safety instructions](#) on the first pages of this manual. Ignoring the safety instructions can cause injury or death. Make sure that the drive is disconnected from the mains (input power) during installation. If the drive was already connected to the mains, wait for 5 min. after disconnecting mains power. Further information is available in the [Technical guide](#).


Checking the insulation of the drive

Every converter has been tested for insulation between the main circuit and the chassis (2500 V_{rms} 50 Hz for 1 second) at the factory. Therefore, do not make any voltage tolerance or insulation resistance tests (e.g., hi-pot or megger) on any part of the converter. Check the insulation of the drive as follows.



WARNING

Check the insulation before connecting the drive to the mains. Make sure that the drive is disconnected from the mains (input power). Check that the motor cables are disconnected from the converter output terminals C1, D1, F+ and F-. Measure the insulation resistances of the motor cable and the motor between each circuit (C1, D1)/(F+, F-) and the Protective Earth (PE) by using a measuring voltage of 1 kV_{DC}. The insulation resistance must be higher than 1 MΩ.

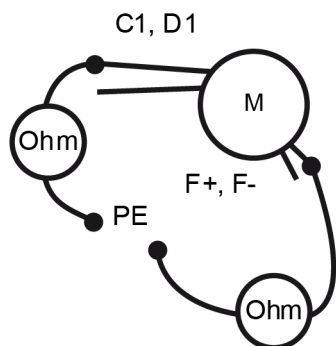


SB_DCS_001_elektr-inst_a.ai

IT (ungrounded) systems


Don't use EMC filters in IT systems.

The screen winding of existing dedicated transformers must be grounded.



For installation without low voltage switch (e.g., contactor, air-circuit-breaker) use an overvoltage protection on the secondary side of the mains transformer.

The voltage shift of the isolated supply must not be larger than the voltage shift in case of an earth fault.

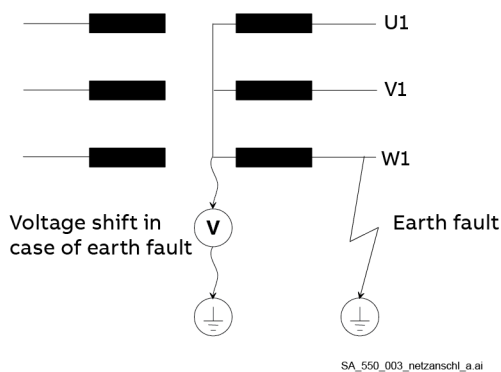

Supply voltage

Check supply voltages of:

Auxiliary voltage	XAUX (X99) on SDCS-PIN-H01/SDCS-POW-H01
Cooling fan	Terminals
Mains voltage for field circuit	U1, V1, W1 (if used)
Mains voltage for armature circuit	U1, V1, W1

Connecting the power cables


Check:

Grounding and screening of power cables see manual [Technical guide](#).

Cross sectional areas and tightening torques of power cable see chapter [Cross-sectional areas - Tightening torques](#).

Location of F-type adapters and interfaces

Connect the signal cables as described below. Tighten the screws to secure the extension modules and the memory unit.

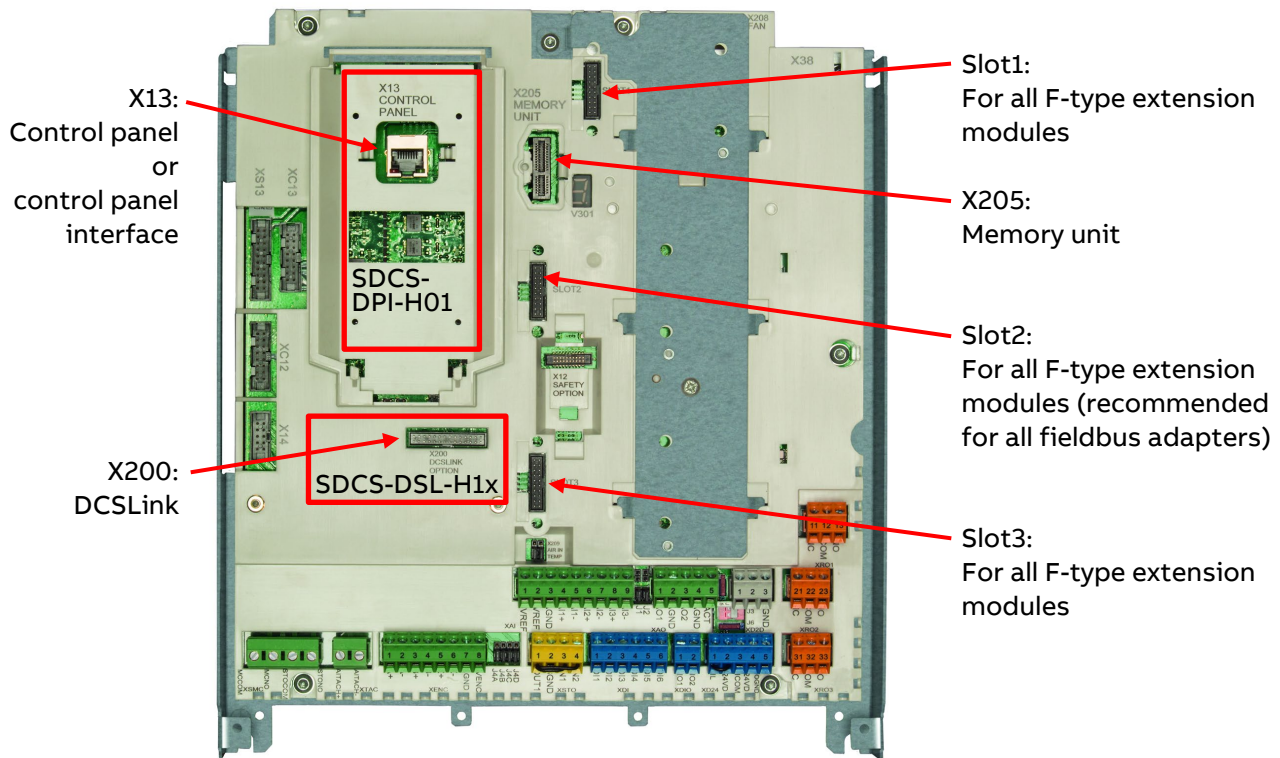

Fieldbus adapters



I/O extension modules




Attention: A maximum of 3 I/O extension modules can be activated and configured using parameter groups 14 ... 16.


FEA-03 I/O extension adapter configuration

Attention:

- Not to be used for fieldbus adapters.
- A maximum of 3 I/O extension modules can be activated and configured using parameter groups 14 ... 16.

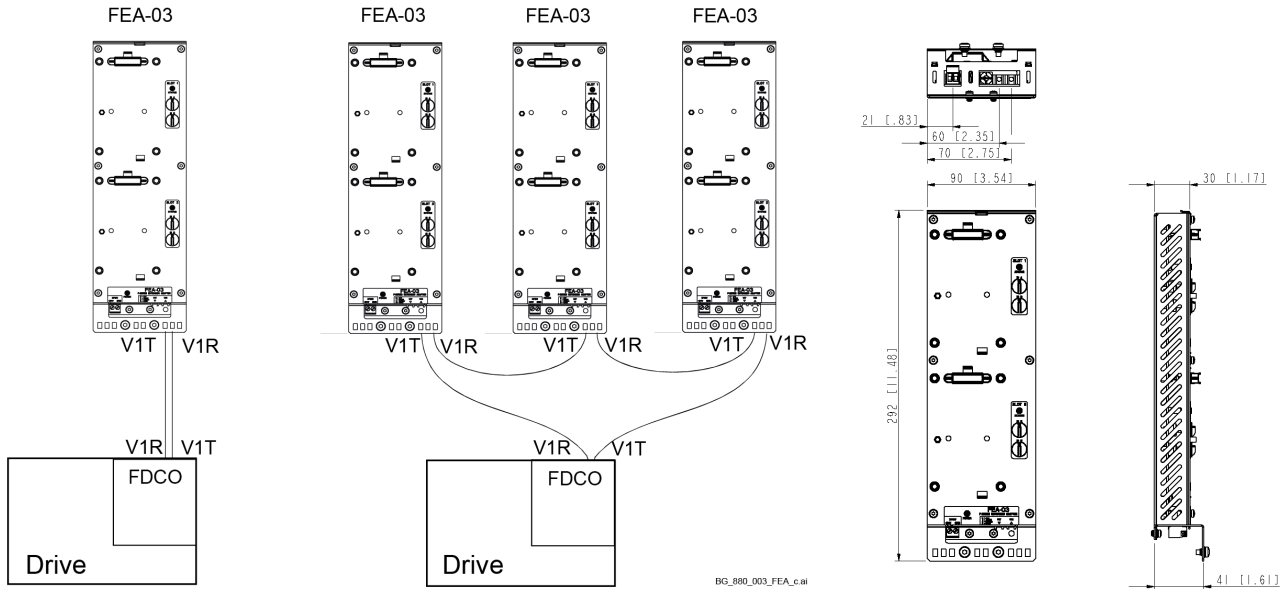

EG_880_003_FEA_c.ai

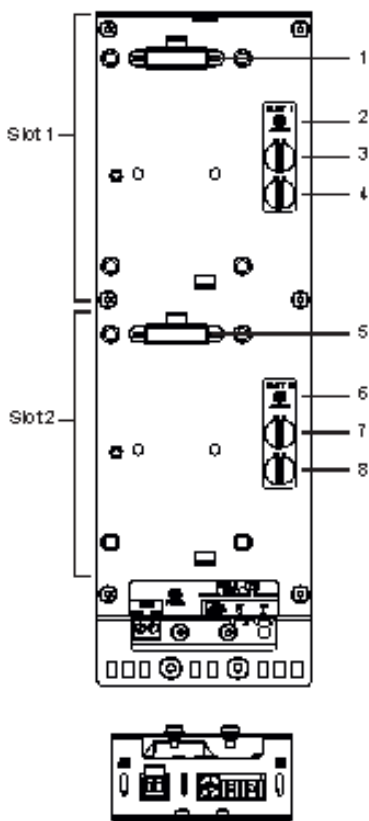



Item	Description
1	Module connector 1
2	Status LED for Slot 1
3	Node address switch A (digit 10)
4	Node address switch B (digit 0)
5	Module connector 2
6	Status LED for Slot 2
7	Node address switch C (digit 10)
8	Node address switch D (digit 0)
9	Power supply connector (XPOW: +24 V/GND, 100 mA plus current for option modules)
10	Transmitter V1T and receiver V1R
11	Selector for V1T and V1R


Pulse encoder connection

OnBoard encoder interface (XENC on SDCS-CON-H01).

On the SDCS-CON-H01 it is possible to select the supply voltage using jumper J4D.

	Hardware configuration	
Encoder supply	SDCS-CON-H01	J4D
5 V, default (TTL level)	No sense	
24 V (HTL level)	No sense	

The wiring is shown in the figure below.

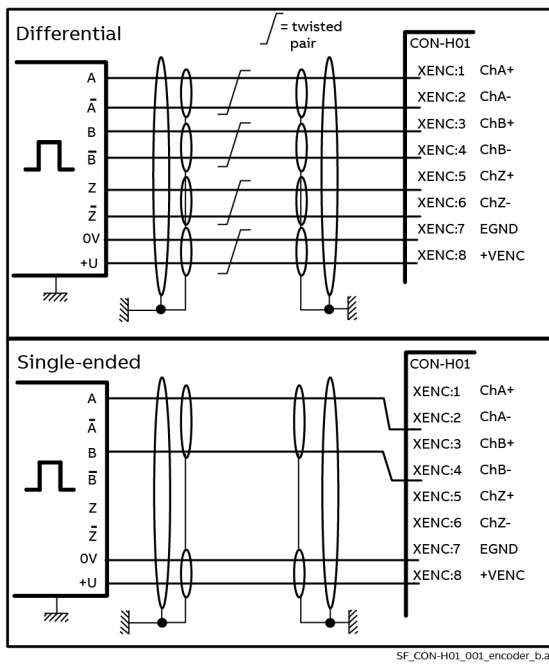


Commissioning hint:

If the drive's measured direction of rotation is wrong or does not correspond to the measured EMF speed, fault 7301 Motor speed feedback may appear during start-up.

If necessary, correct it by exchanging the field connections F1 and F2 or exchange tracks A+ and A-. For single-ended encoders tracks A- and B- must be exchanged.

94.16 OnBoard encoder position should look like this:

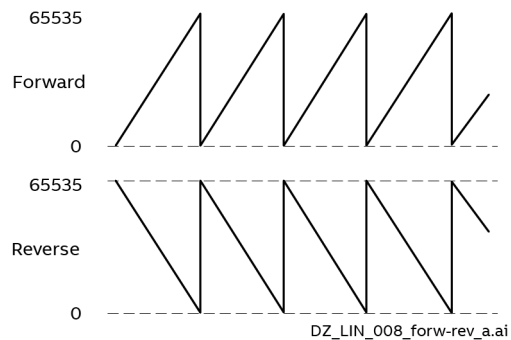


Pulse encoder connection principles

Two different encoder connections are available.


1. Differential connection: Only pulse encoders generating voltage signals can be used.
2. Single-ended (push pull) connection: Only pulse encoders generating voltage signals can be used.

Differential connection:

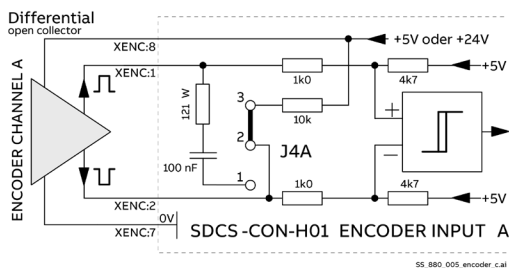

Jumper settings for differential (open collector) encoders connected to a SDCS-CON-H01.


Jumper	SDCS-CON-H01		
J4A	2 - 3		2 - 3
J4B	5 - 6		5 - 6
J4C	8 - 9		8 - 9
J4D	5 V: 10 - 11 (TTL level)		24 V: 11 - 12 (HTL level)

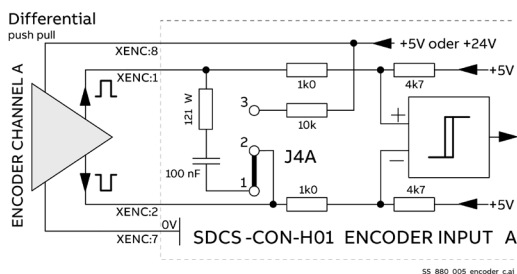

Jumper settings for differential (push pull) encoders connected to a SDCS-CON-H01.


Jumper	SDCS-CON-H01		
J4A	1 - 2		1 - 2
J4B	4 - 5		4 - 5
J4C	7 - 8		7 - 8
J4D	5 V: 10 - 11 (TTL level)		24 V: 11 - 12 (HTL level)

Single-ended connection:

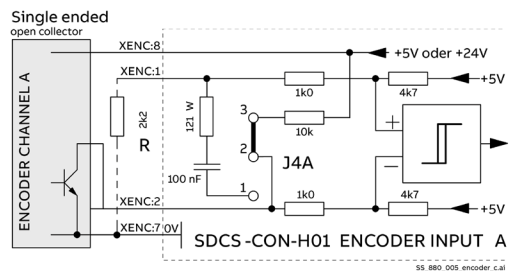

Jumper settings for single-ended (open collector) encoders connected to a SDCS-CON-H01.

Jumper	SDCS-CON-H01		
J4A	2 - 3		2 - 3
J4B	5 - 6		5 - 6
J4C	8 - 9		8 - 9
J4D	5 V: 10 - 11 (TTL level)		24 V: 11 - 12 (HTL level)

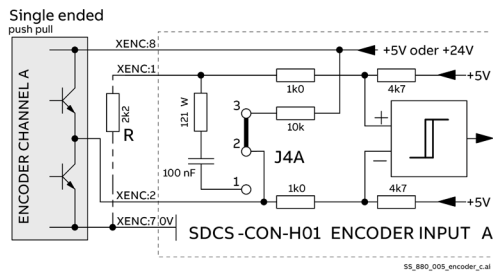

Jumper settings for single-ended (push pull) encoders connected to a SDCS-CON-H01.

Jumper	SDCS-CON-H01				
J4A	2 - 3		2 - 3		Single ended
J4B	5 - 6		5 - 6		
J4C	8 - 9		8 - 9		
J4D	5 V: 10 - 11 (TTL level)		24 V: 11 - 12 (HTL level)		Voltage source

To get a threshold lower than 5 V each terminal XENC:1, 3 and 5 must be connected via a resistor R to GND.

Cable length:


The maximum distance between pulse encoder and SDCS-CON-H01 depends on the voltage drop of the connecting lines and on the output and input configuration of the used components. Use cables according to the table below. Use twisted pair cables with pair shielding plus overall shielding.

Cable length	Parallel wires for power source & GND	Cable used
0 ... 50 m	1 x 0.25 mm ²	12 x 0.25 mm ²
50 ... 100 m	2 x 0.25 mm ²	12 x 0.25 mm ²
100 ... 150 m	3 x 0.25 mm ²	14 x 0.25 mm ²

Cable length	Parallel wires for power source & GND	Cable used
0 ... 164 ft	1 x 24 AWG	12 x 24 AWG
164 ... 328 ft	2 x 24 AWG	12 x 24 AWG
328 ... 492 ft	3 x 24 AWG	14 x 24 AWG


Connecting the signal and control cables

Use screened cables for digital signals, when the cables are longer than 3 m and for all analog signals. Connect each screen at both ends by metal clamps or comparable means directly on clean metal surfaces, if both earthing points belong to the same earth line. Otherwise, connect a capacitor to earth on one end. In the converter cabinet this kind of connection must be made directly on the sheet metal close to the terminals and if the cable comes from outside also on the PE bar. At the other end of the cable, connect the screen well with the housing of the signal emitter or receiver.

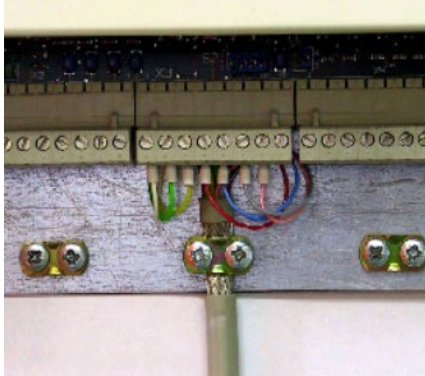

Connection of cable screens with metal clamps to the metal surface of the electronic tray.



Size H7, H8 screen connection

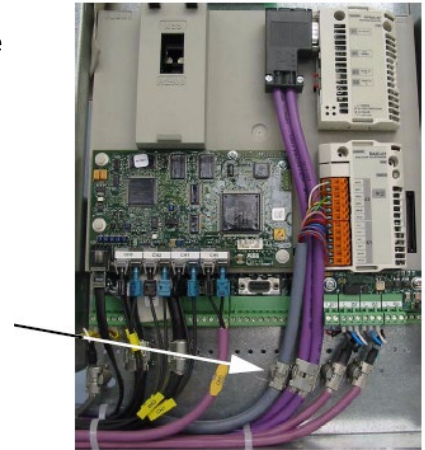


Routing the cables

- Run the motor cable away from other cable routes. Motor cables of several drives can be run in parallel installed next to each other.
- Motor cables, input power cables and control cables should be installed on separate trays.
- Avoid long parallel runs of motor cables with other cables to decrease electromagnetic interference caused by rapid changes in the drive output voltage.
- Where control cables must cross power cables, ensure they are arranged at an angle as close to 90° as possible. Do not run spare cables through the drive or cabinet.
- The cable trays must have good electrical bonding to each other and to the grounding electrodes.
- Aluminum tray systems can be used to improve local equalizing of potential.

The following diagrams show the proper routing of cables.

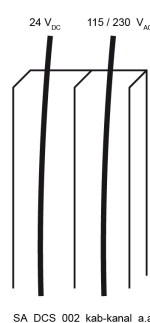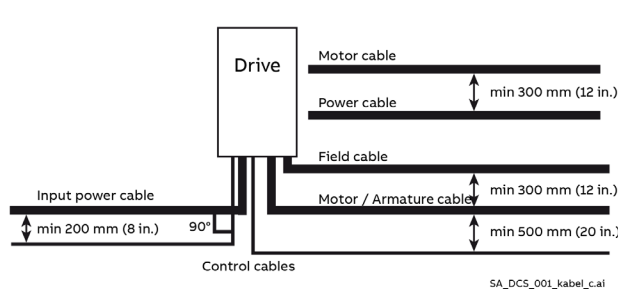

Route 24 V_{DC} and 115/230 V_{AC} control cables in separate ducts



Not allowed unless the 24 V_{DC} cable is insulated for 115/230 V_{AC} or insulated with an insulation sleeving for 115/230 V_{AC}.

Continuous motor cable shield or enclosure for equipment on the motor cable

To minimize the emission level when safety switches, contactors, connection boxes or similar equipment are installed on the motor cable between the drive and the motor:

- European Union: Install the equipment in a metal enclosure with 360° grounding for the shields of both the incoming and outgoing cables or connect the shields of the cables otherwise together.
- US: Install the equipment in a metal enclosure in a way that the conduit or motor cable shielding runs consistently without breaks from the drive to the motor.

DCSLink wiring


The DCSLink is a 500 kBaud serial communication between drives and from drives to field exciters. It is based on CAN hardware and uses twisted pair cables. The topology is a bus system. Switched OFF nodes can remain in the bus and do not disturb the serial communication.

The function of the interface is predefined:


- Communication to field exciter types DCF803, DCF804 and large field exciters (standard DCS880 modules used as field exciters).
- Communication for 12-pulse operation, DCS880 to DCS880.

Cabling


- Every bus device requires its own individual node number.
- Only two physical ends are allowed for the bus system.
- The termination resistance of 120 Ohm is selected for typical twisted pair cables.
- The cables must be terminated at both ends. This is done using jumpers or switches inside the drives or field exciter.
- Maximum total cable length is 100 m.
- Preferred cable type: DEVICENET
Supplier: Helu Kabel, Germany; type 81910PUR
 Belden, USA; type 3084A

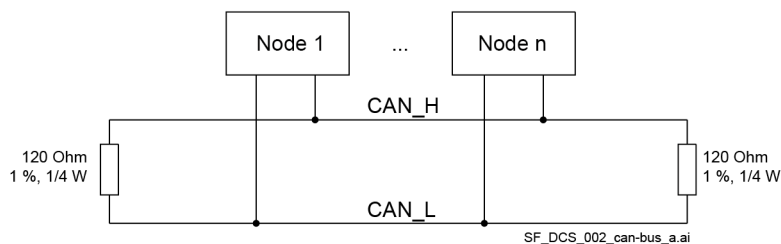

Example of two DCS880 converters, one as armature converter, the other one as large field exciter

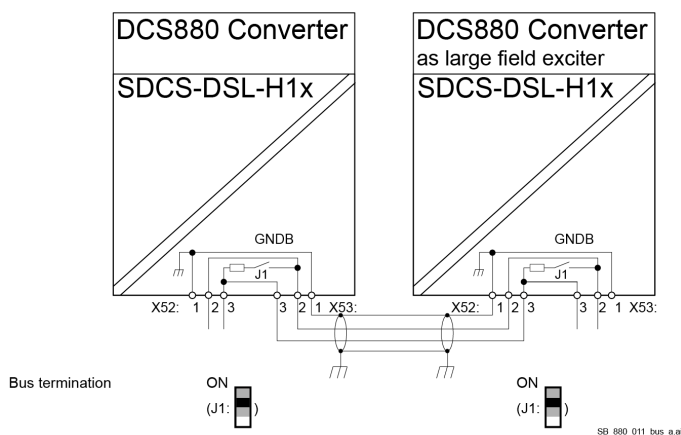


Example of two DCS880 H5, H6 converters with FEX-425-Int internal field supply.

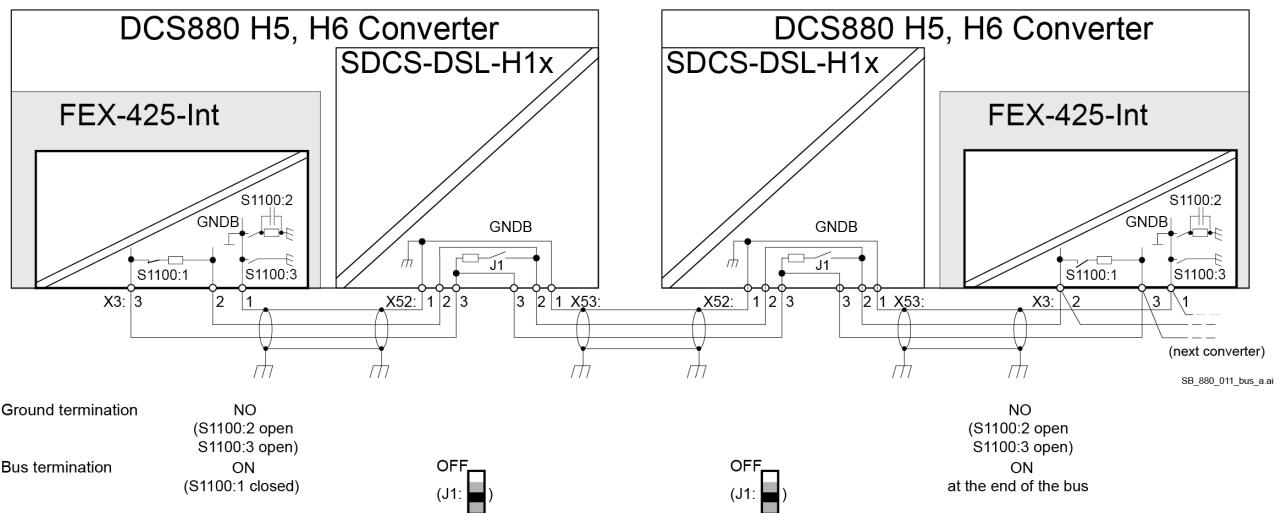

The connection of isolated GND between two or more serial communication interfaces is optional. It is recommended to connect GND if the supply voltage is above 690 V, and the cabling is made from cubicle to cubicle.

Example of one DCS880 converter plus external field supply.

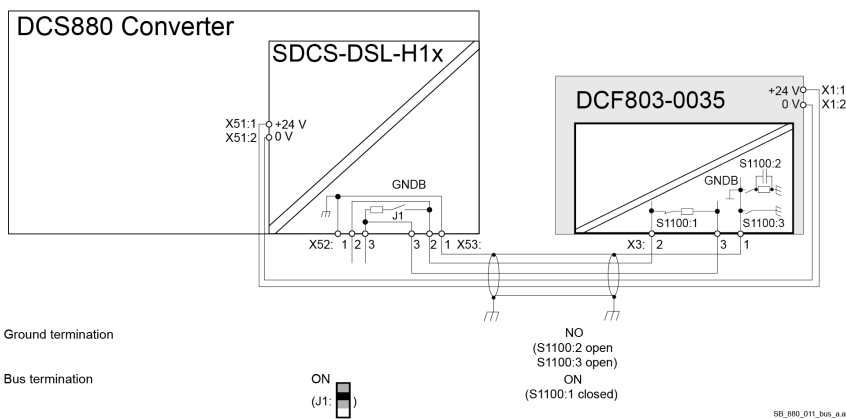

Cable length

The cable length influences the maximum baud rate.


Baudrate	Max. cable length	
50 k	500 m	
125 k	500 m	
250 k	250 m	
500 k	100 m	default and recommended setting
800 k	50 m	
888 k	35 m	
1000 k	25 m	

The bus is designed for a total cable length up to 100 meters. Larger distances on request.


Connecting a control unit at H7 and H8 power units

During installation the control unit needs to be connected with the power unit using fiber optic cables. For a standard drive connect the fiber optic cables from the SDCS-DSL-H1x (control unit) to the SDCS-OPL-H01(power unit).

The mains contactor is controlled via XSMC (X96) on the SDCS-OPL-H01 located in the power unit. The current measurement using a scope is possible via X4. Connecting according to the drawing below:

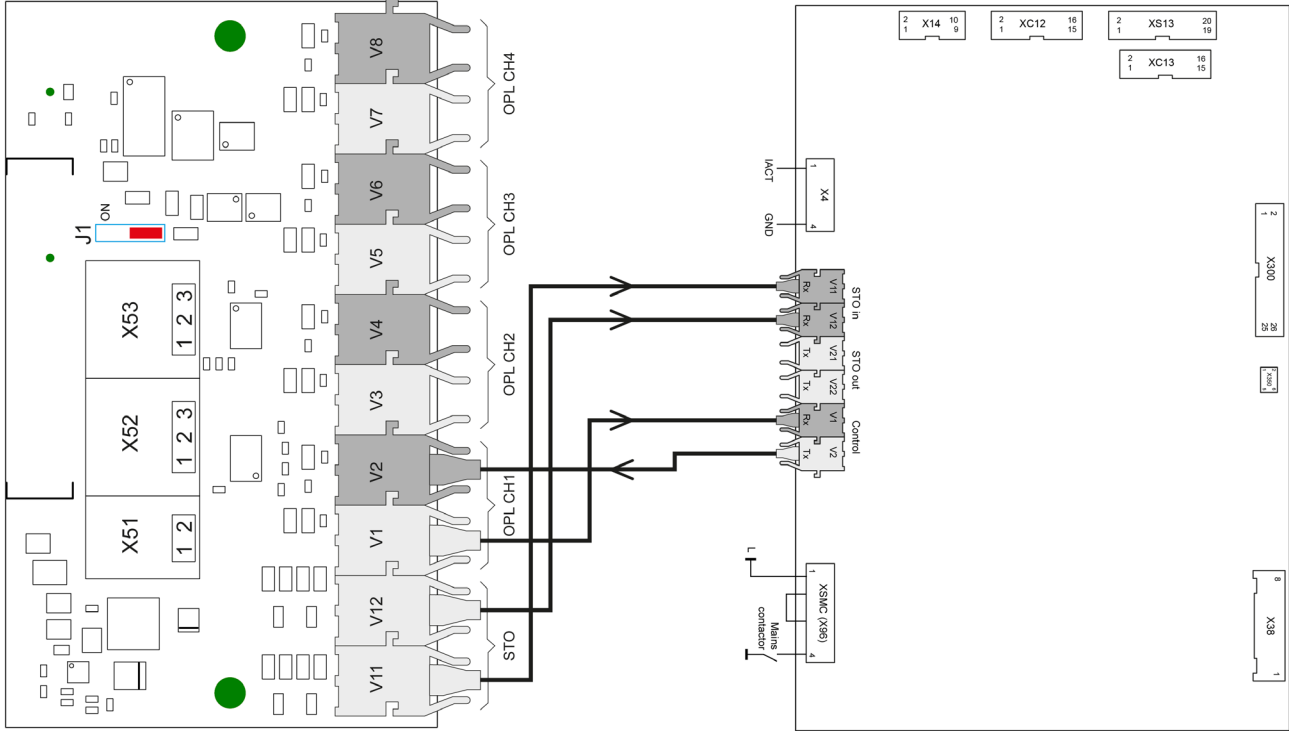

BL_DSLH1x+OPL_001_c.ai

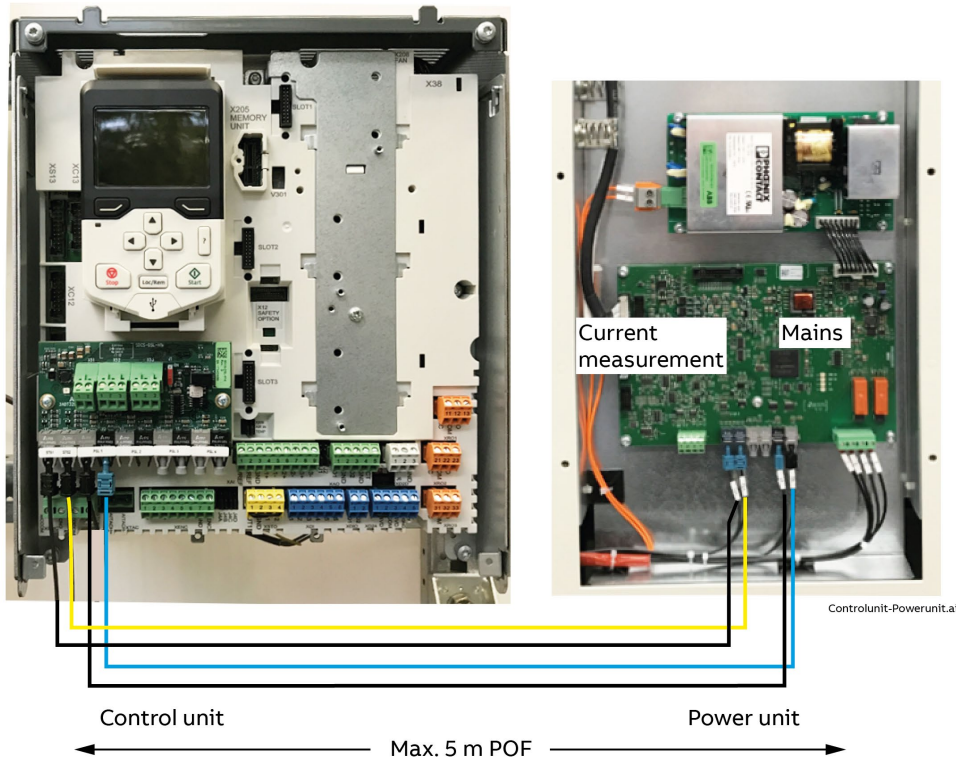

Controlunit-Powerunit.ai

Installation checklist

Check the mechanical and electrical installation of the drive before start-up. Go through the checklist below together with another person. Read the [Safety instructions](#) on the first pages of this manual before you work on the unit.

MECHANICAL INSTALLATION

- The ambient operating conditions are allowed (see [Environmental Conditions](#), [Current ratings](#)).
- The unit is mounted properly on a vertical non-flammable wall (see [Mechanical installation](#)).
- The cooling air will flow freely (see [Cabinet installation](#), [Mounting the converter module inside an enclosure](#)).
- The motor and the driven equipment are ready for start.
- All screen terminals are checked for tightness (see [Connecting the signal and control cables](#)).
- All cable connections are seated properly (see [Connecting the signal and control cables](#)).

ELECTRICAL INSTALLATION (see [Planning the electrical installation](#), [Electrical installation](#))

- The converter modules are grounded properly.
- The mains voltage matches the converter module's nominal input voltage.
- The mains (input power) connections at U1, V1, W1 (L1, L2, L3) and their tightening torques are OK.
- The appropriate mains fuses and disconnectors are installed.
- The drive connections at C1, D1 and F+, F- and their tightening torques are OK.
- Motor cable routing (armature and excitation) is OK.
- Check that the screens are properly installed at the motor and the drive cabinet.
- The motor connections L+, L-, F+ and F- and their tightening torques are OK.
- The control connections are OK.
- If a pulse encoder is used, check the encoder cables and correct direction of rotation.
- PTC, klixon cables:
 - Check that the connections are appropriate for the type of sensor used in the motor.
- Check the Safe Torque Off (STO) circuit for proper function.
- Check the prevention of unexpected start-up (on inhibit, coast stop) circuit for proper function.
- Proper function of E-stop circuit and relay.
- Cooling fan power wiring connected.
- The external control connections inside the drive are OK.
- There are no tools, foreign objects, or drill cuttings inside the drive.
- Converter, motor connection box and other covers are in place.

Technical data

Chapter overview

The technical data contain the technical specifications of the converter, e.g., the ratings, sizes and technical requirements, provisions for fulfilling the requirements for CE and other markings.

Environmental Conditions

System connections

Voltage, 3-phase:	1000 ... 100 V acc. to IEC 60038 100 ... 690 V acc. to UL508c
Voltage deviation:	IEC: -10% +15% continuous ±20% short time (0.5 to 30 cycles) UL: ±10 % continuous ±15 % short time (0.5 to 30 cycles)

Rated frequency:	50 Hz or 60 Hz
Static frequency deviation:	50 Hz ± 2 %; 60 Hz ± 2 %
Dynamic: frequency range:	50 Hz ± 5 Hz; 60 Hz ± 5 Hz
df/dt:	17 %/s

Please note: Special consideration must be taken for voltage deviation in regenerative mode.

Degree of protection

Converter module and options (line chokes, fuses, field exciters, etc.):	IEC: IP 00; acc. to IEC/EN 60529 UL: open type acc. to UL 508c
Overvoltage category (all inputs):	III acc. to IEC 60664-1
Protective class:	I acc. to IEC 61800-5-1

Paint finish

Converter module:	Body RAL 7012 Cover RAL 9017 & RAL 9002
-------------------	--

Environmental limit values

Permissible cooling air temp.	
– at converter module air inlet:	0 ... +55°C 0 ... +40°C +30 ... +55°C
– with rated DC current:	0 ... +40°C
– with different DC current:	5 ... 95 %, no condensation
– Options:	
Relative humidity (at 5...+40°C):	
Relative humidity (at 0...+5°C):	5 ... 50 %, no condensation
Change of the ambient temp.:	< 0.5°C/minute
Storage temperature:	-40 ... +55°C
Transport temperature:	-40 ... +70°C

Pollution degree (IEC/EN 61800-5-1): 2

The drive must be installed in clean air according to enclosure classification. Cooling air must be clean, free from corrosive materials and electrically conductive dust.

Site elevation

< 1000 m above M.S.L.:	100 %, no current reduction
> 1000 m above M.S.L.:	with current reduction
Permissible supply systems:	IT, TN, TT (neutral earthed) IT (corner earthed) TT (corner earthed)

Note: If an FSPS-21 or FSO-21 module is used, the atmospheric pressure of the module is limited to 70 ... 106 kPa. See manual [FSPS-21 PROFIsafe safety functions module \(3AXD50000158638\)](#) or [FSO-21 Safety functions module \(3AXD50000015614\)](#).

Sound pressure level and vibration

Size	Sound pressure level L_p (1 m distance)		Vibration
	as module	enclosed converter	
H1	55 dBA	68 dBA	3 mm, 2 ... 9 Hz 1 g, 9 ... 200 Hz
H2	55 dBA	72 dBA	
H3	60 dBA	78 dBA	
H4	66 ... 70 dBA, depending on fan	77 dBA	
H5	75 dBA	77 dBA	0.3 mm, 2 ... 9 Hz 0.1 g, 9 ... 200 Hz
H6	70 dBA	78 dBA	
H7	69 dBA	67 dBA	
H8	82 dBA	80 dBA	

North American Standards

In North America the system components fulfil the requirements of the table below.


Rated supply voltage	Standards Converter module	Enclosed converter
Up to 990 V	UL 61800-5-1: Power Conversion Equipment. CSA C 22.2 No. 274-13: Industrial Control Equipment, Industrial Products. Available for converter modules including field exciter units. Types with UL mark: – See DCS880-DCS800-DCS550 Certificate, UL, TÜV-SÜD NRTL DCF505-DCF506-DCF80x Certificate, UL, TÜV-SÜD NRTL. TÜV SÜD is NRTL listed. – Or on request.	UL/CSA types: On request

Regulatory compliance

The converter module and enclosed converter components are designed for use in industrial environments. In EEA countries, the components fulfil the requirements of the EU directives, see table below:


European Union Directive	Manufacturer's Assurance	Harmonized Standards
		Converter module
Machinery Directive		
2006/42/EC	Declaration of Incorporation	[IEC 60204-1]
Low Voltage Directive		
2014/35/EU	Declaration of Conformity	EN 61800-1 [IEC 61800-1] EN 60204-1 [IEC 60204-1] EN 61800-5-1 [IEC 61800-5-1]
EMC Directive		
2014/30/EU	Declaration of Conformity (If all installation instructions concerning cable selection, cabling and EMC filters or dedicated transformer are followed.)	EN 61800-3 [IEC 61800-3] in accordance with 3ADW000032 .

Effect of the site elevation above sea level on the converter's load capacity:

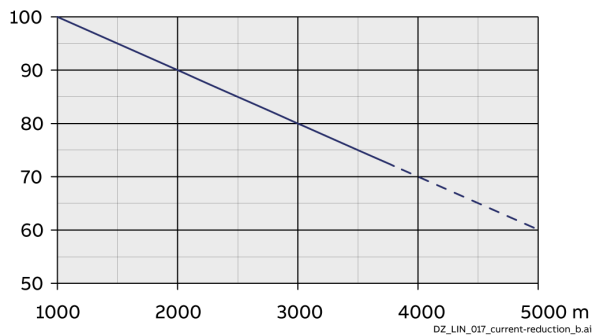

Current reduction to % of nominal converter current.

Effect of the ambient temperature on the converter's load capacity:

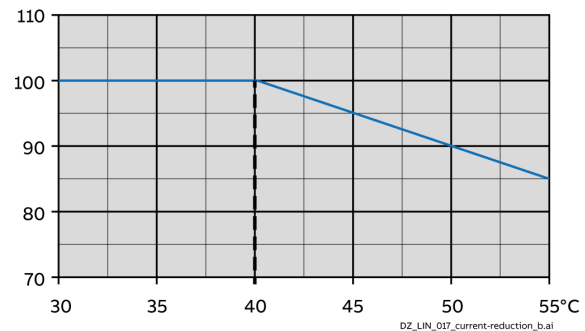

Current reduction to % of nominal converter current.

Effect of site elevation and ambient temperature on the converter's load capacity:

Ambient temperature	Site elevation in m above M.S.L.			
	≤ 1000 m	≤ 2000 m	≤ 3000 m	≤ 4000 m
30°C	100 %	100 %	90 %	80 %
35°C	100 %	95 %	85 %	75 %
40°C	100 %	90 %	80 %	
45°C	95 %	85 %		
50°C	90 %	80 %		
55°C	85 %			

Current reduction to % of nominal converter current

Short Circuit Current Ratio (SCCR)

For drives with thyristor modules (H1 ... H5) the SCCR = 65 kA.

For drives with disk type thyristors (H6 ... H8) the SCCR = 100 kA.

Current ratings - IEC regenerative converters (S02)

See the current ratings including several standard duty cycles for the DCS880 with 50 Hz and 60 Hz supplies below. The current ratings are based on an ambient temperature of maximum 40°C and an elevation of maximum 1000 m above mean sea level.

Unit type	I _{DC I} [A]	I _{DC II} [A]		I _{DC III} [A]		I _{DC IV} [A]		Size	Internal field current	
4-Q converters	continuous	100 % 15 min	150 % 60 s	100 % 15 min	150 % 120 s	100 % 15 min	200 % 10 s			
DCS880-S02-0025-04/05 ①	25	22	33	21	31	20	40	H1	0.3 ... 6 A	
DCS880-S02-0050-04/05 ①	50	38	57	37	55	33	66	H1	1 ... 12 A	
DCS880-S02-0075-04/05 ①	75	60	90	59	88	54	108			
DCS880-S02-0100-04/05 ①	100	85	127	83	124	80	160			
DCS880-S02-0150-04/05	150	114	171	110	165	100	200	H2	1 ... 18 A	
DCS880-S02-0200-04/05 ①	200	145	217	140	210	115	230			
DCS880-S02-0250-04/05	250	185	277	180	270	165	330			
DCS880-S02-0300-04/05	300	225	337	220	330	200	400	H3	2 ... 25 A	
DCS880-S02-0350-04/05 ①	350	275	412	265	397	245	490			
DCS880-S02-0450-04/05 ①	450	350	525	340	510	310	620			
DCS880-S02-0520-04/05	520	400	600	380	570	350	700	H4	2 ... 30 A	
DCS880-S02-0680-04/05 ①	680	525	787	510	765	475	950			
DCS880-S02-0820-04/05	820	630	945	610	915	565	1130			
DCS880-S02-1000-04/05	1000	750	1125	725	1087	660	1320	H5	25 A ③	
DCS880-S02-1190-04/05	1190 ②	860	1290	835	1253	745	1490			
DCS880-S02-1200-04/05	1200	888	1332	872	1308	764	1528			
DCS880-S02-1500-04/05	1500	1200	1800	1156	1734	1104	2208	H6	+S164	
DCS880-S02-2000-04/05	2000	1479	2219	1421	2132	1361	2722			
DCS880-S02-2050-05	2050	1550	2325	1480	2220	1450	2900			
DCS880-S02-2500-04/05	2500	2000	3000	1930	2895	1790	3580	H7	-	
DCS880-S02-3000-04/05	3000	2330	3495	2250	3375	2080	4160			
DCS880-S02-3300-04/05	3300	2416	3624	2300	3450	2277	4554			
DCS880-S02-4000-04/05	4000	2977	4466	2855	4283	2795	5590	H8	-	
DCS880-S02-5200-04/05	5200	3800	5700	3669	5504	3733	7466			
600 V/690 V										
DCS880-S02-0320-06	320	256	384	246	369	235	470	H3	-	
DCS880-S02-0650-06	650	514	771	508	762	462	924	H4	-	
DCS880-S02-0900-06/07	900	684	1026	670	1005	594	1188	H6	25 A ③ +S164	
DCS880-S02-1500-06/07	1500	1200	1800	1104	1656	1104	2208			
DCS880-S02-2050-06/07	2050	1520	2280	1450	2175	1430	2860	H7	-	
DCS880-S02-2500-06/07	2500	1940	2910	1870	2805	1740	3480			
DCS880-S02-3000-06/07	3000	2270	3405	2190	3285	2030	4060			
DCS880-S02-3300-06/07	3300	2416	3624	2300	3450	2277	4554	H8	-	
DCS880-S02-4000-06/07	4000	3036	4554	2900	4350	2950	5900			
DCS880-S02-4800-06/07	4800	3734	5601	3608	5412	3700	7400			
800 V										
DCS880-S02-1900-08	1900	1500	2250	1430	2145	1400	2800	H7	-	
DCS880-S02-2500-08	2500	1910	2865	1850	2775	1710	3420			
DCS880-S02-3000-08	3000	2250	3375	2160	3240	2000	4000			
DCS880-S02-3300-08	3300	2655	3983	2540	3810	2485	4970	H8	-	
DCS880-S02-4000-08	4000	3036	4554	2889	4334	2933	5866			
DCS880-S02-4800-08	4800	3734	5601	3608	5412	3673	7346			
990 V										
DCS880-S02-2050-10	2050	1577	2366	1500	2250	1471	2942	H8	-	
DCS880-S02-2600-10	2600	2000	3000	1900	2850	1922	3844			
DCS880-S02-3300-10	3300	2551	3827	2428	3642	2458	4916			
DCS880-S02-4000-10	4000	2975	4463	2878	4317	2918	5836			
1190 V	Data on request.									

① This unit type can be used as large field exciter. Do not forget the SDCS-DSL-H10 (+S521). A 10 % current de-rating is strongly recommended.

② 1190 A_{DC} for 35°C and 1140 A_{DC} for 40°C ambient temperature.

③ As option.

Notes:

- AC current I_{AC} = 0.82 x I_{DC}.
- The ratings apply at ambient temperature of 40°C (104°F). For lower temperatures the H6, H7, H8 ratings are higher (except I_{max}). Use DriveSize for detailed dimensioning in case the ambient temperature is below 40°C (104°F) or the drive is loaded cyclically.

Current ratings - IEC non regenerative converters (S01)

Unit type	I _{DC I} [A]	I _{DC II} [A]		I _{DC III} [A]		I _{DC IV} [A]		Size	Internal field current
2-Q converters	continuous	100 % 15 min	150 % 60 s	100 % 15 min	150 % 120 s	100 % 15 min	200 % 10 s		
400 V/500 V (IEC)/525 V (UL)									
DCS880-S01-0020-04/05 ①	20	16	24	16	24	15	30	H1	0.3 ... 6 A
DCS880-S01-0045-04/05 ①	45	36	54	35	52	31	62		1 ... 12 A
DCS880-S01-0065-04/05 ①	65	54	81	52	78	49	98		
DCS880-S01-0090-04/05 ①	90	76	114	74	111	73	146		
DCS880-S01-0135-04/05	135	105	157	100	150	93	186	H2	1 ... 18 A
DCS880-S01-0180-04/05 ①	180	130	195	125	187	110	220		
DCS880-S01-0225-04/05	225	170	255	165	247	148	296		
DCS880-S01-0270-04/05	270	200	300	195	292	180	360		
DCS880-S01-0315-04/05 ①	315	240	360	235	352	215	430	H3	2 ... 25 A
DCS880-S01-0405-04/05 ①	405	310	465	300	450	270	540		
DCS880-S01-0470-04/05	470	350	525	340	510	310	620		
DCS880-S01-0610-04/05 ①	610	455	682	435	652	425	850	H4	2 ... 30 A
DCS880-S01-0740-04/05	740	570	855	540	810	525	1050		
DCS880-S01-0900-04/05	900	680	1020	650	975	615	1230		
DCS880-S01-1190-04/05	1190 ②	860	1290	835	1253	745	1490	H5	25 A ③
DCS880-S01-1200-04/05	1200	888	1332	872	1308	764	1528	H6	+S164
DCS880-S01-1500-04/05	1500	1200	1800	1156	1734	1104	2208		
DCS880-S01-2000-04/05	2000	1479	2219	1421	2132	1361	2722		
DCS880-S01-2050-05	2050	1550	2325	1480	2220	1450	2900	H7	-
DCS880-S01-2500-04/05	2500	1980	2970	1880	2820	1920	3840		
DCS880-S01-3000-04/05	3000	2350	3525	2220	3330	2280	4560		
DCS880-S01-3300-04/05	3300	2416	3624	2300	3450	2277	4554	H8	-
DCS880-S01-4000-04/05	4000	2977	4466	2855	4283	2795	5590		
DCS880-S01-5200-04/05	5200	3800	5700	3669	5504	3733	7466		
600 V/690 V									
DCS880-S01-0290-06	290	240	360	225	337	205	410	H3	-
DCS880-S01-0590-06	590	470	705	472	708	434	868	H4	-
DCS880-S01-0900-06/07	900	684	1026	670	1005	594	1188	H6	25 A ③
DCS880-S01-1500-06/07	1500	1200	1800	1104	1656	1104	2208		+S164
DCS880-S01-2000-06/07	2000	1479	2219	1421	2132	1361	2722		
DCS880-S01-2050-06/07	2050	1520	2280	1450	2175	1430	2860	H7	-
DCS880-S01-2500-06/07	2500	1940	2910	1840	2760	1880	3760		
DCS880-S01-3000-06/07	3000	2530	3795	2410	3615	2430	4860		
DCS880-S01-3300-06/07	3300	2416	3624	2300	3450	2277	4554	H8	-
DCS880-S01-4000-06/07	4000	3036	4554	2900	4350	2950	5900		
DCS880-S01-4800-06/07	4800	3734	5601	3608	5412	3700	7400		
800 V									
DCS880-S01-1900-08	1900	1500	2250	1430	2145	1400	2800	H7	-
DCS880-S01-2500-08	2500	1920	2880	1820	2730	1860	3720		
DCS880-S01-3000-08	3000	2500	3750	2400	3600	2400	4800		
DCS880-S02-3300-08	3300	2655	3983	2540	3810	2485	4970	H8	-
DCS880-S02-4000-08	4000	3036	4554	2889	4334	2933	5866		
DCS880-S02-4800-08	4800	3734	5601	3608	5412	3673	7346		
990 V									
DCS880-S02-2050-10	2050	1577	2366	1500	2250	1471	2942	H8	-
DCS880-S02-2600-10	2600	2000	3000	1900	2850	1922	3844		
DCS880-S02-3300-10	3300	2551	3827	2428	3642	2458	4916		
DCS880-S02-4000-10	4000	2975	4463	2878	4317	2918	5836		
1190 V	Data on request.								


① This unit type can be used as large field exciter. Do not forget the SDCS-DSL-H10 (+S521). A 10 % current de-rating is strongly recommended.

② 1190 A_{DC} for 35°C and 1140 A_{DC} for 40°C ambient temperature.

③ As option.

Note: AC current I_{AC} = 0.82 x I_{DC}.

Standard duty cycles

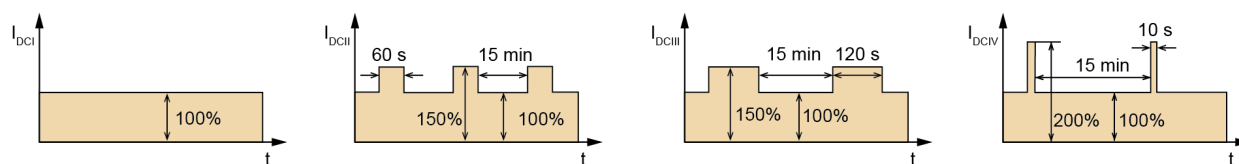

DZ_LIN_054_duty cycle_a.ai

Control board SDCS-CON-H01 (H1 ... H8)

The control circuit terminals are common for all sizes H1 ... H8.

Location of the control circuit board SDCS-CON-H01

The SDCS-CON-H01 is mounted on an electronic tray. The electronic tray is attached in the housing by means of two hinges.

Watchdog function


The SDCS-CON-H01 has an internal watchdog. The watchdog controls the proper function of the SDCS-CON-H01 and the firmware. If the watchdog trips, it has the following effects:

- The thyristor firing control is reset and disabled.
- All DI's will not be processed.
- All DO's are frozen in the actual state.
- All AI's will not be processed.
- All programmable AO's are frozen in the actual state.


Recommended wire size - Tightening torques

Control cables:












Wire sizes:	Tightening torques:
0.5 ... 2.5 mm ²	0.5 Nm for both stranded and solid wiring

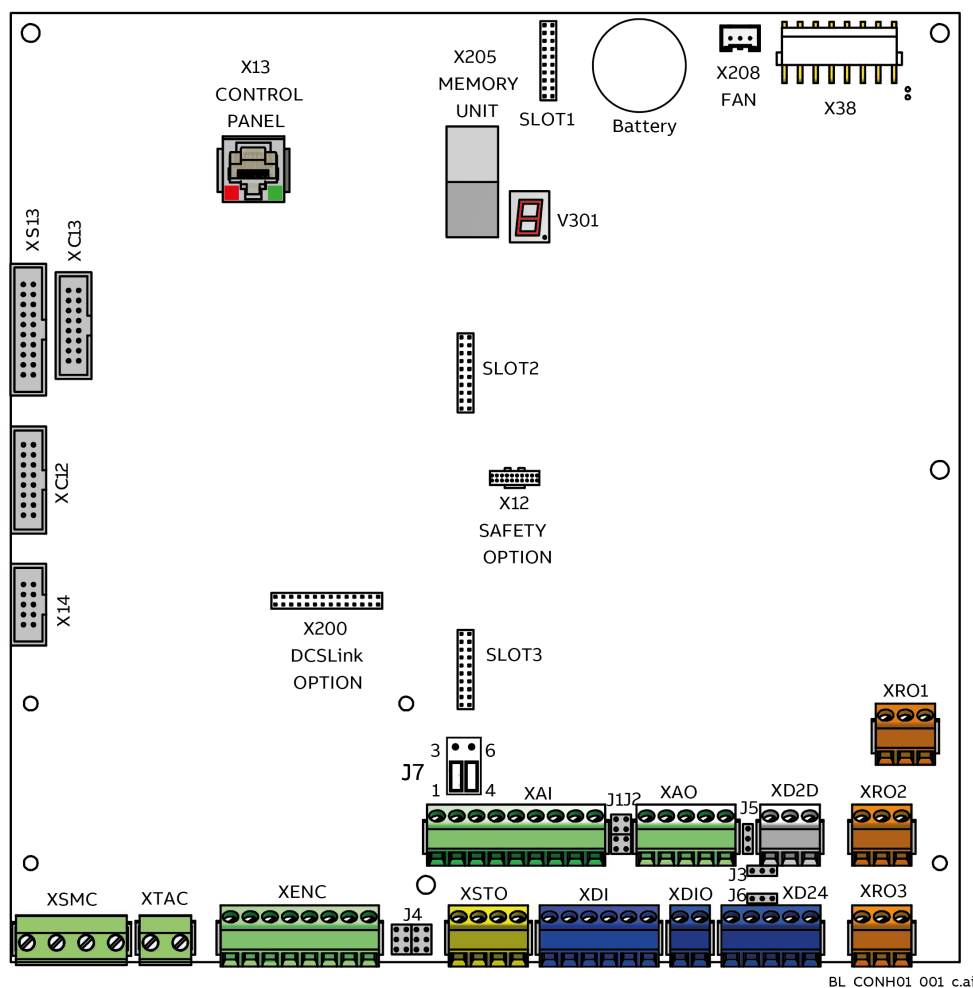

Intermediate cover

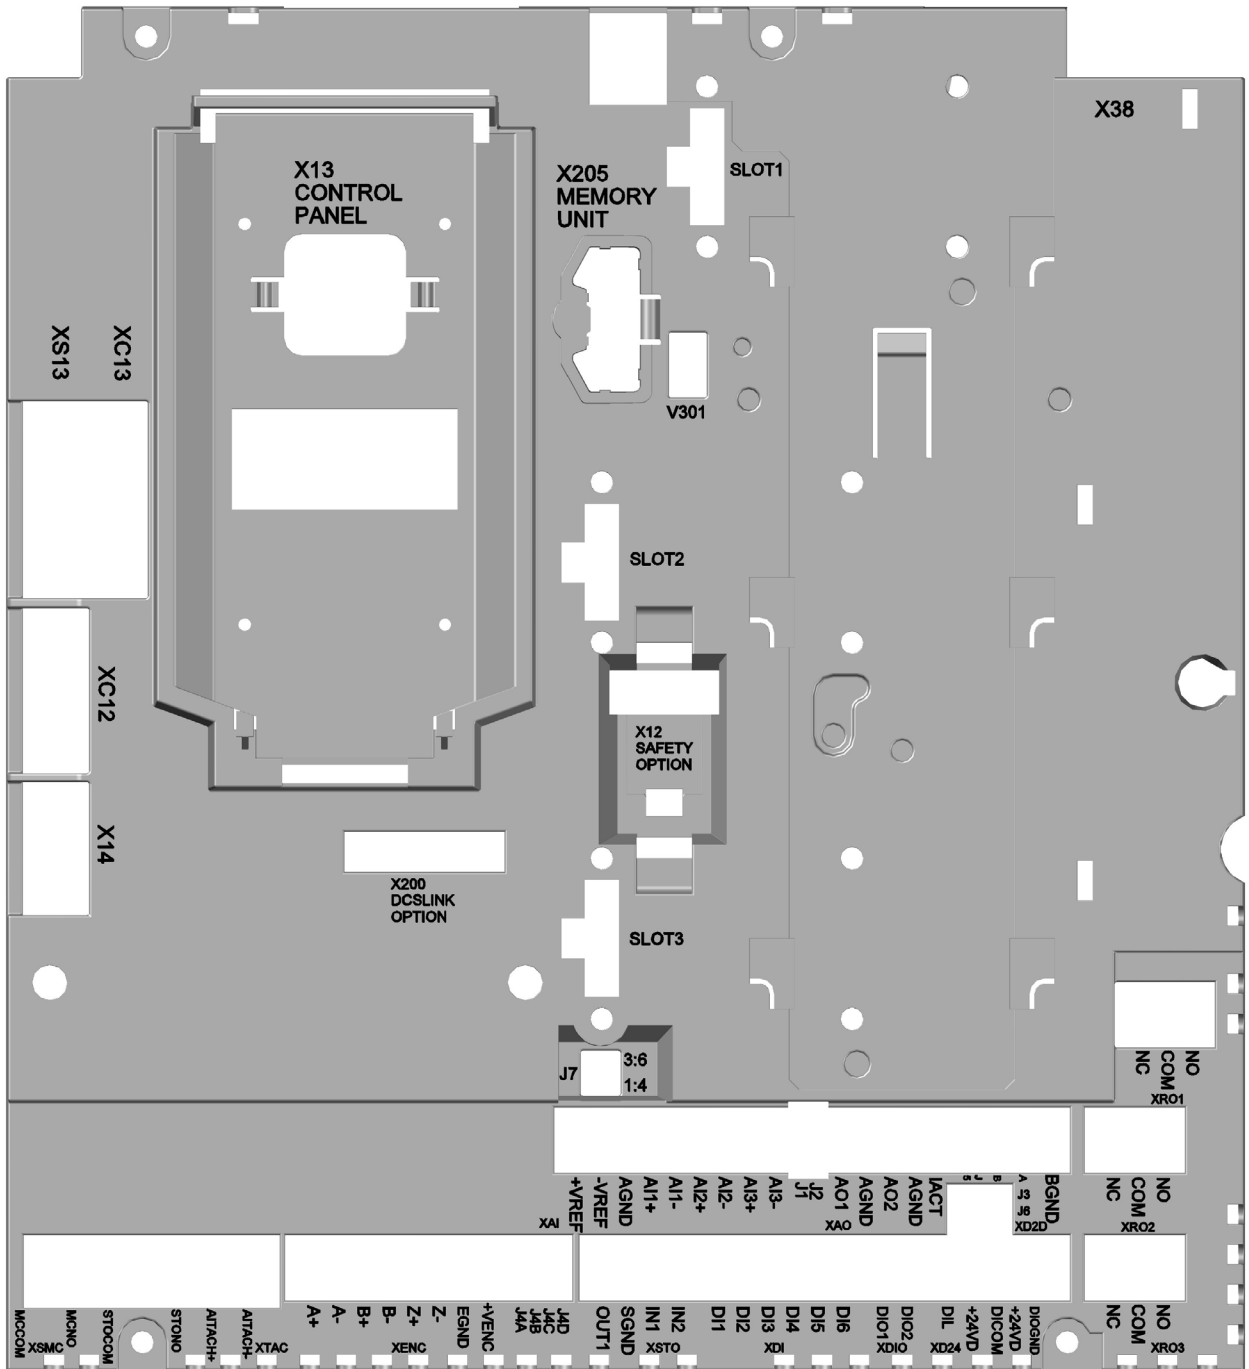

Control circuit terminal layout

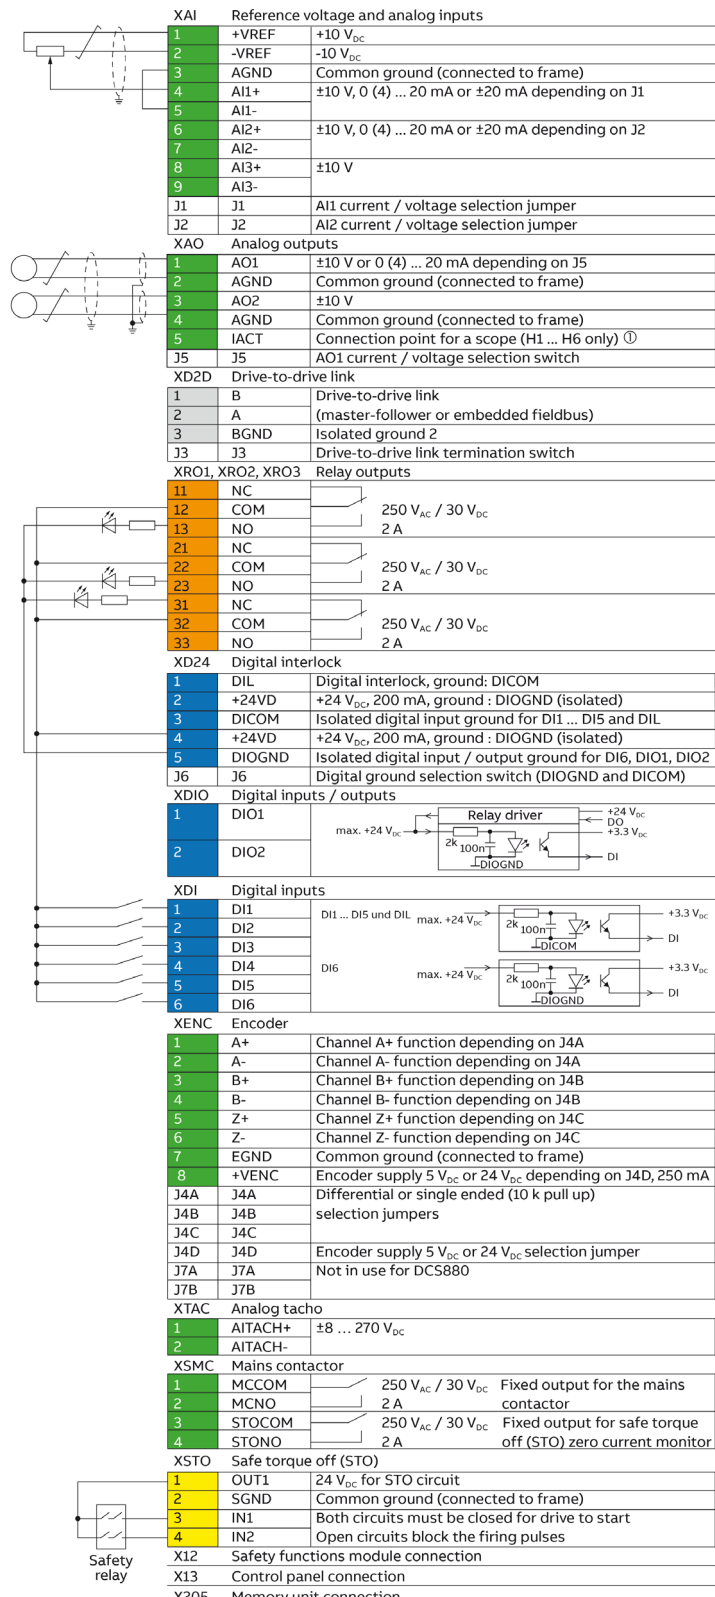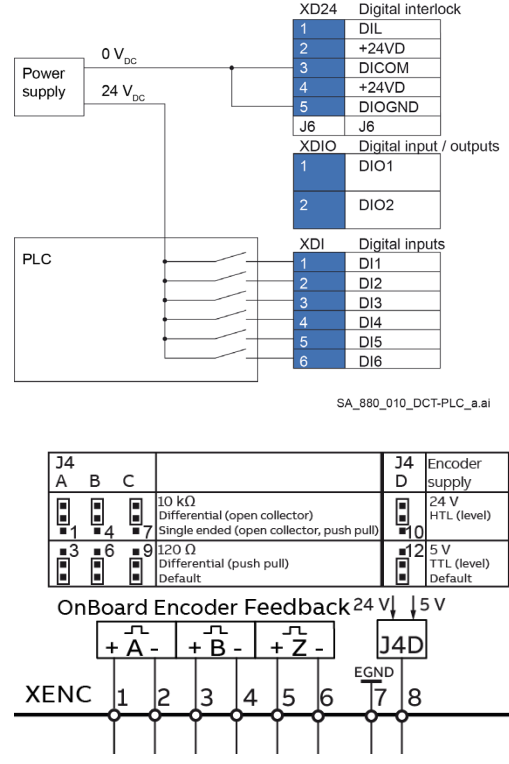Internal 24 V _{DC} used	External 24 V _{DC} used																																																																																																																																																																																																																																									
 <p>XAI Reference voltage and analog inputs</p> <table border="1"> <tr><td>1</td><td>+VREF</td><td>+10 V_{DC}</td></tr> <tr><td>2</td><td>-VREF</td><td>-10 V_{DC}</td></tr> <tr><td>3</td><td>AGND</td><td>Common ground (connected to frame)</td></tr> <tr><td>4</td><td>AI1+</td><td>±10 V, 0 (4) ... 20 mA or ±20 mA depending on J1</td></tr> <tr><td>5</td><td>AI1-</td><td></td></tr> <tr><td>6</td><td>AI2+</td><td>±10 V, 0 (4) ... 20 mA or ±20 mA depending on J2</td></tr> <tr><td>7</td><td>AI2-</td><td></td></tr> <tr><td>8</td><td>AI3+</td><td>±10 V</td></tr> <tr><td>9</td><td>AI3-</td><td></td></tr> <tr><td>J1</td><td>J1</td><td>AI1 current / voltage selection jumper</td></tr> <tr><td>J2</td><td>J2</td><td>AI2 current / voltage selection jumper</td></tr> </table> <p>XAO Analog outputs</p> <table border="1"> <tr><td>1</td><td>AO1</td><td>±10 V or 0 (4) ... 20 mA depending on J5</td></tr> <tr><td>2</td><td>AGND</td><td>Common ground (connected to frame)</td></tr> <tr><td>3</td><td>AO2</td><td>±10 V</td></tr> <tr><td>4</td><td>AGND</td><td>Common ground (connected to frame)</td></tr> <tr><td>5</td><td>IACT</td><td>Connection point for a scope (H1 ... H6 only) ①</td></tr> <tr><td>J5</td><td>J5</td><td>AO1 current / voltage selection switch</td></tr> </table> <p>XD2D Drive-to-drive link</p> <table border="1"> <tr><td>1</td><td>B</td><td>Drive-to-drive link</td></tr> <tr><td>2</td><td>A</td><td>(master-follower or embedded fieldbus)</td></tr> <tr><td>3</td><td>BGND</td><td>Isolated ground 2</td></tr> <tr><td>J3</td><td>J3</td><td>Drive-to-drive link termination switch</td></tr> </table> <p>XRO1, XRO2, XRO3 Relay outputs</p> <table border="1"> <tr><td>11</td><td>NC</td><td rowspan="3">250 V_{AC} / 30 V_{DC} 2 A</td></tr> <tr><td>12</td><td>COM</td></tr> <tr><td>13</td><td>NO</td></tr> <tr><td>21</td><td>NC</td><td rowspan="3">250 V_{AC} / 30 V_{DC} 2 A</td></tr> <tr><td>22</td><td>COM</td></tr> <tr><td>23</td><td>NO</td></tr> <tr><td>31</td><td>NC</td><td rowspan="3">250 V_{AC} / 30 V_{DC} 2 A</td></tr> <tr><td>32</td><td>COM</td></tr> <tr><td>33</td><td>NO</td></tr> </table> <p>XD24 Digital interlock</p> <table border="1"> <tr><td>1</td><td>DIL</td><td>Digital interlock, ground: DICOM</td></tr> <tr><td>2</td><td>+24VD</td><td>+24 V_{DC}, 200 mA, ground : DIOGND (isolated)</td></tr> <tr><td>3</td><td>DICOM</td><td>Isolated digital input ground for DI1 ... DI5 and DIL</td></tr> <tr><td>4</td><td>+24VD</td><td>+24 V_{DC}, 200 mA, ground : DIOGND (isolated)</td></tr> <tr><td>5</td><td>DIOGND</td><td>Isolated digital input / output ground for DI6, DIO1, DIO2</td></tr> <tr><td>J6</td><td>J6</td><td>Digital ground selection switch (DIOGND and DICOM)</td></tr> </table> <p>XDIO Digital inputs / outputs</p> <table border="1"> <tr><td>1</td><td>DIO1</td><td rowspan="2">  </td></tr> <tr><td>2</td><td>DIO2</td></tr> </table> <p>XDI Digital inputs</p> <table border="1"> <tr><td>1</td><td>DI1</td><td rowspan="5">  </td></tr> <tr><td>2</td><td>DI2</td></tr> <tr><td>3</td><td>DI3</td></tr> <tr><td>4</td><td>DI4</td></tr> <tr><td>5</td><td>DI5</td></tr> <tr><td>6</td><td>DI6</td><td>  </td></tr> </table> <p>XENC Encoder</p> <table border="1"> <tr><td>1</td><td>A+</td><td>Channel A+ function depending on J4A</td></tr> <tr><td>2</td><td>A-</td><td>Channel A- function depending on J4A</td></tr> <tr><td>3</td><td>B+</td><td>Channel B+ function depending on J4B</td></tr> <tr><td>4</td><td>B-</td><td>Channel B- function depending on J4B</td></tr> <tr><td>5</td><td>Z+</td><td>Channel Z+ function depending on J4C</td></tr> <tr><td>6</td><td>Z-</td><td>Channel Z- function depending on J4C</td></tr> <tr><td>7</td><td>EGND</td><td>Common ground (connected to frame)</td></tr> <tr><td>8</td><td>+VENC</td><td>Encoder supply 5 V_{DC} or 24 V_{DC} depending on J4D, 250 mA</td></tr> <tr><td>J4A</td><td>J4A</td><td>Differential or single ended (10 k pull up) selection jumpers</td></tr> <tr><td>J4B</td><td>J4B</td><td></td></tr> <tr><td>J4C</td><td>J4C</td><td></td></tr> <tr><td>J4D</td><td>J4D</td><td>Encoder supply 5 V_{DC} or 24 V_{DC} selection jumper</td></tr> <tr><td>J7A</td><td>J7A</td><td>Not in use for DCS880</td></tr> <tr><td>J7B</td><td>J7B</td><td></td></tr> </table> <p>XTAC Analog tacho</p> <table border="1"> <tr><td>1</td><td>AITACH+</td><td>±8 ... 270 V_{DC}</td></tr> <tr><td>2</td><td>AITACH-</td><td></td></tr> </table> <p>XSMC Mains contactor</p> <table border="1"> <tr><td>1</td><td>MCCOM</td><td>250 V_{AC} / 30 V_{DC} Fixed output for the mains contactor</td></tr> <tr><td>2</td><td>MCNO</td><td>2 A</td></tr> <tr><td>3</td><td>STOCOM</td><td>250 V_{AC} / 30 V_{DC} Fixed output for safe torque off (STO) zero current monitor</td></tr> <tr><td>4</td><td>STONO</td><td>2 A</td></tr> </table> <p>XSTO Safe torque off (STO)</p> <table border="1"> <tr><td>1</td><td>OUT1</td><td>24 V_{DC} for STO circuit</td></tr> <tr><td>2</td><td>SGND</td><td>Common ground (connected to frame)</td></tr> <tr><td>3</td><td>IN1</td><td>Both circuits must be closed for drive to start</td></tr> <tr><td>4</td><td>IN2</td><td>Open circuits block the firing pulses</td></tr> </table> <p>X12 Safety functions module connection X13 Control panel connection X205 Memory unit connection</p> <p>① For H7 and H8 see SDCS-OPL-H01. SA_880_005_DCS_e.ai</p>	1	+VREF	+10 V _{DC}	2	-VREF	-10 V _{DC}	3	AGND	Common ground (connected to frame)	4	AI1+	±10 V, 0 (4) ... 20 mA or ±20 mA depending on J1	5	AI1-		6	AI2+	±10 V, 0 (4) ... 20 mA or ±20 mA depending on J2	7	AI2-		8	AI3+	±10 V	9	AI3-		J1	J1	AI1 current / voltage selection jumper	J2	J2	AI2 current / voltage selection jumper	1	AO1	±10 V or 0 (4) ... 20 mA depending on J5	2	AGND	Common ground (connected to frame)	3	AO2	±10 V	4	AGND	Common ground (connected to frame)	5	IACT	Connection point for a scope (H1 ... H6 only) ①	J5	J5	AO1 current / voltage selection switch	1	B	Drive-to-drive link	2	A	(master-follower or embedded fieldbus)	3	BGND	Isolated ground 2	J3	J3	Drive-to-drive link termination switch	11	NC	250 V _{AC} / 30 V _{DC} 2 A	12	COM	13	NO	21	NC	250 V _{AC} / 30 V _{DC} 2 A	22	COM	23	NO	31	NC	250 V _{AC} / 30 V _{DC} 2 A	32	COM	33	NO	1	DIL	Digital interlock, ground: DICOM	2	+24VD	+24 V _{DC} , 200 mA, ground : DIOGND (isolated)	3	DICOM	Isolated digital input ground for DI1 ... DI5 and DIL	4	+24VD	+24 V _{DC} , 200 mA, ground : DIOGND (isolated)	5	DIOGND	Isolated digital input / output ground for DI6, DIO1, DIO2	J6	J6	Digital ground selection switch (DIOGND and DICOM)	1	DIO1		2	DIO2	1	DI1		2	DI2	3	DI3	4	DI4	5	DI5	6	DI6		1	A+	Channel A+ function depending on J4A	2	A-	Channel A- function depending on J4A	3	B+	Channel B+ function depending on J4B	4	B-	Channel B- function depending on J4B	5	Z+	Channel Z+ function depending on J4C	6	Z-	Channel Z- function depending on J4C	7	EGND	Common ground (connected to frame)	8	+VENC	Encoder supply 5 V _{DC} or 24 V _{DC} depending on J4D, 250 mA	J4A	J4A	Differential or single ended (10 k pull up) selection jumpers	J4B	J4B		J4C	J4C		J4D	J4D	Encoder supply 5 V _{DC} or 24 V _{DC} selection jumper	J7A	J7A	Not in use for DCS880	J7B	J7B		1	AITACH+	±8 ... 270 V _{DC}	2	AITACH-		1	MCCOM	250 V _{AC} / 30 V _{DC} Fixed output for the mains contactor	2	MCNO	2 A	3	STOCOM	250 V _{AC} / 30 V _{DC} Fixed output for safe torque off (STO) zero current monitor	4	STONO	2 A	1	OUT1	24 V _{DC} for STO circuit	2	SGND	Common ground (connected to frame)	3	IN1	Both circuits must be closed for drive to start	4	IN2	Open circuits block the firing pulses	 <p>XD24 Digital interlock</p> <table border="1"> <tr><td>1</td><td>DIL</td></tr> <tr><td>2</td><td>+24VD</td></tr> <tr><td>3</td><td>DICOM</td></tr> <tr><td>4</td><td>+24VD</td></tr> <tr><td>5</td><td>DIOGND</td></tr> <tr><td>J6</td><td>J6</td></tr> </table> <p>XDIO Digital input / outputs</p> <table border="1"> <tr><td>1</td><td>DIO1</td></tr> <tr><td>2</td><td>DIO2</td></tr> </table> <p>XDI Digital inputs</p> <table border="1"> <tr><td>1</td><td>DI1</td></tr> <tr><td>2</td><td>DI2</td></tr> <tr><td>3</td><td>DI3</td></tr> <tr><td>4</td><td>DI4</td></tr> <tr><td>5</td><td>DI5</td></tr> <tr><td>6</td><td>DI6</td></tr> </table> <p>J4 Encoder supply</p> <table border="1"> <tr><td>A</td><td>B</td><td>C</td><td>D</td></tr> <tr><td>1</td><td>4</td><td>7</td><td>10</td></tr> <tr><td>3</td><td>6</td><td>9</td><td>12</td></tr> </table> <p>OnBoard Encoder Feedback 24 V_{DC} / 5 V</p> <p>XENC 1 2 3 4 5 6 7 8</p> <p>SA_880_010_DCT-PLC_a.ai</p>	1	DIL	2	+24VD	3	DICOM	4	+24VD	5	DIOGND	J6	J6	1	DIO1	2	DIO2	1	DI1	2	DI2	3	DI3	4	DI4	5	DI5	6	DI6	A	B	C	D	1	4	7	10	3	6	9	12
1	+VREF	+10 V _{DC}																																																																																																																																																																																																																																								
2	-VREF	-10 V _{DC}																																																																																																																																																																																																																																								
3	AGND	Common ground (connected to frame)																																																																																																																																																																																																																																								
4	AI1+	±10 V, 0 (4) ... 20 mA or ±20 mA depending on J1																																																																																																																																																																																																																																								
5	AI1-																																																																																																																																																																																																																																									
6	AI2+	±10 V, 0 (4) ... 20 mA or ±20 mA depending on J2																																																																																																																																																																																																																																								
7	AI2-																																																																																																																																																																																																																																									
8	AI3+	±10 V																																																																																																																																																																																																																																								
9	AI3-																																																																																																																																																																																																																																									
J1	J1	AI1 current / voltage selection jumper																																																																																																																																																																																																																																								
J2	J2	AI2 current / voltage selection jumper																																																																																																																																																																																																																																								
1	AO1	±10 V or 0 (4) ... 20 mA depending on J5																																																																																																																																																																																																																																								
2	AGND	Common ground (connected to frame)																																																																																																																																																																																																																																								
3	AO2	±10 V																																																																																																																																																																																																																																								
4	AGND	Common ground (connected to frame)																																																																																																																																																																																																																																								
5	IACT	Connection point for a scope (H1 ... H6 only) ①																																																																																																																																																																																																																																								
J5	J5	AO1 current / voltage selection switch																																																																																																																																																																																																																																								
1	B	Drive-to-drive link																																																																																																																																																																																																																																								
2	A	(master-follower or embedded fieldbus)																																																																																																																																																																																																																																								
3	BGND	Isolated ground 2																																																																																																																																																																																																																																								
J3	J3	Drive-to-drive link termination switch																																																																																																																																																																																																																																								
11	NC	250 V _{AC} / 30 V _{DC} 2 A																																																																																																																																																																																																																																								
12	COM																																																																																																																																																																																																																																									
13	NO																																																																																																																																																																																																																																									
21	NC	250 V _{AC} / 30 V _{DC} 2 A																																																																																																																																																																																																																																								
22	COM																																																																																																																																																																																																																																									
23	NO																																																																																																																																																																																																																																									
31	NC	250 V _{AC} / 30 V _{DC} 2 A																																																																																																																																																																																																																																								
32	COM																																																																																																																																																																																																																																									
33	NO																																																																																																																																																																																																																																									
1	DIL	Digital interlock, ground: DICOM																																																																																																																																																																																																																																								
2	+24VD	+24 V _{DC} , 200 mA, ground : DIOGND (isolated)																																																																																																																																																																																																																																								
3	DICOM	Isolated digital input ground for DI1 ... DI5 and DIL																																																																																																																																																																																																																																								
4	+24VD	+24 V _{DC} , 200 mA, ground : DIOGND (isolated)																																																																																																																																																																																																																																								
5	DIOGND	Isolated digital input / output ground for DI6, DIO1, DIO2																																																																																																																																																																																																																																								
J6	J6	Digital ground selection switch (DIOGND and DICOM)																																																																																																																																																																																																																																								
1	DIO1																																																																																																																																																																																																																																									
2	DIO2																																																																																																																																																																																																																																									
1	DI1																																																																																																																																																																																																																																									
2	DI2																																																																																																																																																																																																																																									
3	DI3																																																																																																																																																																																																																																									
4	DI4																																																																																																																																																																																																																																									
5	DI5																																																																																																																																																																																																																																									
6	DI6																																																																																																																																																																																																																																									
1	A+	Channel A+ function depending on J4A																																																																																																																																																																																																																																								
2	A-	Channel A- function depending on J4A																																																																																																																																																																																																																																								
3	B+	Channel B+ function depending on J4B																																																																																																																																																																																																																																								
4	B-	Channel B- function depending on J4B																																																																																																																																																																																																																																								
5	Z+	Channel Z+ function depending on J4C																																																																																																																																																																																																																																								
6	Z-	Channel Z- function depending on J4C																																																																																																																																																																																																																																								
7	EGND	Common ground (connected to frame)																																																																																																																																																																																																																																								
8	+VENC	Encoder supply 5 V _{DC} or 24 V _{DC} depending on J4D, 250 mA																																																																																																																																																																																																																																								
J4A	J4A	Differential or single ended (10 k pull up) selection jumpers																																																																																																																																																																																																																																								
J4B	J4B																																																																																																																																																																																																																																									
J4C	J4C																																																																																																																																																																																																																																									
J4D	J4D	Encoder supply 5 V _{DC} or 24 V _{DC} selection jumper																																																																																																																																																																																																																																								
J7A	J7A	Not in use for DCS880																																																																																																																																																																																																																																								
J7B	J7B																																																																																																																																																																																																																																									
1	AITACH+	±8 ... 270 V _{DC}																																																																																																																																																																																																																																								
2	AITACH-																																																																																																																																																																																																																																									
1	MCCOM	250 V _{AC} / 30 V _{DC} Fixed output for the mains contactor																																																																																																																																																																																																																																								
2	MCNO	2 A																																																																																																																																																																																																																																								
3	STOCOM	250 V _{AC} / 30 V _{DC} Fixed output for safe torque off (STO) zero current monitor																																																																																																																																																																																																																																								
4	STONO	2 A																																																																																																																																																																																																																																								
1	OUT1	24 V _{DC} for STO circuit																																																																																																																																																																																																																																								
2	SGND	Common ground (connected to frame)																																																																																																																																																																																																																																								
3	IN1	Both circuits must be closed for drive to start																																																																																																																																																																																																																																								
4	IN2	Open circuits block the firing pulses																																																																																																																																																																																																																																								
1	DIL																																																																																																																																																																																																																																									
2	+24VD																																																																																																																																																																																																																																									
3	DICOM																																																																																																																																																																																																																																									
4	+24VD																																																																																																																																																																																																																																									
5	DIOGND																																																																																																																																																																																																																																									
J6	J6																																																																																																																																																																																																																																									
1	DIO1																																																																																																																																																																																																																																									
2	DIO2																																																																																																																																																																																																																																									
1	DI1																																																																																																																																																																																																																																									
2	DI2																																																																																																																																																																																																																																									
3	DI3																																																																																																																																																																																																																																									
4	DI4																																																																																																																																																																																																																																									
5	DI5																																																																																																																																																																																																																																									
6	DI6																																																																																																																																																																																																																																									
A	B	C	D																																																																																																																																																																																																																																							
1	4	7	10																																																																																																																																																																																																																																							
3	6	9	12																																																																																																																																																																																																																																							

XAI: Reference voltages and analog inputs

+VREF	+10 VDC, $\pm 1\%$. RL = 1 ... 10 k Ω . Maximum wire size 2.5 mm ² .
-VREF	-10 VDC, $\pm 1\%$. RL = 1 ... 10 k Ω . Maximum wire size 2.5 mm ² .
AI1+	± 10 V [$R_{in} \geq 200$ k Ω], 0 (4) ... 20 mA or ± 20 mA [$R_{in} = 100$ Ω] depending on J1.
AI1-	Maximum wire size 2.5 mm ² . Differential inputs, common mode range ± 30 V. Sampling interval per channel: 0.25 ms. Hardware filter: 0.25 ms. Resolution: 11 bit + sign. Inaccuracy: 1 % of full-scale range.
AI2+	± 10 V [$R_{in} \geq 200$ k Ω], 0 (4) ... 20 mA or ± 20 mA [$R_{in} = 100$ Ω] depending on J2.
AI2-	Maximum wire size 2.5 mm ² . Differential inputs, common mode range ± 30 V. Sampling interval per channel: 0.25 ms. Hardware filter: 0.25 ms. Resolution: 11 bit + sign. Inaccuracy: 1 % of full-scale range.
AI3+	± 10 V [$R_{in} \geq 200$ k Ω].
AI3-	Maximum wire size 2.5 mm ² . Differential inputs, common mode range ± 30 V. Sampling interval per channel: 0.25 ms. Hardware filter: 0.25 ms. Resolution: 11 bit + sign. Inaccuracy: 1 % of full-scale range.
	Parameter settings see DCS880 Firmware manual Group 12 Standard AI .



XAO: Analog outputs

AO1	± 10 V [load current ≤ 10 mA] or 0 (4) ... 20 mA [$R_L \leq 500$ Ω] depending on J5. Maximum wire size 2.5 mm ² . Frequency range: 0 ... 300 Hz. Resolution: 11 bit + sign. Inaccuracy: 2 % of full-scale range.
AO2	± 10 V [load current ≤ 10 mA]. Maximum wire size 2.5 mm ² . Frequency range: 0 ... 300 Hz. Resolution: 11 bit + sign. Inaccuracy: 2 % of full-scale range.
IAC	Connection point for a scope to measure the current directly over the burden resistor (H1 ... H6 only. For H7 and H8 see SDCS-OPL-H01). Scaling, see 13.80 Scaling of fixed current output.
	Parameter settings see DCS880 Firmware manual Group 13 Standard AO .

XD2D: Drive-to-drive link


B	Maximum wire size 2.5 mm ² .
A	Physical layer: RS-485. Termination by switch J3.
	Parameter settings see DCS880 Firmware manual Group 60 DDCS communication .

The drive-to-drive link is a daisy-chained RS-485 transmission line that allows basic master-follower communication with one master and multiple followers. It is also used for the embedded fieldbus.

Set the termination switch J3 (see [Jumpers and switches](#)) next to terminal block XD2D to terminated () at the two physical ends of the drive-to-drive link. All intermediate switches have to be set to not terminated ().

Use double shielded twisted-pair cable (~ 100 Ω, for example, PROFIBUS compatible cable) for the wiring. For best immunity, high quality cable is recommended. Keep the cable as short as possible. The maximum complete length of the link is 50 meters. Avoid unnecessary loops and running the link near power cables.

The following diagram shows the wiring of the drive-to-drive link.

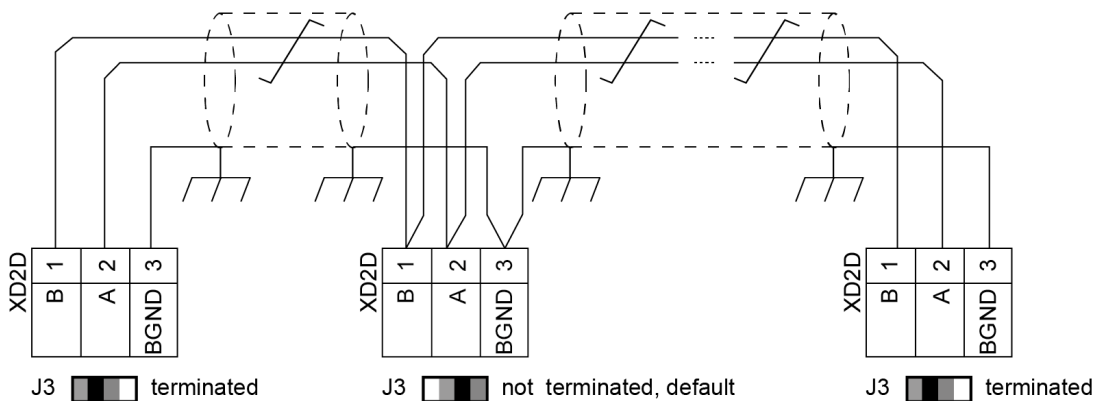

SF_880_008_DCT_drive2drive_b.ai


RO1, RO2, RO3: Relay outputs

NC	250 V _{AC} /30 V _{DC} , 2 A.
COM	Maximum wire size 2.5 mm ² .
NO	Varistor protected.
	Parameter settings see DCS580 Firmware manual Group 10 Standard DI, RO.

XD24: Digital interlock

DIL	<p>The digital interlock works like a normal digital input and has no special function in the DCS880. It can be selected for example as the source for an emergency stop command or any other external event.</p> <p>See the DCS880 Firmware manual for more information.</p> <p>Maximum wire size 2.5 mm².</p> <p>+24 V_{DC} logic levels: low < 5 V_{DC}, high > 15 V_{DC}.</p> <p>R_{in} = 2 kΩ.</p> <p>Hardware filter: 0.04 ms.</p> <p>Digital filter up to 100 ms.</p> <p>Related ground is DICOM.</p>
+24VD	<p>+24 V_{DC}, 200 mA.</p> <p>Total load power of these outputs is 4.8 W (200 mA, 24 V_{DC}) minus the power taken by DIO1 and DIO2.</p> <p>Maximum wire size 2.5 mm².</p> <p>Related ground is DIOGND.</p>
	Parameter settings see DCS880 Firmware manual Group 10 Standard DI, RO.
	Switch on/off delays (reaction time) see DCS880 Firmware manual chapter I/O configuration.

XDIO: Digital inputs/outputs

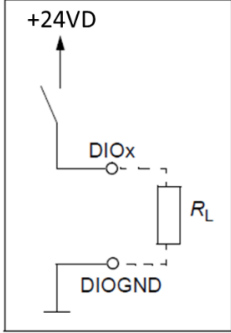DIO1	Maximum wire size 2.5 mm ² .
DIO2	<p>As input:</p> <ul style="list-style-type: none"> +24 V_{DC} logic levels: low < 5 V_{DC}, high > 15 V_{DC}. R_{in} = 2 kΩ. Filter: 0.25 ms. <p>As output:</p> <ul style="list-style-type: none"> Total output current from +24VD is limited to 200 mA. <div style="text-align: center;">  <p>The diagram shows a circuit for a digital output. A +24VD supply is connected to a switch. The other end of the switch is connected to a terminal labeled DIOx. This terminal is connected to a load resistor RL. The other end of RL is connected to a terminal labeled DIOGND, which is grounded.</p> </div> <ul style="list-style-type: none"> Filter: 0.04 ms. Related ground is DIOGND.
	Parameter settings see DCS880 Firmware manual Group 11 Standard DIO, FI, FO .
	Switch on/off delays (reaction time) see DCS880 Firmware manual chapter I/O configuration .

XDI: Digital inputs

DI1	Maximum wire size 2.5 mm ² .
DI2	+24 V _{DC} logic levels: low < 5 V _{DC} , high > 15 V _{DC} .
DI3	R _{in} = 2 kΩ.
DI4	Hardware filter: 0.04 ms.
DI5	Digital filter up to 100 ms.
DI6	DI1 ... DI5: Related ground is DICOM. DI6: Related ground is DIOGND.
	Parameter settings see DCS880 Firmware manual Group 10 Standard DI, RO .
	Switch on/off delays (reaction time) see DCS880 Firmware manual chapter I/O configuration .

XENC: Encoder

A+	<p>OnBoard encoder interface supply voltage 5 V_{DC} or 24 V_{DC} (not isolated) depending on J4D, 250 mA.</p> <p>OnBoard encoder interface type differential or single ended depending on J4A ... J4C.</p> <p>Maximum wire size 2.5 mm².</p>																								
A-																									
B+																									
B-																									
Z+																									
Z-																									
EGND																									
+VENC	<table border="1"> <tr> <td>J4</td> <td></td> <td>J4</td> <td>Encoder supply</td> </tr> <tr> <td>A</td> <td>B</td> <td>C</td> <td>D</td> </tr> <tr> <td>1</td> <td>4</td> <td>7</td> <td>10</td> </tr> <tr> <td colspan="3">10 kΩ Differential (open collector) Single ended (open collector, push pull)</td> <td>24 V HTL (level)</td> </tr> <tr> <td>3</td> <td>6</td> <td>9</td> <td>12</td> </tr> <tr> <td colspan="3">120 Ω Differential (push pull) Default</td> <td>5 V TTL (level) Default</td> </tr> </table> <p>OnBoard Encoder Feedback 24 V ↓ 5 V</p>	J4		J4	Encoder supply	A	B	C	D	1	4	7	10	10 kΩ Differential (open collector) Single ended (open collector, push pull)			24 V HTL (level)	3	6	9	12	120 Ω Differential (push pull) Default			5 V TTL (level) Default
J4		J4	Encoder supply																						
A	B	C	D																						
1	4	7	10																						
10 kΩ Differential (open collector) Single ended (open collector, push pull)			24 V HTL (level)																						
3	6	9	12																						
120 Ω Differential (push pull) Default			5 V TTL (level) Default																						
Parameter settings see DCS880 Firmware manual Group 94 OnBoard speed feedback configuration .																									

XTAC: Analog tacho

AITACH+	OnBoard tacho interface.
AITACH	Maximum wire size 2.5 mm ² . Differential input max. voltage 8 ... 270 V.
Parameter settings see DCS880 Firmware manual Group 94 OnBoard speed feedback configuration .	

XSMC: Mains contactor

MCCOM	Fixed output for the mains contactor.
MCNO	250 V _{AC} /30 V _{DC} , 2 A. Maximum wire size 2.5 mm ² . Varistor protected. Mains contactor ON command: 06.24.b07 Current controller status word 1
STOCOM	Fixed output for safe torque off (STO) zero current monitor.
STONO	250 V _{AC} /30 V _{DC} , 2 A. Maximum wire size 2.5 mm ² . Varistor protected.
(STO) zero current monitor: 31.99.b09 STO fault diagnostic	

XSTO: Safe torque off

OUT1	<p>For the drive to start, both connections (OUT1 to IN1 and IN2) must be closed. By default, the terminal block has wires to close the circuit. Removing the wires will block the firing pulses.</p> <p>Maximum wire size 2.5 mm². Current consumption per channel: 55 mA (continuous). The maximum cable length from:</p> <ul style="list-style-type: none"> – FSPS-21 to XSTO is 3 m. – FSO-21 to XSTO is 1 m.
IN1	
IN2	

X205 Memory unit connection

The drive is equipped with a memory unit that is plugged into X205 on the SDCS-CON-H01. The memory unit contains the firmware, the parameters, and the application program (as option). It is possible to handle the parameters by control panel, PC tool or overriding control. Changed parameters are stored immediately in the memory unit.

In addition, the fault logger entries are stored in the memory unit during de-energizing the auxiliary power.

When a drive is replaced, the parameter settings can be retained by transferring the memory unit from the defective drive to the new drive.




WARNING

Do not remove or insert a memory unit when the drive is powered.

After power-up, the drive will scan the memory unit. If different parameter settings are detected, they are copied to the drive. This may take several minutes.

Replacing the memory unit


Make sure, that the auxiliary power is off. Unscrew the memory unit and pull it out. Replace the memory unit in reverse order.

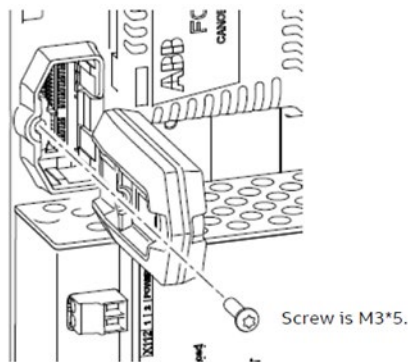


Additional terminals

- Use connectors Slot 1 ... Slot 3 for F-type I/O extension modules and F-type fieldbus adapters.
- Connectors XC12, XS13, X14 and X38 connect the SDCS-CON-H01 to the SDCS-PIN-H01 or SDCS-POW-H01 for voltage, current, temperature measurement and safety.
- Use connector X13 to connect the control panel either directly via a jack plug or via a CAT 1:1 cable (< 3 m) with RJ-45 plugs.


Ground isolation diagram

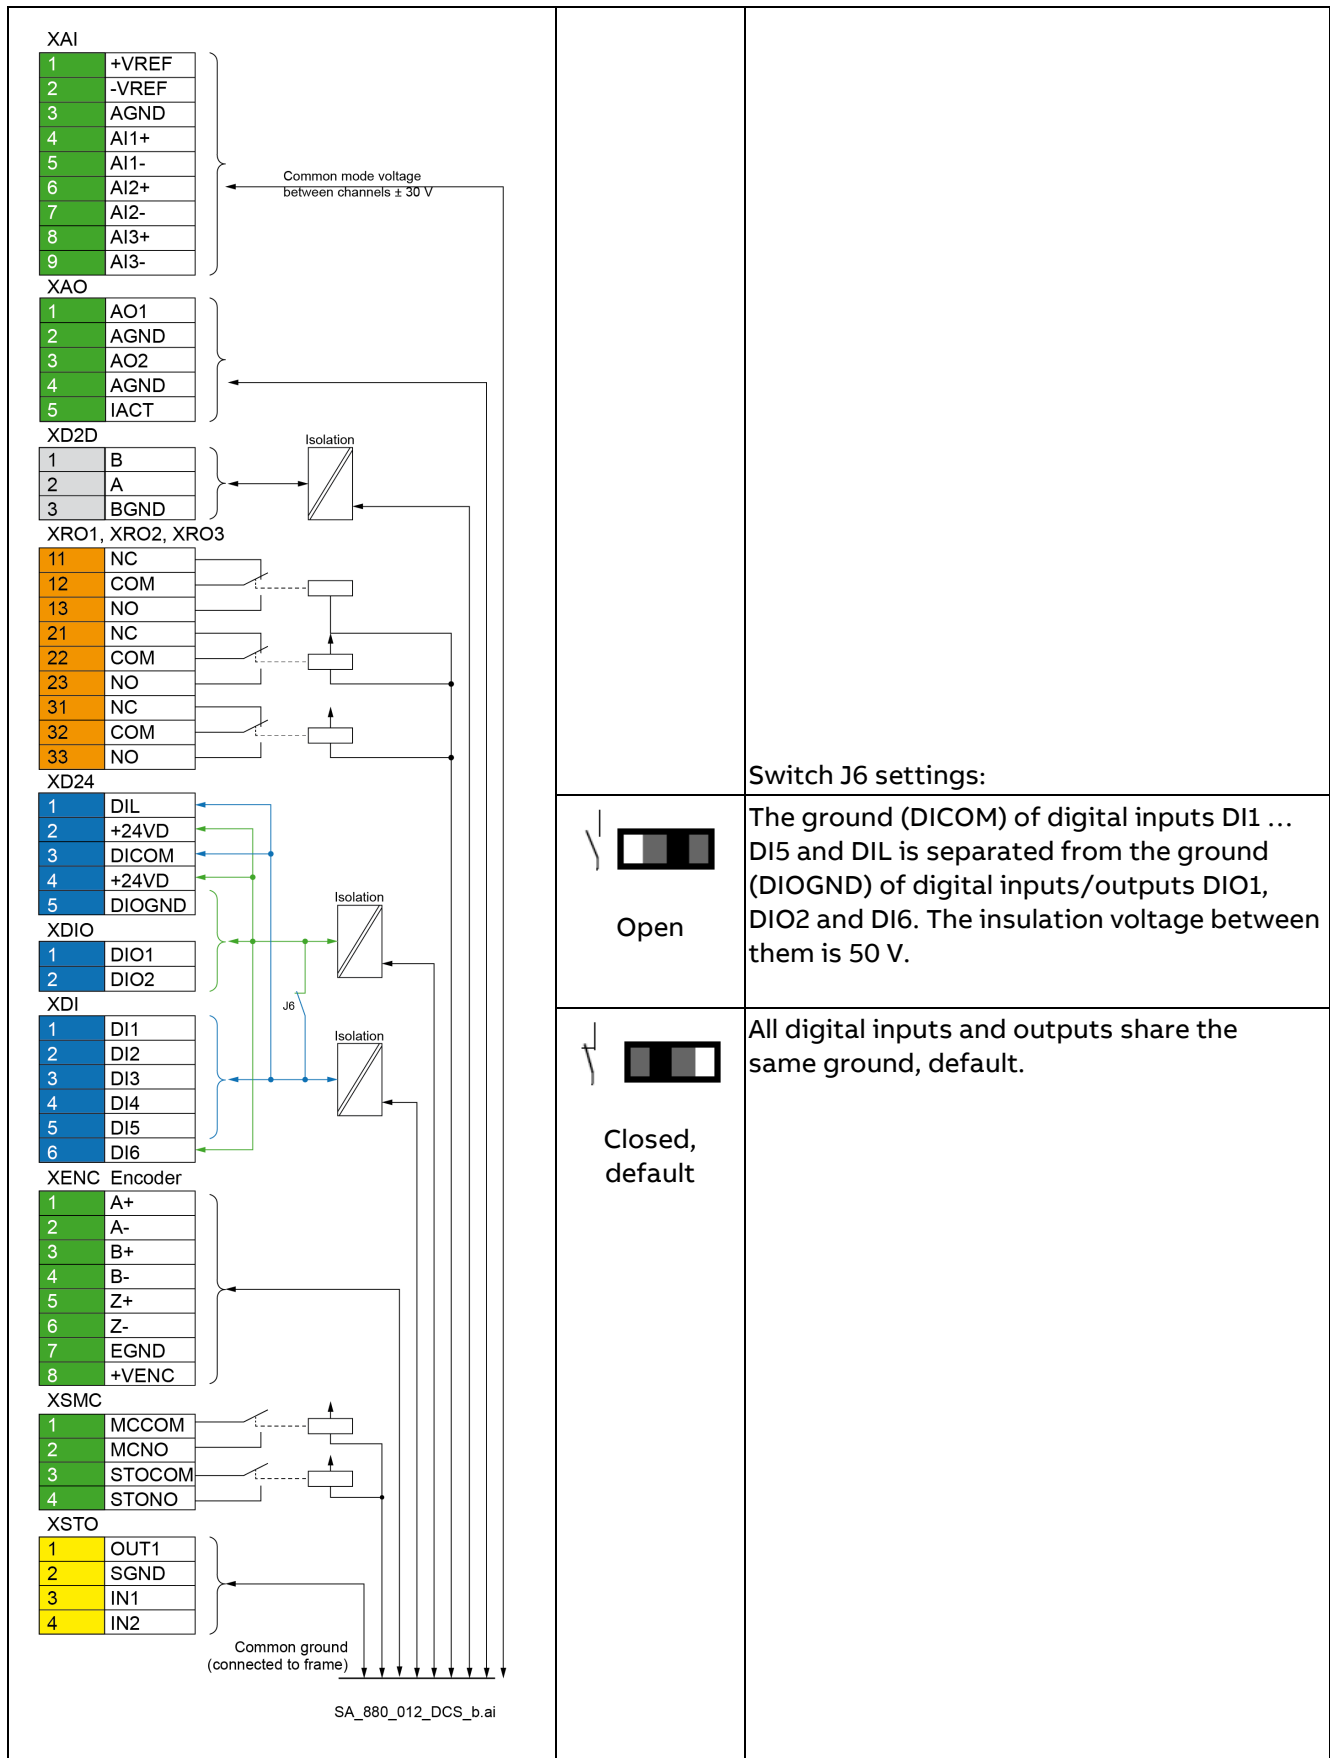

Switch J6 settings:
















The ground (DICOM) of digital inputs DI1 ... DI5 and DIL is separated from the ground (DIOGND) of digital inputs/outputs DIO1, DIO2 and DI6. The insulation voltage between them is 50 V.

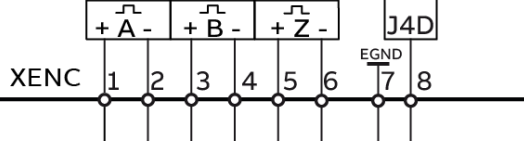


All digital inputs and outputs share the same ground, default.

Jumpers and switches

Jumper/Switch	Description	Positions															
J1 (AI1)	Determines whether analog input AI1 is used as a current or voltage input.	 Current (I)															
		 Voltage (U), default.															
J2 (AI2)	Determines whether analog input AI2 is used as a current or voltage input.	 Current (I)															
		 Voltage (U), default.															
J3 (D2D)	Drive-to-drive link termination. Must be set to terminated position when the thyristor power controller is the last unit on the link.	 Bus is not terminated, default.															
		 Bus is terminated.															
J4A ... J4D (encoder)	OnBoard encoder interface.	<table border="1" data-bbox="975 981 1469 1122"> <thead> <tr> <th>J4 A</th> <th>B</th> <th>C</th> <th>J4 D</th> <th>Encoder supply</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td>24 V HTL (level)</td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td>5 V TTL (level) Default</td> </tr> </tbody> </table> <p data-bbox="975 1131 1469 1301"> OnBoard Encoder Feedback 24 V ↓ 5 V  </p>	J4 A	B	C	J4 D	Encoder supply					24 V HTL (level)					5 V TTL (level) Default
J4 A	B	C	J4 D	Encoder supply													
				24 V HTL (level)													
				5 V TTL (level) Default													
J5 (AO1)	Determines whether analog output AO1 is used as a current or voltage output.	 Voltage (U), default.															
		 Current (I)															
J6 (grounding)	Digital ground selection switch. Determines whether DICOM is separated from DIOGND (e.g., the common reference for digital inputs floats). See Ground isolation diagram . The insulation voltage between them is 50 V.	 DIOGND and DICOM separated.															
		 DIOGND and DICOM connected, default.															
J7A, J7B		 Encoder, default.															
		 Not in use for DCS880.															

DDCS Interface configuration

Ch0 DriveBus or module bus connection to Advant Controller (star)

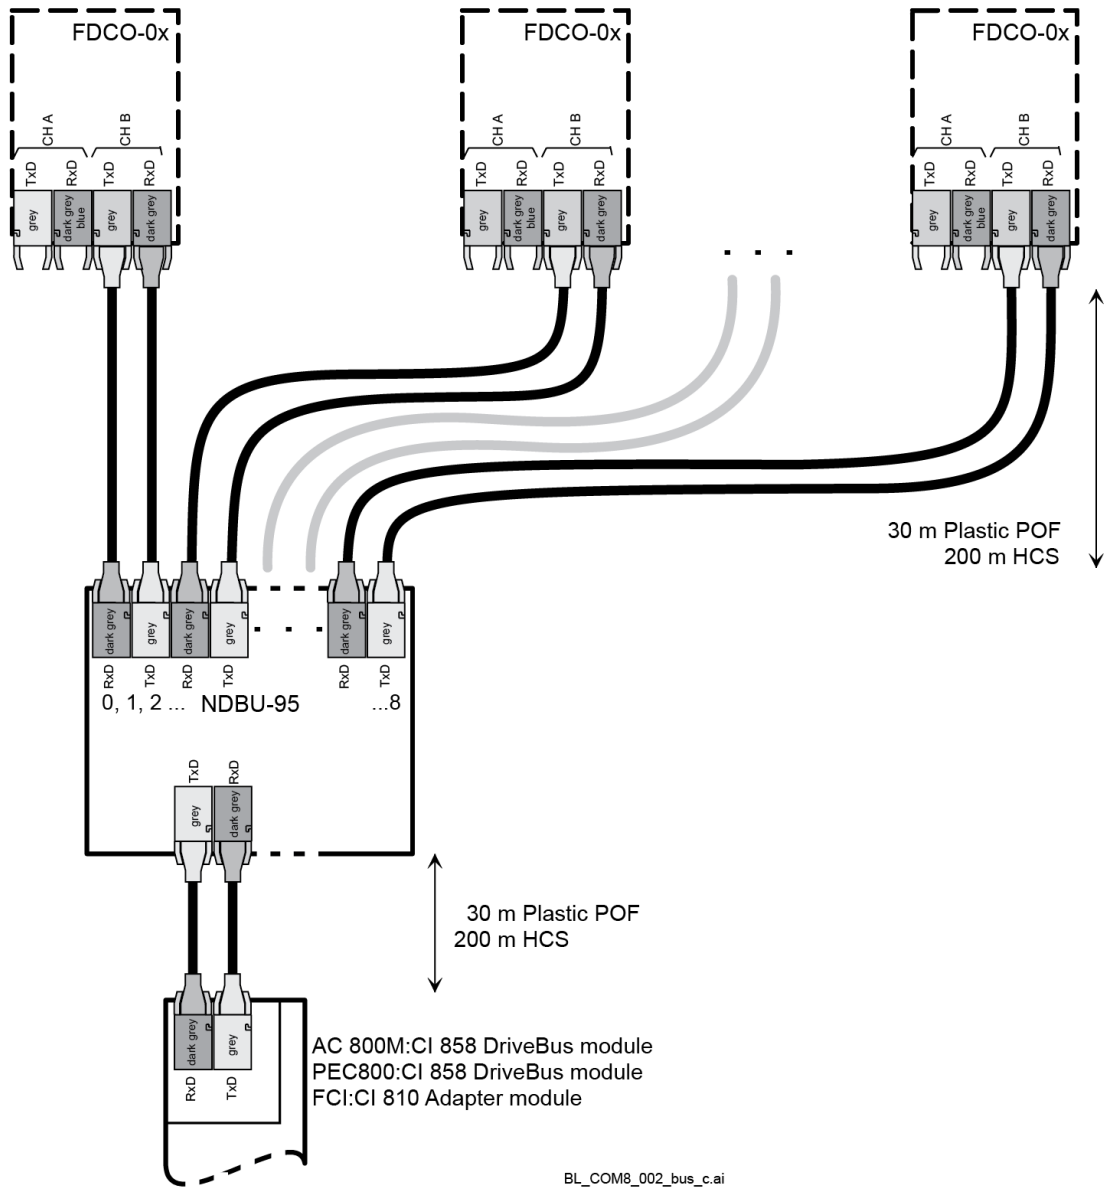

BL_COM8_002_bus_c.ai

DDCS branching unit NDBU-95

The NDBU-95 is used to implement star topology for DDCS communication. This allows a drive to fail or become unpowered without disabling the complete communication. The NDBU-95 receives messages from the master (e.g., PC) and sends them to all the drives simultaneously. Each drive has an individual address and only the addressed drive sends a reply message to the master.

NDBU-95 has nine output channels. The reply message sent by a drive is delivered to the master. Several NDBU-95s can be used in parallel, in series or in any combination of these. The maximum distance between the master and a NDBU-95 as well as between two NDBU-95s, see manual [Branching units NDBU-95](#).

Technical data

Optical links

- Master channels: 1 x DDCS input and 1 x DDCS output.
- Drive channels: 9 x DDCS inputs and 9 x DDCS outputs.
- Data rate: 1 ... 4 Mbit/s (see X12).
- Driving current: 20 mA, 30 mA, 50 mA and channel disabling (see X2 ... X11).
- Monitoring: A green LED for each channel is switched on when messages are received.
- Transmission: 10 Mb components.

Power supply

- Input voltage: +24 V_{DC} ±10 %.
- Input current: 300 mA.
- Monitoring: A green LED is switched on when the voltage is normal.



Operating temperature: +0 ... +50°C.

Dimensions: See diagram.

Note: Only channels with the same hardware components (e.g., 10 Mb component) are allowed to be connected together.

For further information see [Branching units NDBU-95](#).

Layout of the NDBU-95

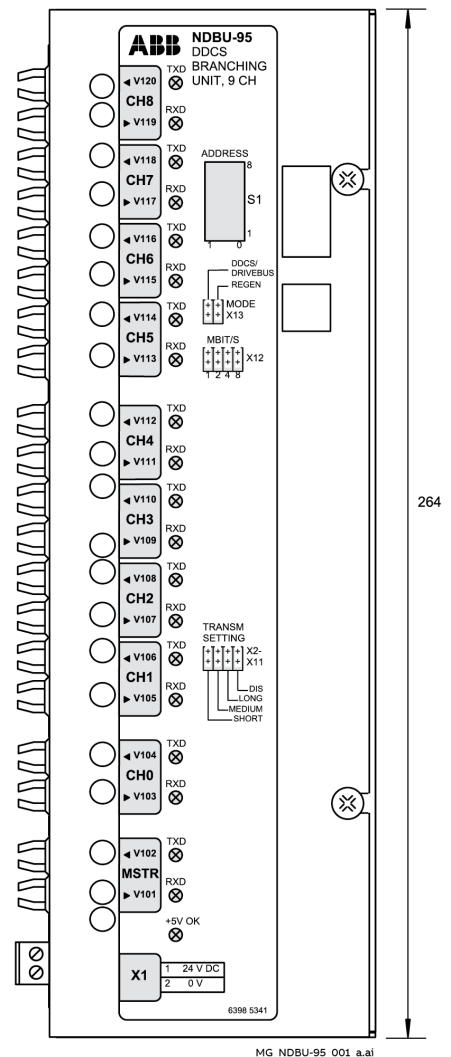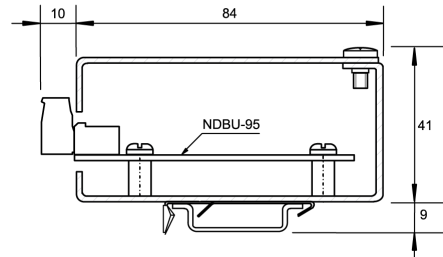


DCSLink board SDCS-DSL-H1x (H1 ... H8)

The SDCS-DSL-H1x provides communication between drives. The communication hardware and protocol are based on CAN bus.


This communication will be used for 12-pulse operation and communication to field exciters.

The communication hardware is equipped with an isolated power supply and an isolated transmitter.

The bus termination can be set by jumper J1. See also chapter [DCSLink communication](#).

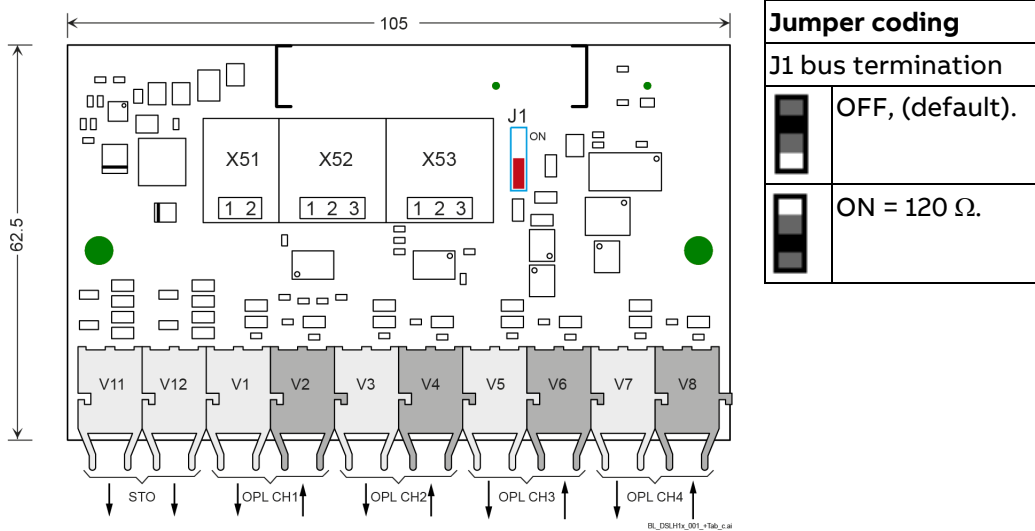

SDCS-DSL-H1x	
SDCS-DSL-H10	<ul style="list-style-type: none"> 1 x DCSLink channel. 0 x optical power link channels. Used for units size H1 ... H4 with external field exciters. Used for units size H5 and H6 with internal/external field exciters.
SDCS-DSL-H12	<ul style="list-style-type: none"> 1 x DCSLink channel. 2 x optical power link channels. Used for all units size H7 and H8. Used for units size H8 in hardparallel configuration with up to 2 power units.
SDCS-DSL-H14	<ul style="list-style-type: none"> 1 x DCSLink channel. 4 x optical power link channels. Used for units size H8 in hardparallel configuration with up to 4 power units.

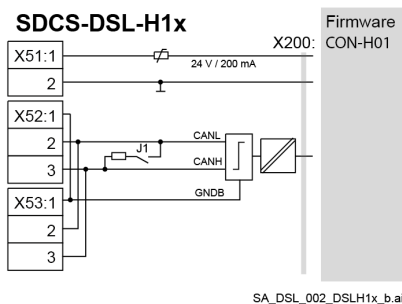

Supply	Remarks
24 V _{DC} ≤ 200 mA	24 V _{DC} grounded supply for DCF803-0016, FEX-425-Int and DCF803-0035 field exciters. Short circuit protected.

- X51 supplies 24 V_{DC}.
- X52 and X53 are connected in parallel and provide two connectors for the DCSLink.

Notes:

- Maximum total DCSLink cable length is 100 m.
- Maximum length of the plastic optic fiber cable between SDCS-DSL-H12/H14 and SDCS-OPL-H01 is 5 m.


Daisy chain DPI-H01 kit (H1 ... H8)

Daisy chain adapters are used to connect several drives to one control panel or to a PC via a control panel. Maximum of 32 nodes are possible. The control panel/PC is the master, while the drives equipped with a daisy chain adapter are followers.

Note: The DPI-H01 kit can be ordered together with the drives using pluscode +J428.


Contents of the kit

- ① Plastic cover.
- ② SDCS-DPI-H01 adapter.
- ③ Patch cable.
- ④ Grounding cable plus screw.
- ⑤ Stand offs.

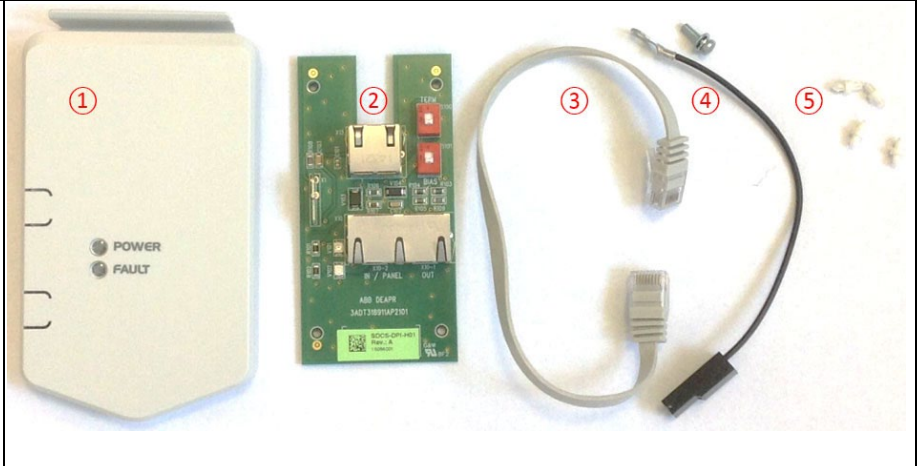


Layout

- ① Clip to attach the plastic cover.
- ② Status LEDs via light pipes.
- ③ X13 for the patch cable to the unit.
- ④ Termination switch (S100).
- ⑤ Bias switch (S101).

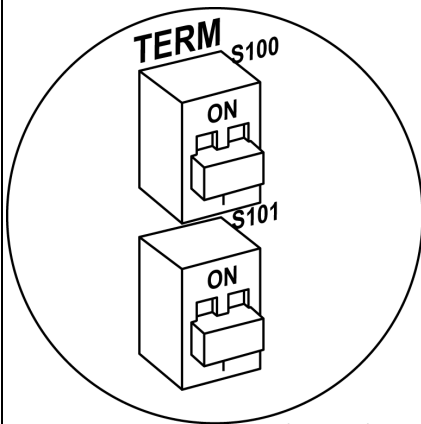

BE_STE_001_term S10x_a.ai


- ⑥ X1 for grounding.
- ⑦ X10-1 (IN / PANEL) for control panel.
- ⑧ X10-2 (OUT) for the next unit.
- ⑨ Status LEDs.

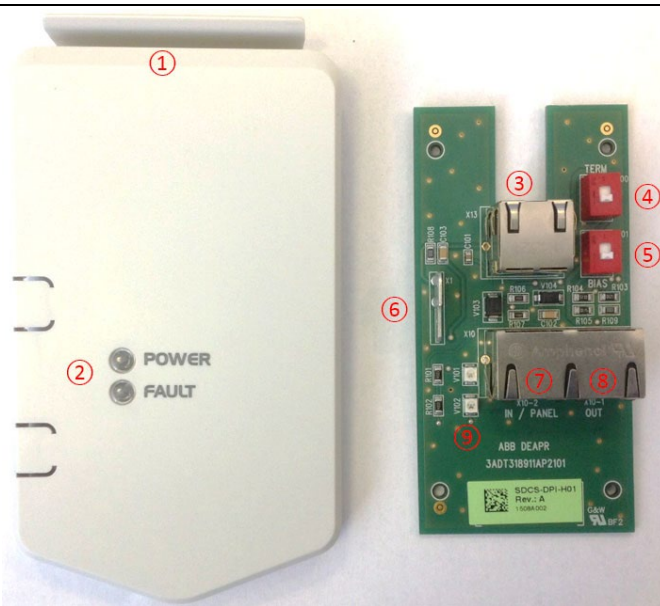


Status LED name	Color	Description
POWER	Green	The unit is powered.
FAULT	Red	The unit has an active fault.

Installation

1. Inset the four stand offs into the intermediate cover.
2. Connect the patch cable between X13 on the SDCS-CON-H01 and X13 on the SDCS-DPI-H01 adapter.
3. Plug the SDCS-DPI-H01 adapter onto the standoffs.
4. Connect the grounding cable at X1 and the grounding standoff using the screw.
5. Connect the cables to the control panel/a drive using X10:2 and X10:1.

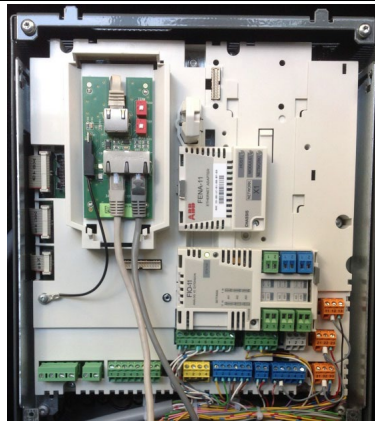

6. Attach the plastic cover.

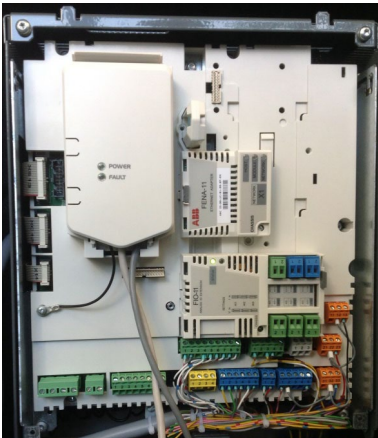


7. Attach the front cover.



Chaining a control panel


This figure shows how to chain a control panel to several drives.

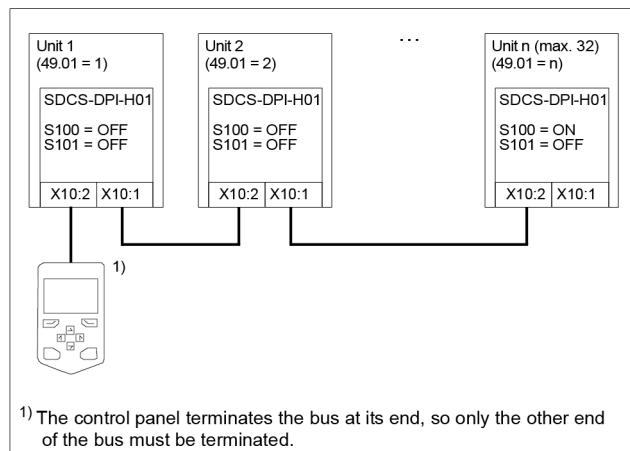

SB_880_003_DPI-H_b.a1

This figure shows how to chain a PC via a control panel to several drives.

Note: When a control panel is used for a PC connection, it cannot be used to operate the drives.

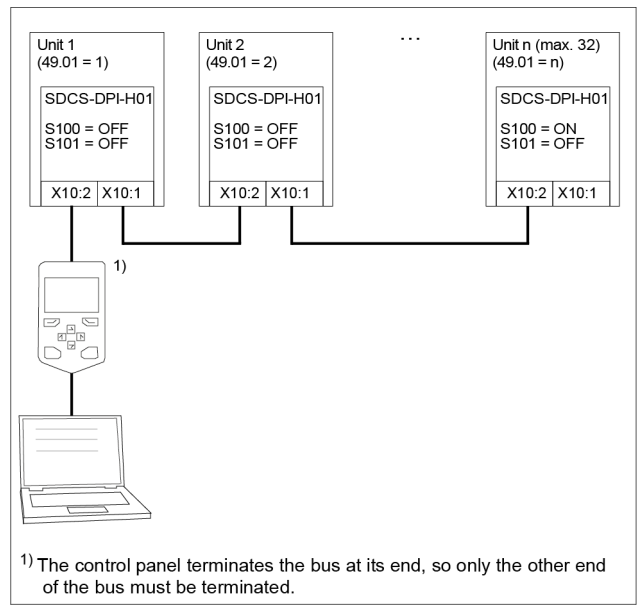

Setting up the firmware

1. Power up the drive.
2. Set the node ID, see 49.01 Node ID number. All drives connected to the panel bus must have a unique node ID. It is advisable to reserve node ID 1 for spare/replacement drives, because they have node ID 1 as default setting.
3. Set the baud rate, see 49.03 Baud rate. The baud rate has to be the same for all nodes on the panel bus.
4. Select a suitable communication loss action, see 49.04 Communication loss time and 49.05 Communication loss action.
5. Save the settings with 49.06 Refresh settings = Refresh.

Note: Refreshing may cause a communication break, thus reconnecting the drives may be required.

Power Interface board SDCS-PIN-H01 (H1 ... H5)

The SDCS-PIN-H01 is designed for DCS880 converter modules sizes H1 ... H5 (20 A ... 1190 A).

It has 5 different functions:


1. The power supply for all internal voltages of the whole drive and the connected options (H1 ... H5).
2. Control of armature bridge including high ohmic measurement of DC- and AC voltage (H1 ... H5).
3. Provides an interface for the current transformers measuring the armature current (H1 ... H5).
4. Control of the OnBoard field exciter and field current measurement (H1 ... H4).
5. An automatic adaptation of the auxiliary voltage of either 230 V_{AC} or 115 V_{AC} (H1 ... H5).

The board is connected to ground at points (⊕) inside the module.

The board is used for mains supply voltages from 100 V up to 500 V (IEC)/525 V (UL) and 600 V.

The DCS880 provides an automatic adjustment for current and voltage measurement, burden resistor settings and 2-Q or 4-Q operation by means of setting parameters in the firmware.

Layout SDCS-PIN-H01

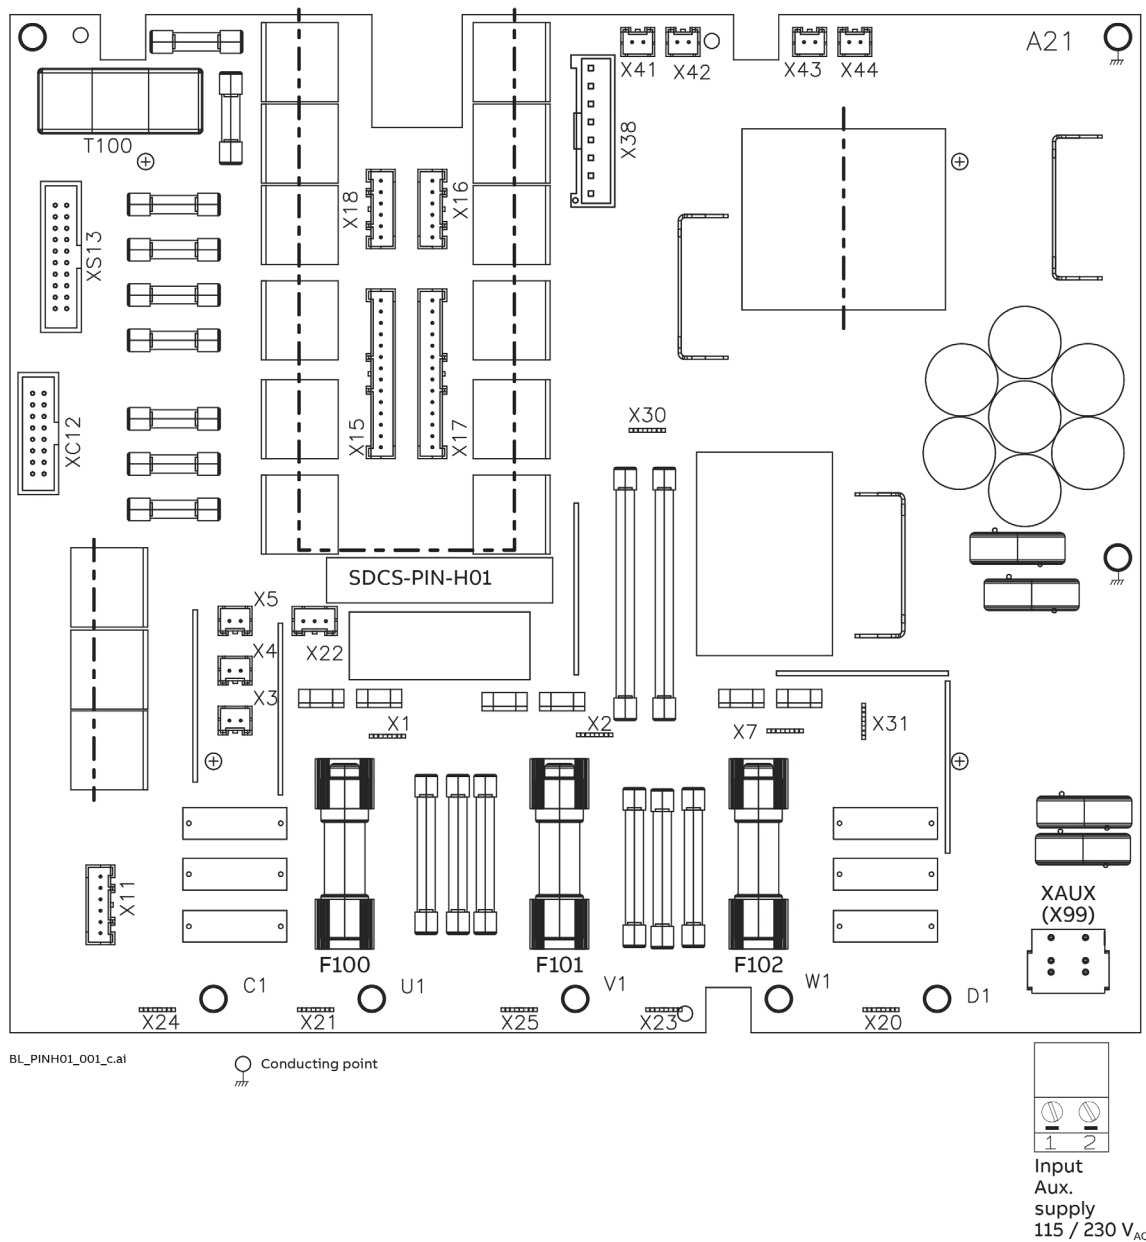

Technical data

Auxiliary supply voltage XAUX (X99)


Auxiliary voltage	115 V _{AC}	230 V _{AC}	230 V _{DC}
Tolerance	-15 %/+10 %	-15 %/+10 %	-15 %/+10 %
Frequency	45 Hz ... 65 Hz	45 Hz ... 65 Hz	-
Power consumption	160 VA ①	170 VA ①	120 W ①
Nominal output power ②	96 W	96 W	96 W
Inrush current	20 A/20 ms	10 A/20 ms	15 A/20 ms
Recommended fusing	6 AT	6 AT	6 AT
Mains buffering	min. 30 ms	min. 30 ms	min. 30 ms
Power fail	< 90 V _{AC}	< 90 V _{AC}	< 115 V _{DC}

① At 25°C.

② $3.5 \text{ A} \times 24 \text{ V}_{\text{DC}} + 0.25 \text{ A} \times 48 \text{ V}_{\text{DC}} = 96 \text{ W}$.

Input circuit XAUX (X99)

Features a hardware filter and a voltage limitation

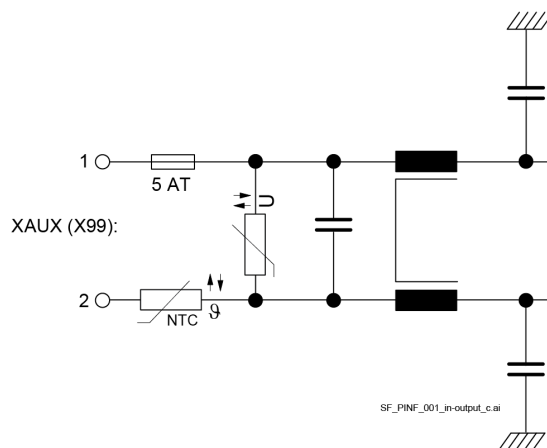

Armature circuit interface

The function for the armature circuit interface consists of:


- Firing the armature bridge of 6 or 12 thyristors.
- High ohmic measurement of DC and AC voltages.
- Residual current measurement of armature circuit to ground equals approximately 5 mA at 500 V mains ($\approx 1 \text{ M}\Omega$).
- Interface for the current transformers for current measurement.
- Snubber circuit for the thyristor protection together with R1 on the heatsink.
- Interface for heatsink temperature measurement with a PTC.
- Fuses for overvoltage protection and field circuit.

Power supply board SDCS-POW-H01 (H6 ... H8)

The SDCS-POW-H01 is designed for DCS880 converter modules and is mounted on the electronic tray. It is used for sizes H6, H7, H8 and the rebuild kit DCS880-R.

The SDCS-POW-H01 generates all necessary DC voltages for the SDCS-CON-H01 and all other electronic boards. The input voltage is automatically detected and set to either 230 V_{AC} or 115 V_{AC}.

X38 connection to the control board

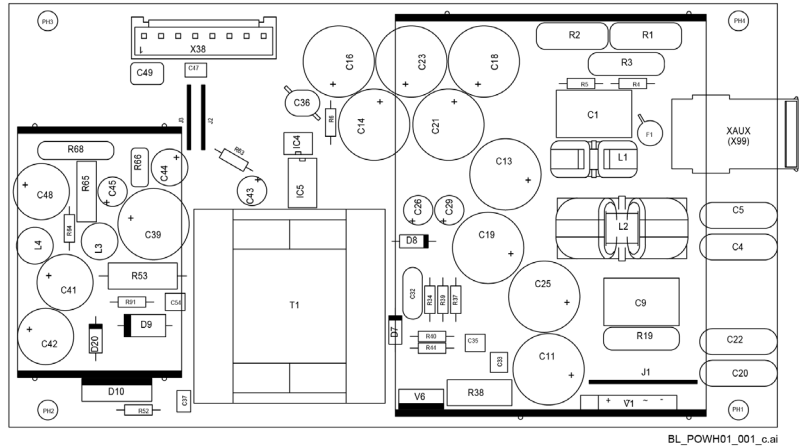

BL_POWH01_001_c.ai

Technical data


Auxiliary supply voltage XAUX (X99)

Auxiliary voltage	115 V _{AC}	230 V _{AC}	230 V _{DC}
Tolerance	-15 %/+10 %	-15 %/+10 %	-15 %/+10 %
Frequency	45 Hz ... 65 Hz	45 Hz ... 65 Hz	-
Power consumption	160 VA ①	170 VA ①	120 W ①
Nominal output power ②	96 W	96 W	96 W
Inrush current ③	20 A/20 ms	10 A/20 ms	15 A/20 ms
Recommended fusing	6 AT	6 AT	6 AT
Mains buffering	min. 30 ms	min. 30 ms	min. 30 ms
Power fail	< 90 V _{AC}	< 90 V _{AC}	< 115 V _{DC}

① At 25°C.

② $3.5 \text{ A} \times 24 \text{ V}_{\text{DC}} + 0.25 \text{ A} \times 48 \text{ V}_{\text{DC}} = 96 \text{ W}$.

③ Frequently switching ON and OFF increases the inrush current.

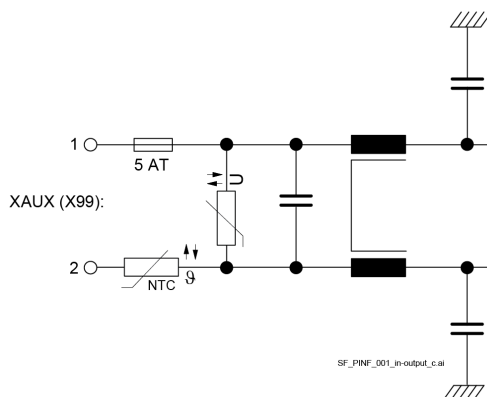

Field circuit interfaces SDCS-BAB-F01 and SDCS-BAB-F02 (H1 ... H4)

The OnBoard field exciter is located internally. The firing pulses are synchronized using the mains circuit L1, L2, L3 and the SDCS-CON-H01. The pulses are amplified on the SDCS-PIN-H01.

The hardware structure is a three-phase half-controlled bridge supplied directly from the mains U1, V1, W1 via fuses F100, F101, F102.

If the OnBoard field exciter is not needed it can be deselected in the firmware.

The field circuit interface consists of:

- Firing the three-phase half-controlled field bridge.
- Measuring the field current on the DC side. The scaling is automatically selected using the rated motor field current.
- The snubber circuit is shared with the armature bridge.
- Fuses F100, F101, F102 are used for cable and motor field winding protection.
- Size H3 and H4 converters for 600 V are always delivered without OnBoard field exciter.
- Size H5 converters do not use the field circuit interface on the SDCS-PIN-H01

Ratings OnBoard field exciter


AC voltage range	110 ... 500 V (IEC)/525 V (UL)
AC insulation voltage	600 V
Frequency	50 Hz/60 Hz
AC input current	< Field current

Cables


Size	H1	H1	H2	H3	H4
DC output current	6 A/12 A	12 A	18 A	25 A	30 A
max. cross sectional area	6 mm ² AWG 10	6 mm ² AWG 10	6 mm ² AWG 10	6 mm ² AWG 10	6 mm ² AWG 10
min. cross sectional area	1 mm ² AWG 16	2.5 mm ² AWG 13	4 mm ² AWG 11	6 mm ² AWG 10	6 mm ² AWG 10

Layout

SDCS-BAB-F01 for module sizes H1 and H2:

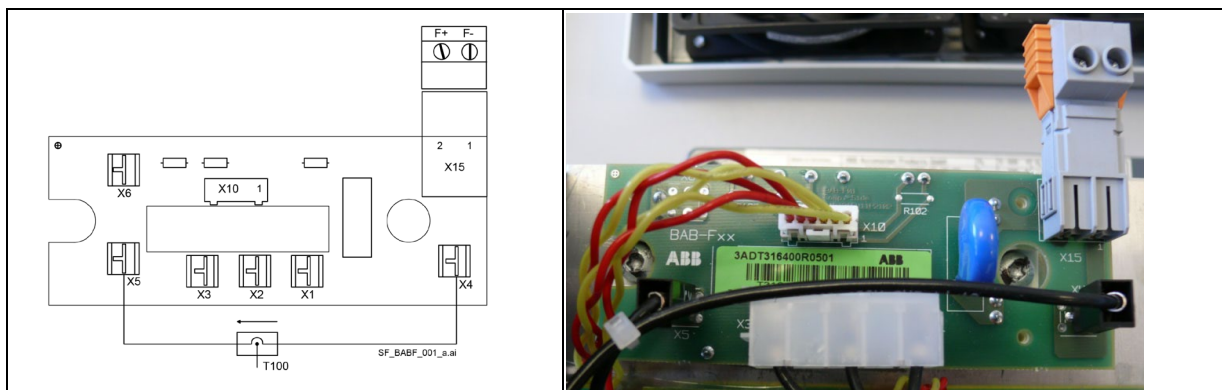

SDCS-BAB-F02 for module sizes H3 and H4:

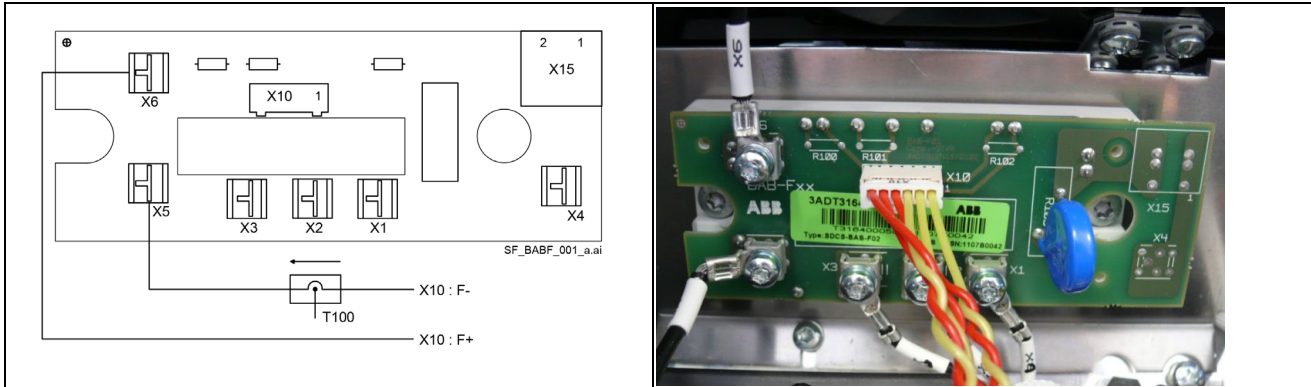

Location

The SDCS-BAB-F0x is located between the power part and the control board SDCS-CON-H01.

Functions


The SDCS-BAB-F0x is a three-phase half-controlled field exciter. The field exciter is directly supplied from the armature mains. Its firing pulses and snubbers are located on the SDCS-PIN-H01. For connection details see next pages.

Size	Converter type	Used type	Used fuses	T100 threads	I _F [A]
H1	DCS880-S01-0020 ... DCS880-S02-0025	SDCS-BAB-F01	F100 ... F102 on SDCS-PIN-H01 KTK 25 = 25 A	4 ①	0.3 ... 6
H1	DCS880-S01-0045 ... DCS880-S02-0100	SDCS-BAB-F01	F100 ... F102 on SDCS-PIN-H01 KTK 25 = 25 A	3 ①	1 ... 12
H2	DCS880-S01-0135 ... DCS880-S02-0300	SDCS-BAB-F01	F100 ... F102 on SDCS-PIN-H01 KTK 25 = 25 A	2 ①	1 ... 18
H3	DCS880-S01-0315 ... DCS880-S02-0520	SDCS-BAB-F02	F100 ... F102 on SDCS-PIN-H01 KTK 25 = 25 A	1 ①	2 ... 25
H4	DCS880-S01-0610 ... DCS880-S02-1000	SDCS-BAB-F02	F401 ... F403 in drive KTK 30 = 30 A	1 ①	2 ... 30


① Number of threads through the hole in the T100 (e.g., 3 threads equal 2 loops).

Circuit diagrams

Typical armature circuit diagram for module sizes H1 and H2 using SDCS-PIN-H01 and SDCS-BAB-F01:

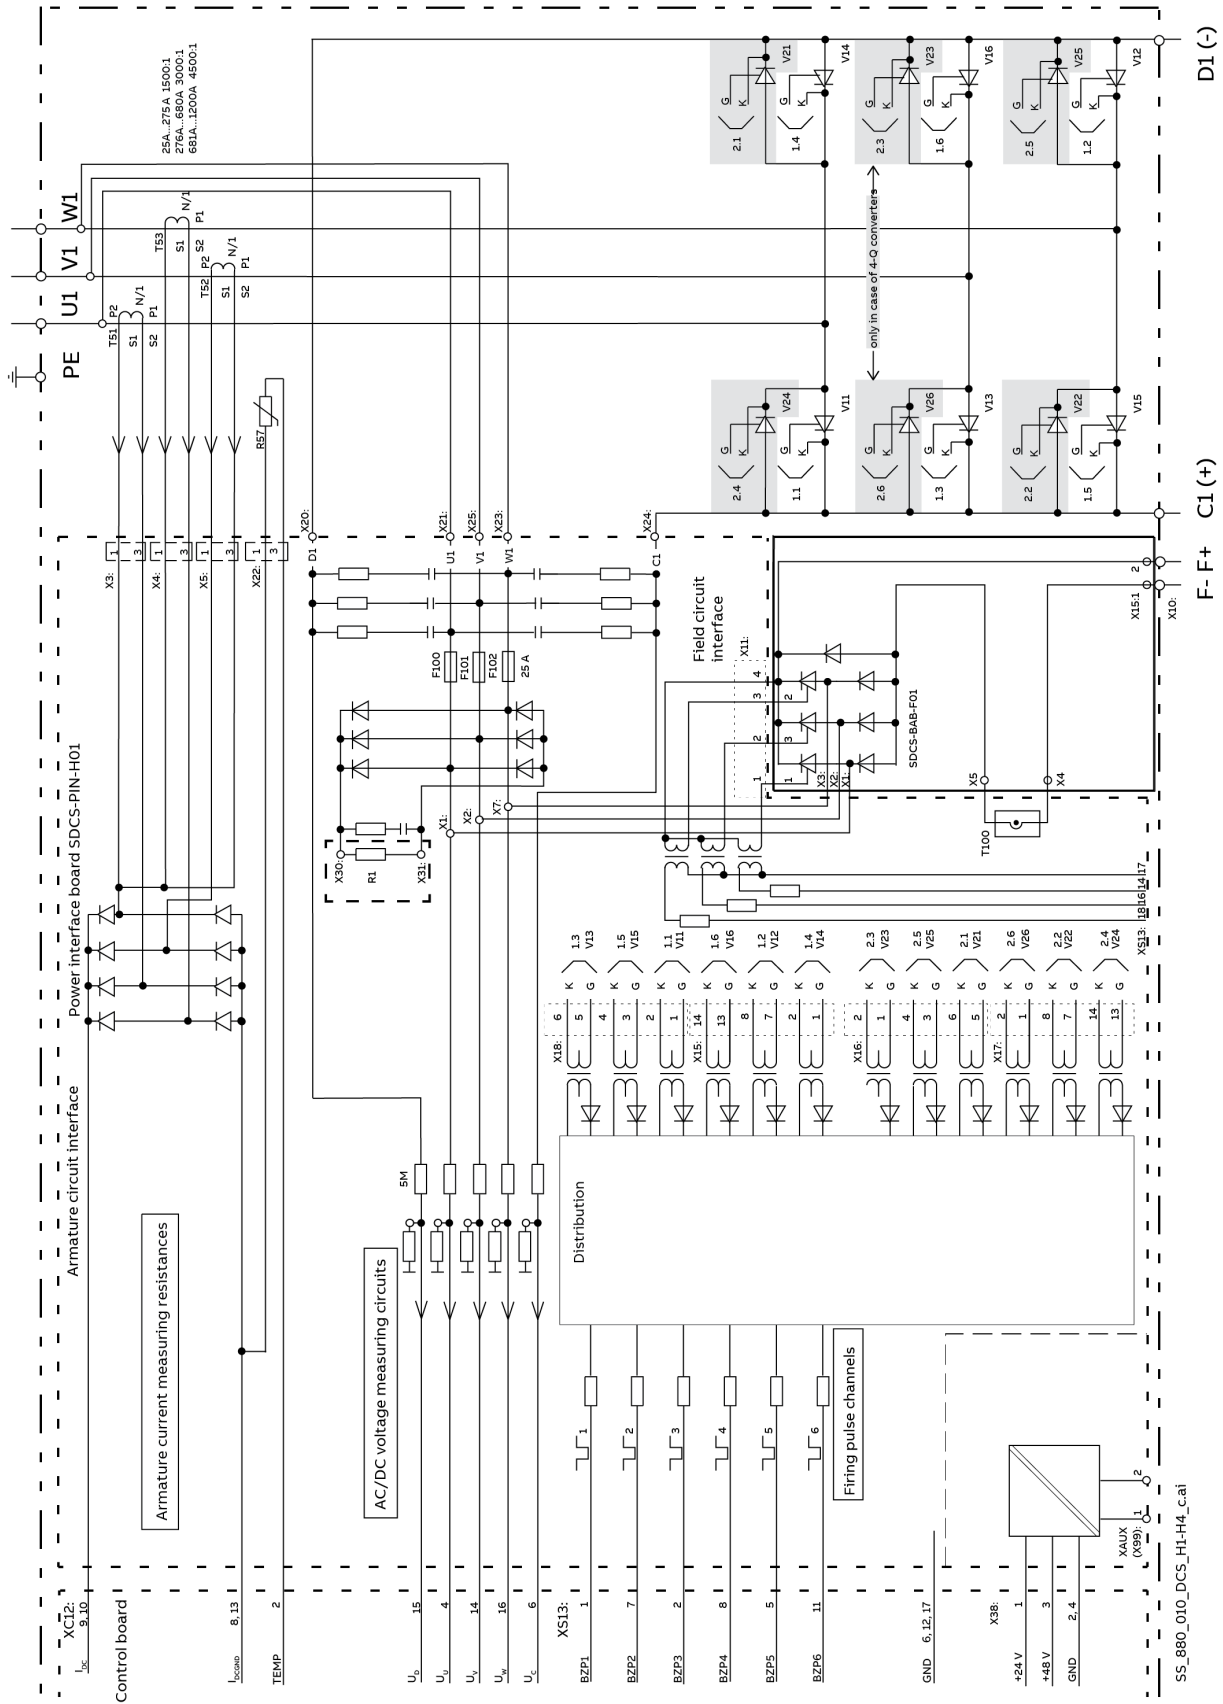

Typical armature circuit diagram for module size H5 using SDCS-PIN-H01:

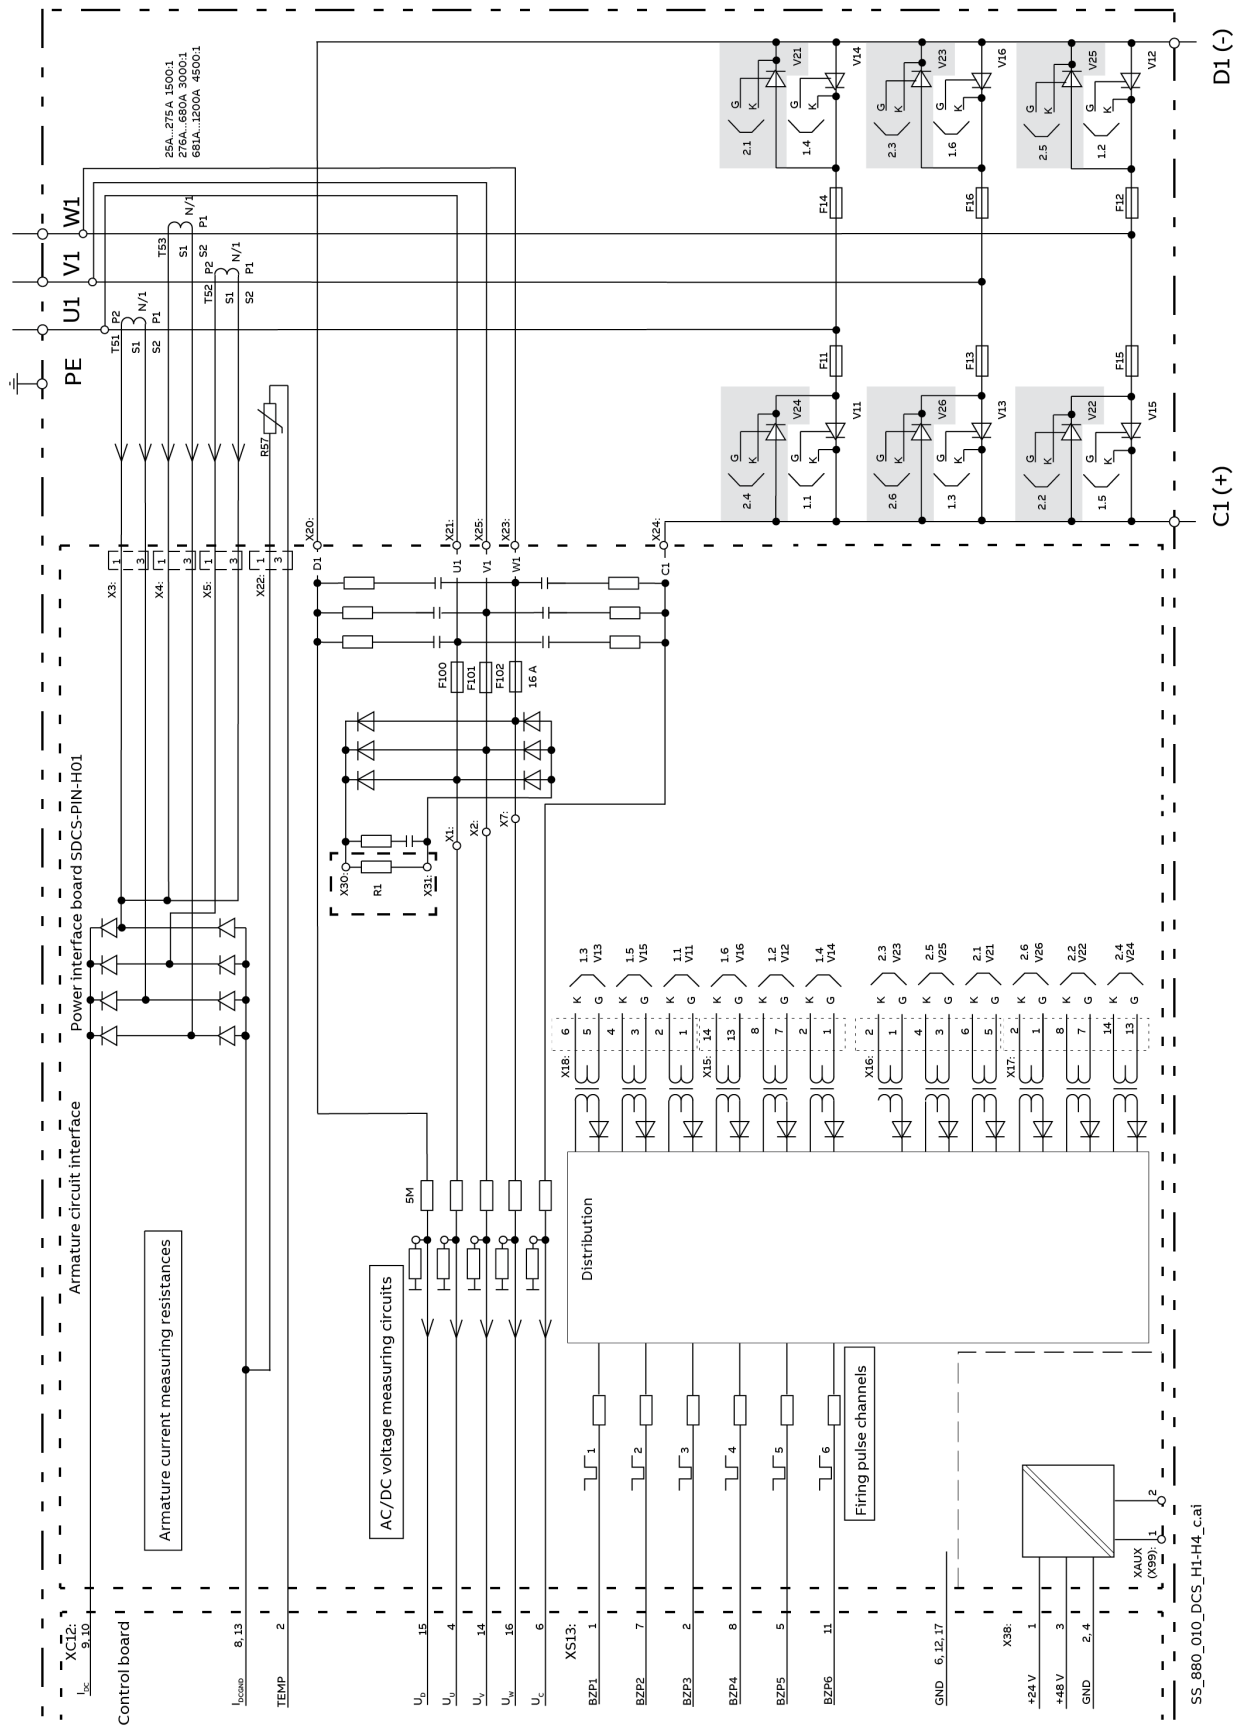

Measuring board SDCS-PIN-H51 (H6 ... H8)

The measuring board is equipped with inputs for current measurement via CTs, high ohmic voltage measurement and an input for a temperature sensor.

Following connectors are available

- Four identical channels for current measurement on the mains side via CTs connected to X231/X232, X241/X242, X251/X252 and X261/X262.

The AC current is rectified by diodes on the measurement board.

The burden resistor is automatically scaled by the type code setting in the firmware for CT ratios of either 1:2500 or 1:4000.

- AC voltage and motor voltage are measured by four different types of inputs.

20 V_{AC} ... 100 V_{AC}: Voltage measurement via X15. For this remove the zero Ohm resistors R221 ... R225. This results in 1.2 MOhm inputs.

100 V_{AC} ... 525 V_{AC}: Voltage measurement via XU2, XV2, XW2, XC2 and XD2 (about 1 MOhm to ground).

526 V_{AC} ... 1000 V_{AC}: Voltage measurement via XU1, XV1, XW1, XC1 and XD1 (about 2 MOhm to ground).

100 V_{AC} ... 1200 V_{AC}: Galvanically isolated voltage measurement via X15. For this DC-DC transducer A92 and transformer T90 have to be used. X15 provides 27.4 kOhm inputs.

- X22 is used for the DCS880 NTC temperature sensor.
- XC12 connection to SDCS-CON-H01 (size H6) or SDCS-OPL-H01 (size H7, H8).

Settings of the SDCS-PIN-H51 for converter sizes H6 ... H8

Current coding

Size	H6				H7				H8					
Current transformer ratio	2500:1				2500:1				4000:1					
Rated current [A _{bc}] ①	900	1200	1500	2000	1900	2050	2500	3000	2050	2600	3300	4000	4800	5200
R101 ... R116	18 Ω													
R117	33 Ω													
R118	68 Ω													
R119	120 Ω													
R120	249 Ω													
R121	560 Ω													

No cutting required.
Automatic current coding via type code setting in the firmware.

① Rated current see the name plate of the converter.

Voltage coding

Mains voltage	20 V _{AC} ... 100 V _{AC}	100 V _{AC} ... 525 V _{AC}	526 V _{AC} ... 1000 V _{AC}	100 V _{AC} ... 1200 V _{AC}
Type code voltages (dd)	04 with +S185 05 with +S185	04 (400 V) 05 (525 V)	06 (600 V) 07 (690 V) 08 (800 V) 10 (990 V)	04 (400 V), 05 (525 V), 06 (600 V), 07 (690 V), 08 (800 V), 10 (990 V), 12 (1200 V)
Used connectors	X15 with removed zero-ohm resistors R221 ... R225 (cut out)	XU2, XV2, XW2, XC2, XD2	XU1, XV1, XW1, XC1, XD1	X15 with DC-DC transducer A92 and transformer T90
Parameter settings 95.28 Set: Drive AC voltage scaling	120 V	0 V	0 V	0 V

Switches

Leave switch J1 on separated (default).

Location of the SDCS-CON-H01



Size H6:

- The board is located inside the module.

Module sizes H7 and H8 consist of a control unit and a power unit:

- The board is located inside the power unit.

Layout of the SDCS-PIN-H51

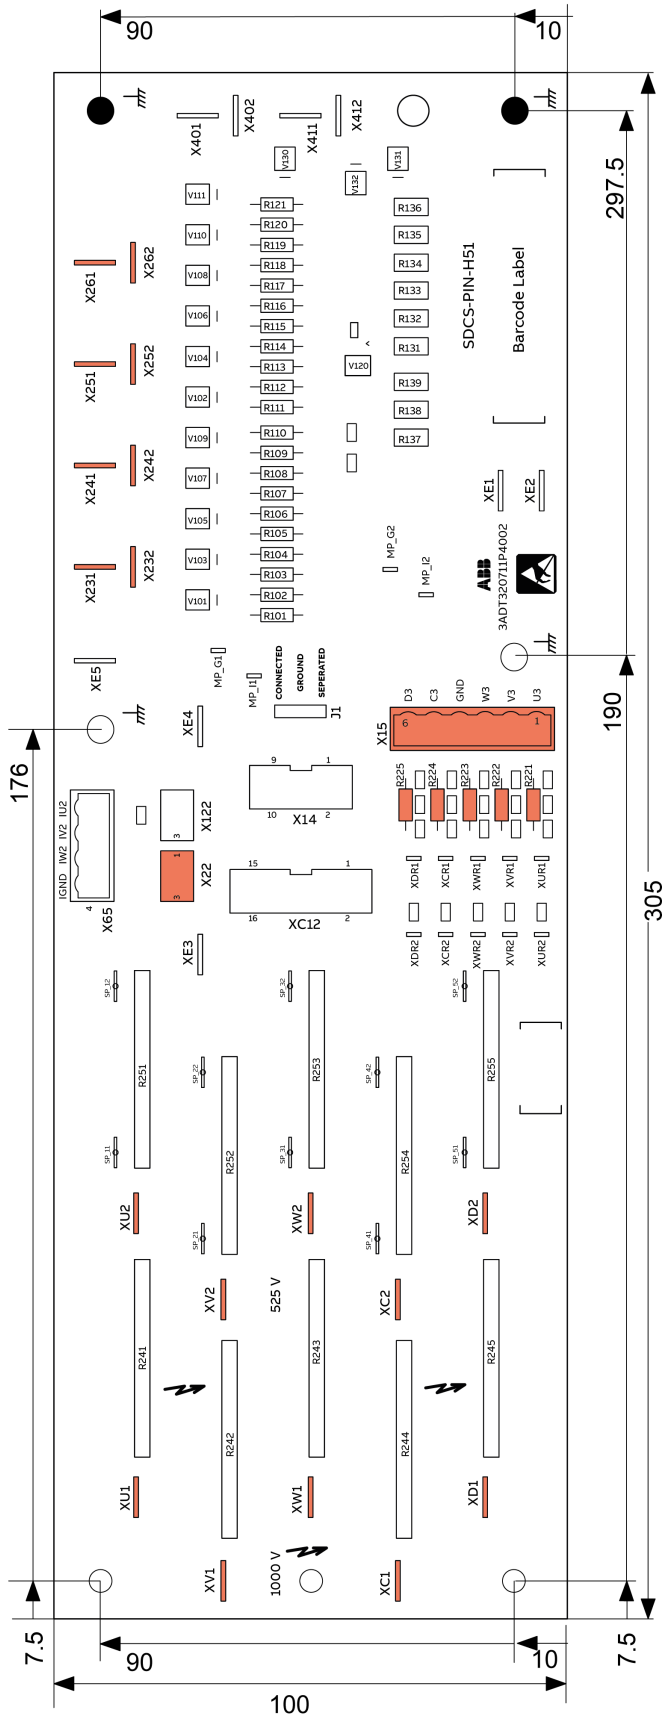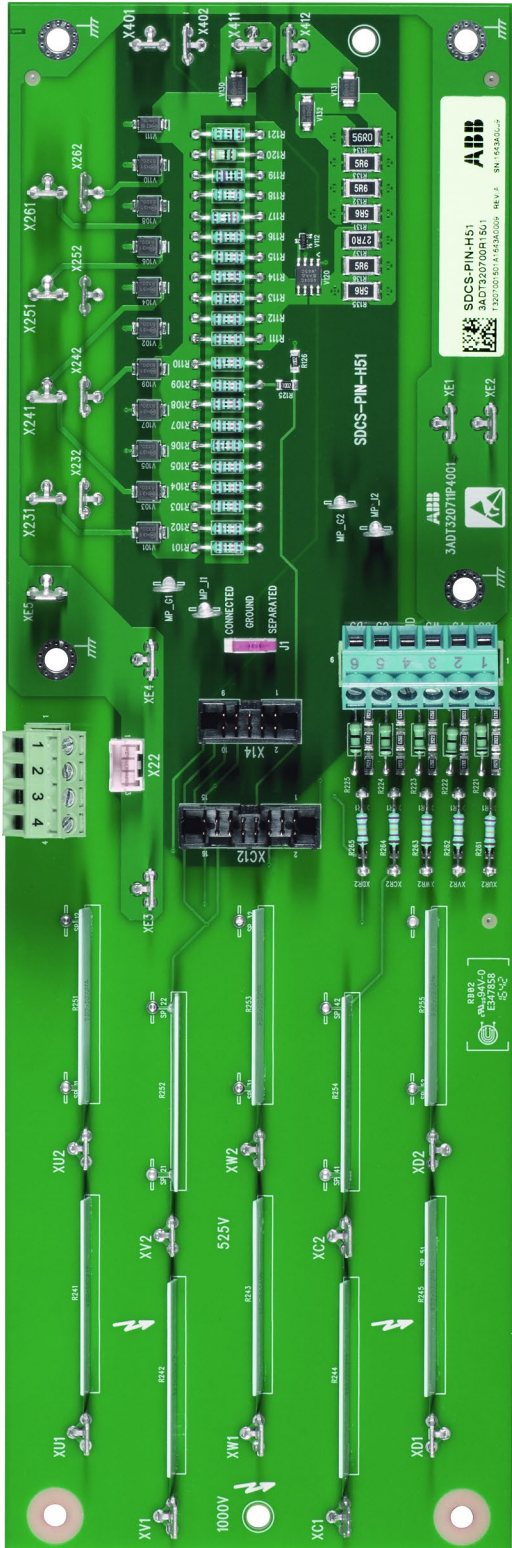

BL_PIN-H51_001_b.ai

Firing pulse transformer board SDCS-PIN-H41 (H6 ... H8)

The interface to the power part of the converter modules size H6 ... H8 from 900 A ... 5200 A consists of one or two firing pulse transformer boards SDCS-PIN-H41.

Single bridge converters (2-Q) are equipped with one board. Converters with 2 anti-parallel bridges (4-Q) require two boards.

Location of the SDCS-PIN-H41


Size H6:

- The board is located inside the converter module.


Module sizes H7 and H8 consist of a control unit and a power unit:

- The board is located inside the power unit.

Layout of the SDCS-PIN-H41

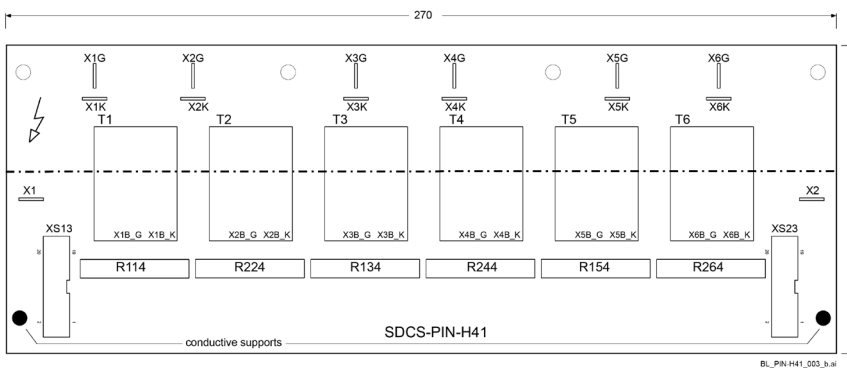

The board consists of six firing pulse transformers with amplifiers.

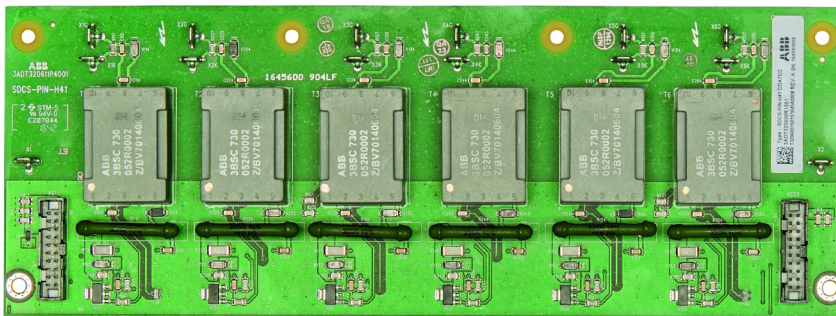

Optical power link board SDCS-OPL-H01 (H7, H8)

Module sizes H7 and H8 consist of a control unit and a power unit. The board provides the interface between control unit and power unit using fiber optic cables.

Following connectors are available

Fiber optic connectors V1, V2 connect the SDCS-CON-H01 via SDCS-DSL-H1x for control.

Fiber optic connectors V11, V12 connect the SDCS-CON-H01 via SDCD-DSL-H1x for Safe Torque Off (STO).

Maximum length of the plastic optic fiber cable is 5 m.

Connector X4 is a connection point for a scope to measure the armature current directly over the burden resistor.

X4 Current measurement

1	IACT	Connection point for a scope. Scaling see 13.80 Scaling of fixed current output.
2	-	-
3	-	-
4	GND1	Common ground (connected to frame)

SA_880_013_OPL_b.ai





Connector XC12 connects the SDCS-PIN-H51.

Connector XS13 connects the SDCS-PIN-H41.

Connector X38 connects the SDCS-POW-H01.

Connector XSMC (X96) connects the mains connector and must be used. XSMC on the control unit is not allowed due to Safe Torque Off (STO).

XSMC (X96) Mains contactor

1	MCCOM		250 V _{AC} / 30 V _{DC}	Fixed output for the mains contactor
2	MCNO		2 A	
3	STOCOM		250 V _{AC} / 30 V _{DC}	Fixed output for safe torque off (STO) zero current monitor
4	STONO		2 A	

SA_880_013_OPL_b.ai



XSMC: Mains contactor

MCCOM	Fixed output for the mains contactor.
MCNO	250 V _{AC} /30 V _{DC} , 2 A. Maximum wire size 2.5 mm ² . Varistor protected. Mains contactor ON command: 06.24.b07 Current controller status word 1
STOCOM	Fixed output for safe torque off (STO) zero current monitor.
STONO	250 V _{AC} /30 V _{DC} , 2 A. Maximum wire size 2.5 mm ² . Varistor protected.
	(STO) zero current monitor: 31.99.b09 STO fault diagnostic

Location of the SDCS-OPL-H01

The board is located inside the power unit.

Layout of the SDCS-OPL-H01

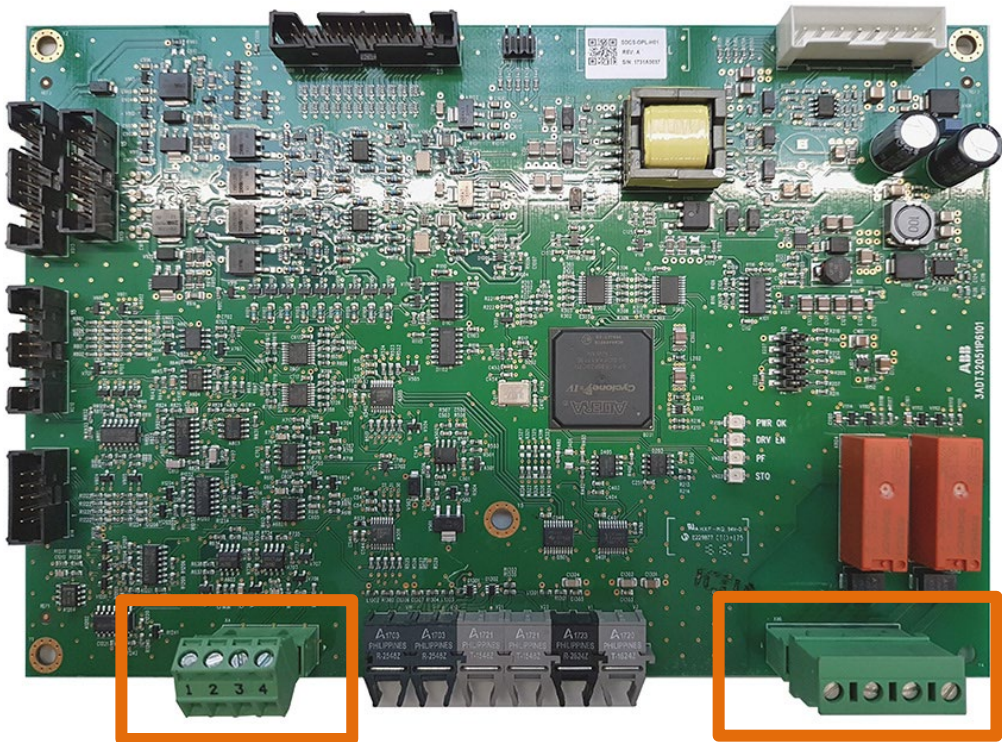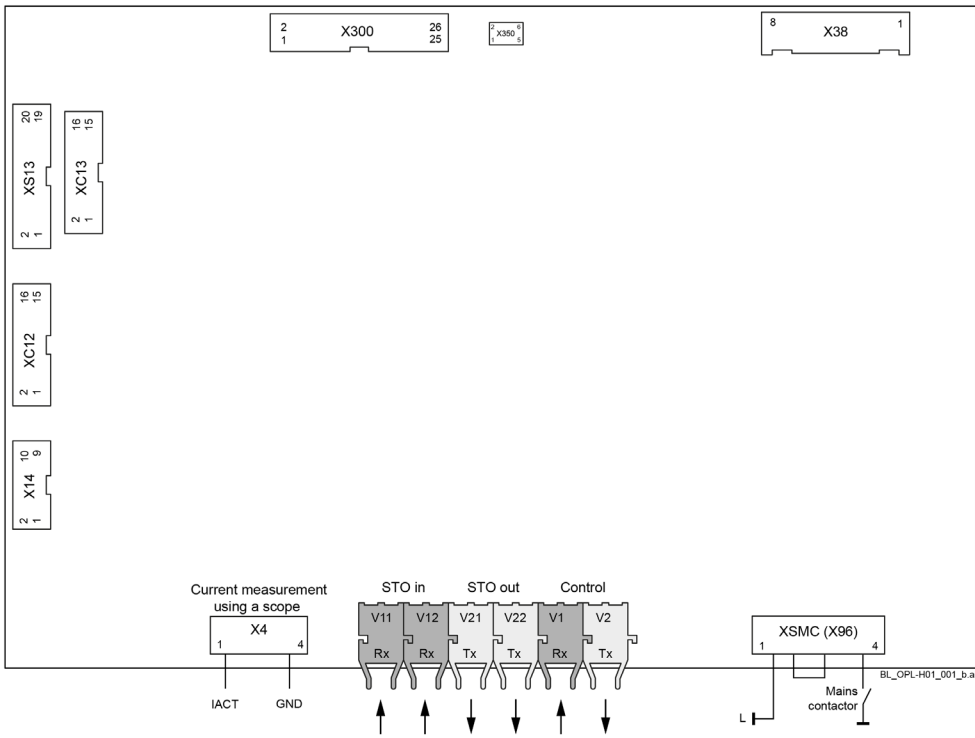


Current measurement via scope


Mains contactor

Connection between firing board and control board for H6 ... H8


2-Q, size H6

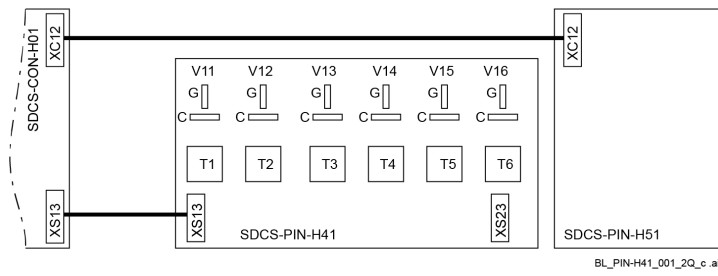


4-Q, size H6

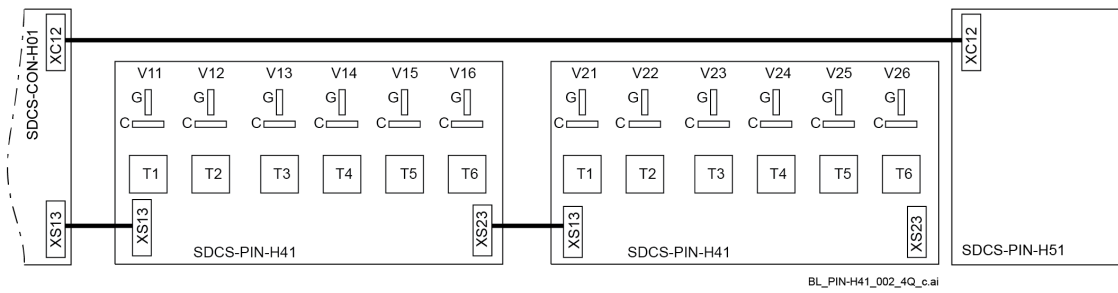

2-Q, sizes H7 and H8

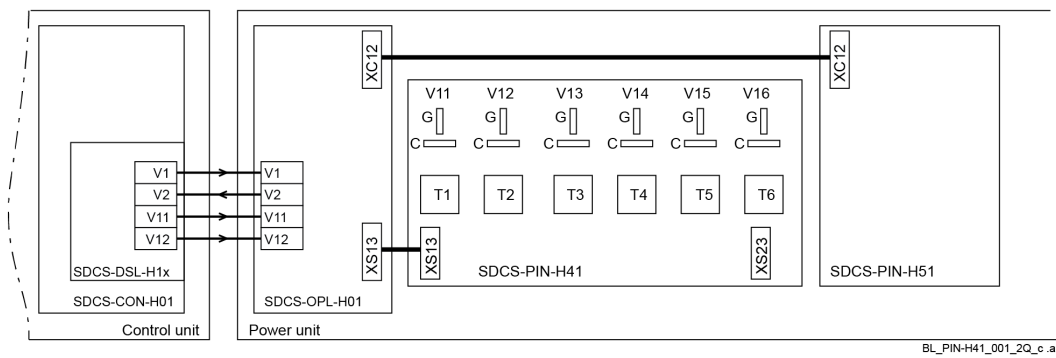


4-Q, sizes H7 and H8

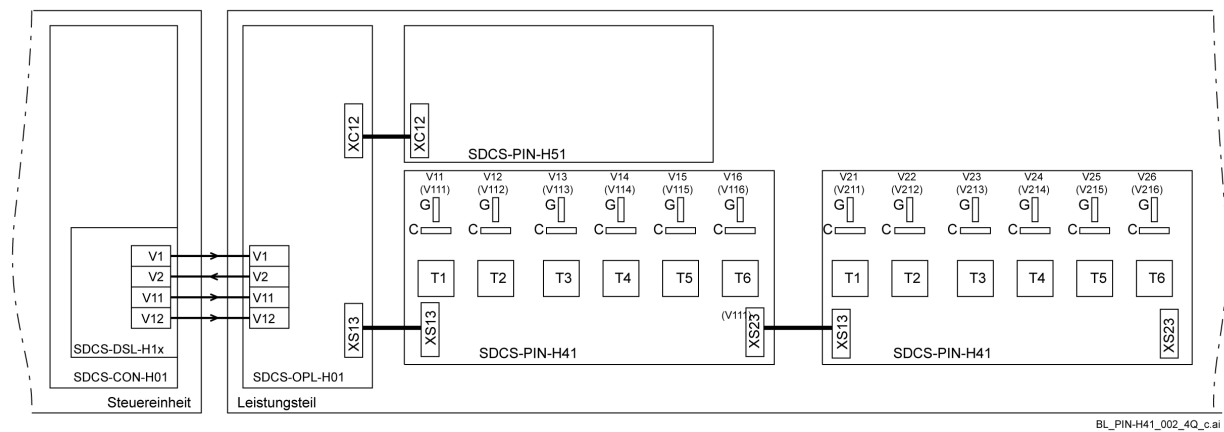


Circuit diagrams

Typical armature circuit diagram for module size H6 with SDCS-PIN-H51 and SDCS-PIN-H41:

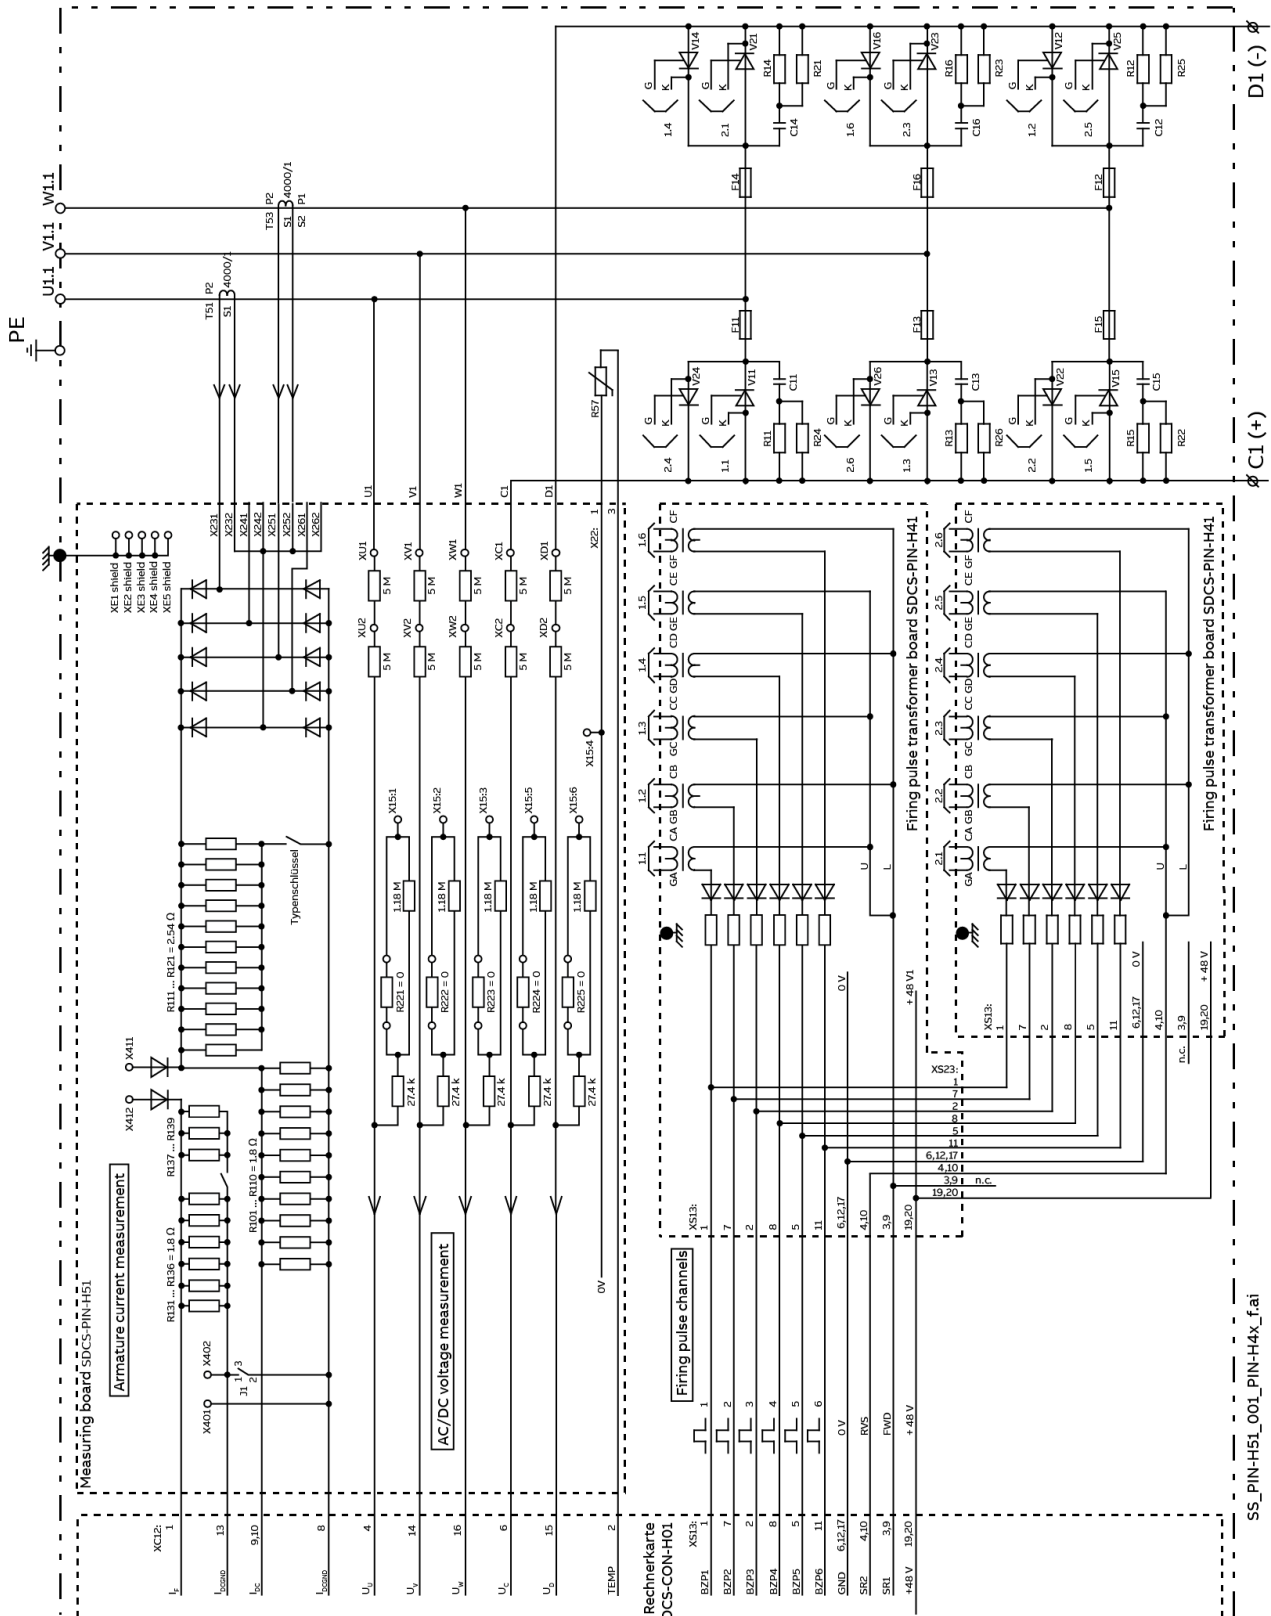

Typical armature circuit diagram for module sizes H7 and H8 with SDCS-PIN-H51 and SDCS-PIN-H41:

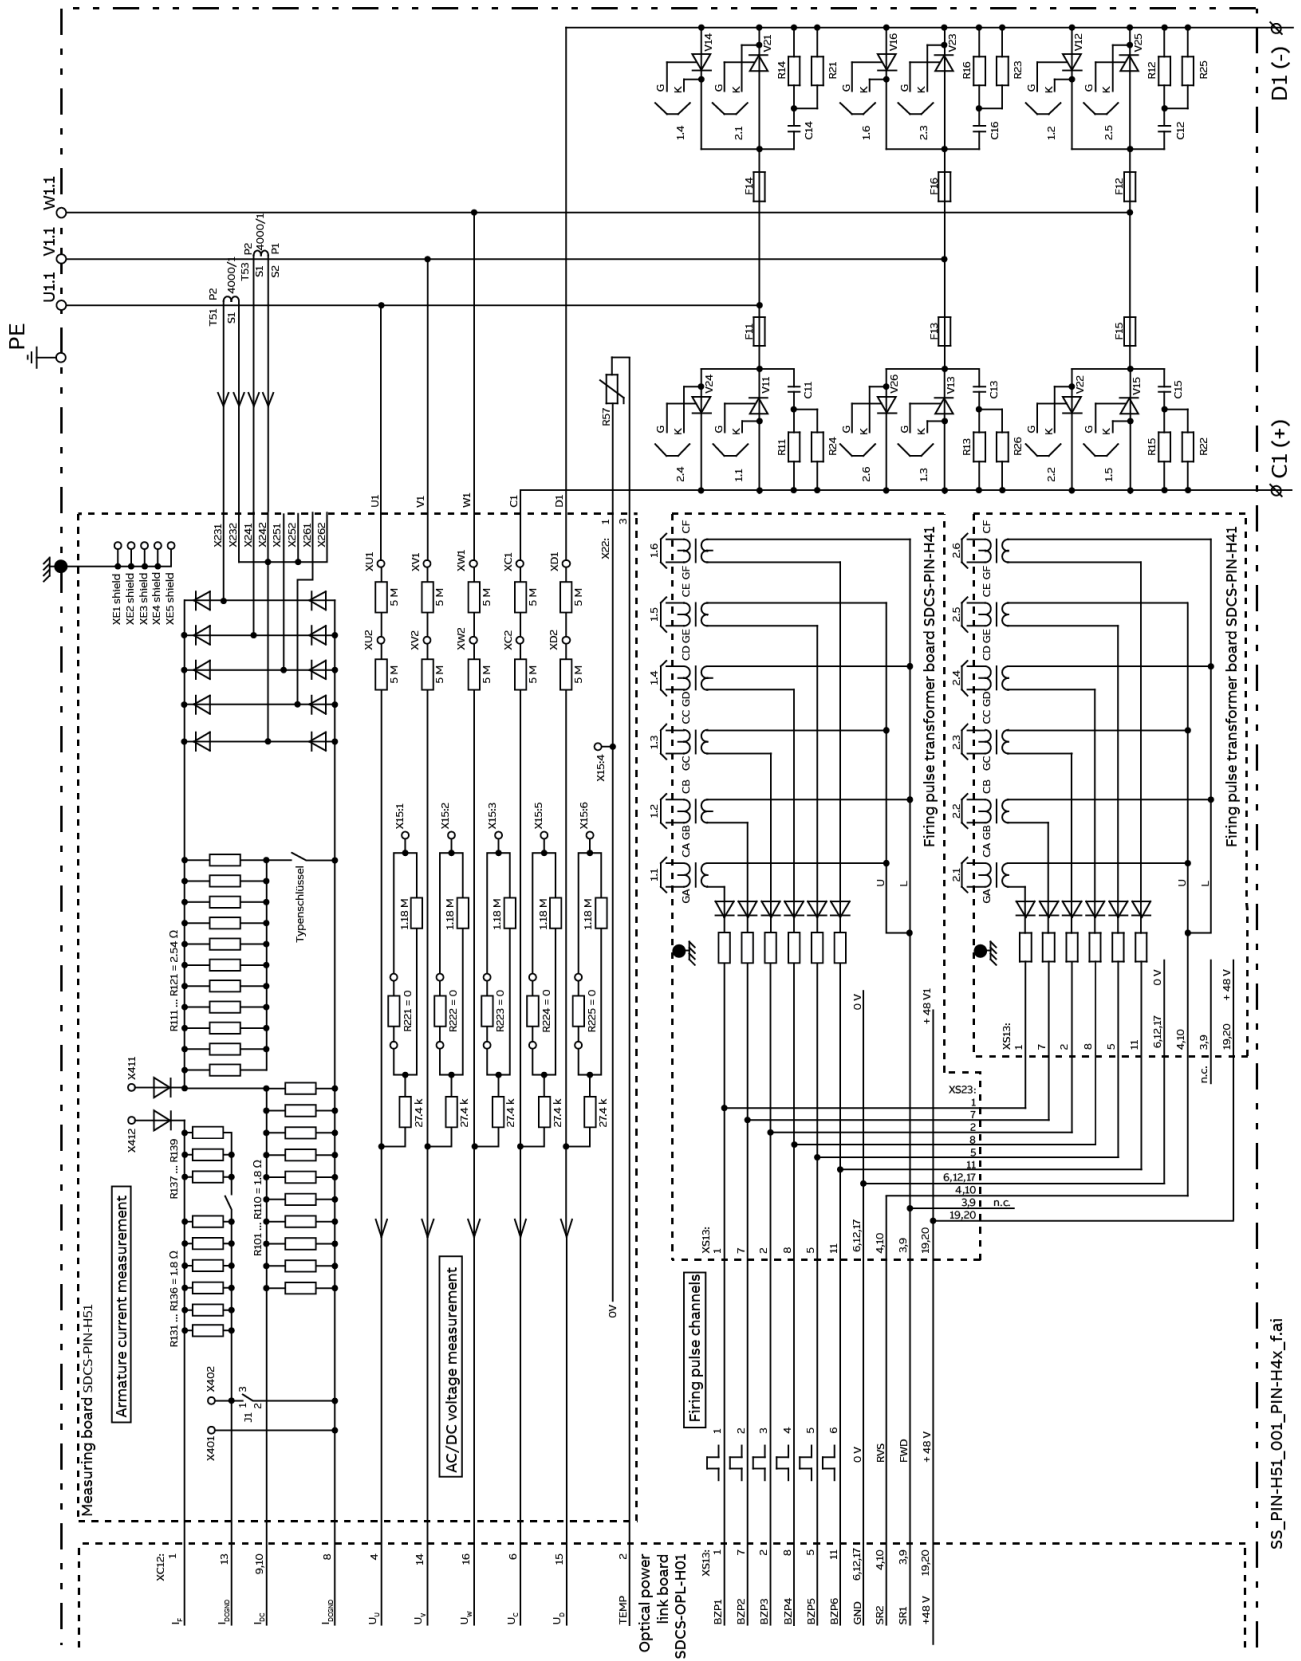

Galvanic isolation - T90, A92, F11, F90


The Galvanic isolation is an option for converters size H6 ... H8 and rated voltages ≤ 1000 V.

For converters with a rated AC voltage of > 1000 V or 12-pulse serial $> 2 \times 500$ V galvanic isolation must be used.

It is used to replace the high-ohmic voltage measurement and gives the advantage of a total isolation between power part and drive electronics.


The transformer T90 and the DC-DC transducer A92 are located outside the converter module. The internal AC and DC voltage measurement channels are removed and connected to T90 and A92.

DC-DC transducer A92



P42000D3-0111
(3ADN260008P0001) or
P42001D3
(3ADV050096P0007)

Transformer T90



3ADT745047P0001

SDCS-PIN-H51



Hardware and firmware settings


Voltage coding						
Size	H6/H7/H8					
Con. nom. voltage [V] U1 [V _{AC}] ①	c = 4 (400 V) c = 5 (500 V)	c = 6 (600 V)	c = 7 (690 V)	c = 8 (800 V)	c = 10 (1000 V)	c = 12 (1200 V)
Rated mains voltage [V _{AC}]	100 ... 525	270 ... 600	315 ... 690	360 ... 800	450 ... 1000	540 ... 1200
Voltage measurement scaled by type code or parameter (95.28)	500	600	690	800	1000	1200
Measuring board	SDCS-PIN-H01 use connector X15					

Galvanic isolation						
Fuse F11	1500 V, 5 A					
DC-DC transducer A92 (1)	P42000D3-0111 (3ADN260008P0001)					
Switch position R _G	0 (675 V)	1 (810 V)	2 (945 V)	3 (1080 V)	5 (1350 V)	6 (1620 V)
DC-DC transducer A92 (2)	P42001D3 (3ADV050096P0007)					
Switch position R _G	-	-	-	-	A (1400 V)	B (1600 V)
Fuse F90	1000 V, 10 A					
Transformer T90	3ADT745047P0001					
Secondary Terminals	2U1 2V1 2W1 2N	2U2 2V2 2W2 2N	2U3 2V3 2W3 2N	2U4 2V4 2W4 2N	2U5 2V5 2W5 2N	2U6 2V6 2W6 2N

① Rated voltage see the name plate of the converter.


For 12-pulse configurations consult the [DCS880 12-pulse manual](#).

Typical armature circuit diagram for module sizes H6 ... H8 with SDCS-PIN-H51, SDCS-PIN-H41 and galvanic isolation:

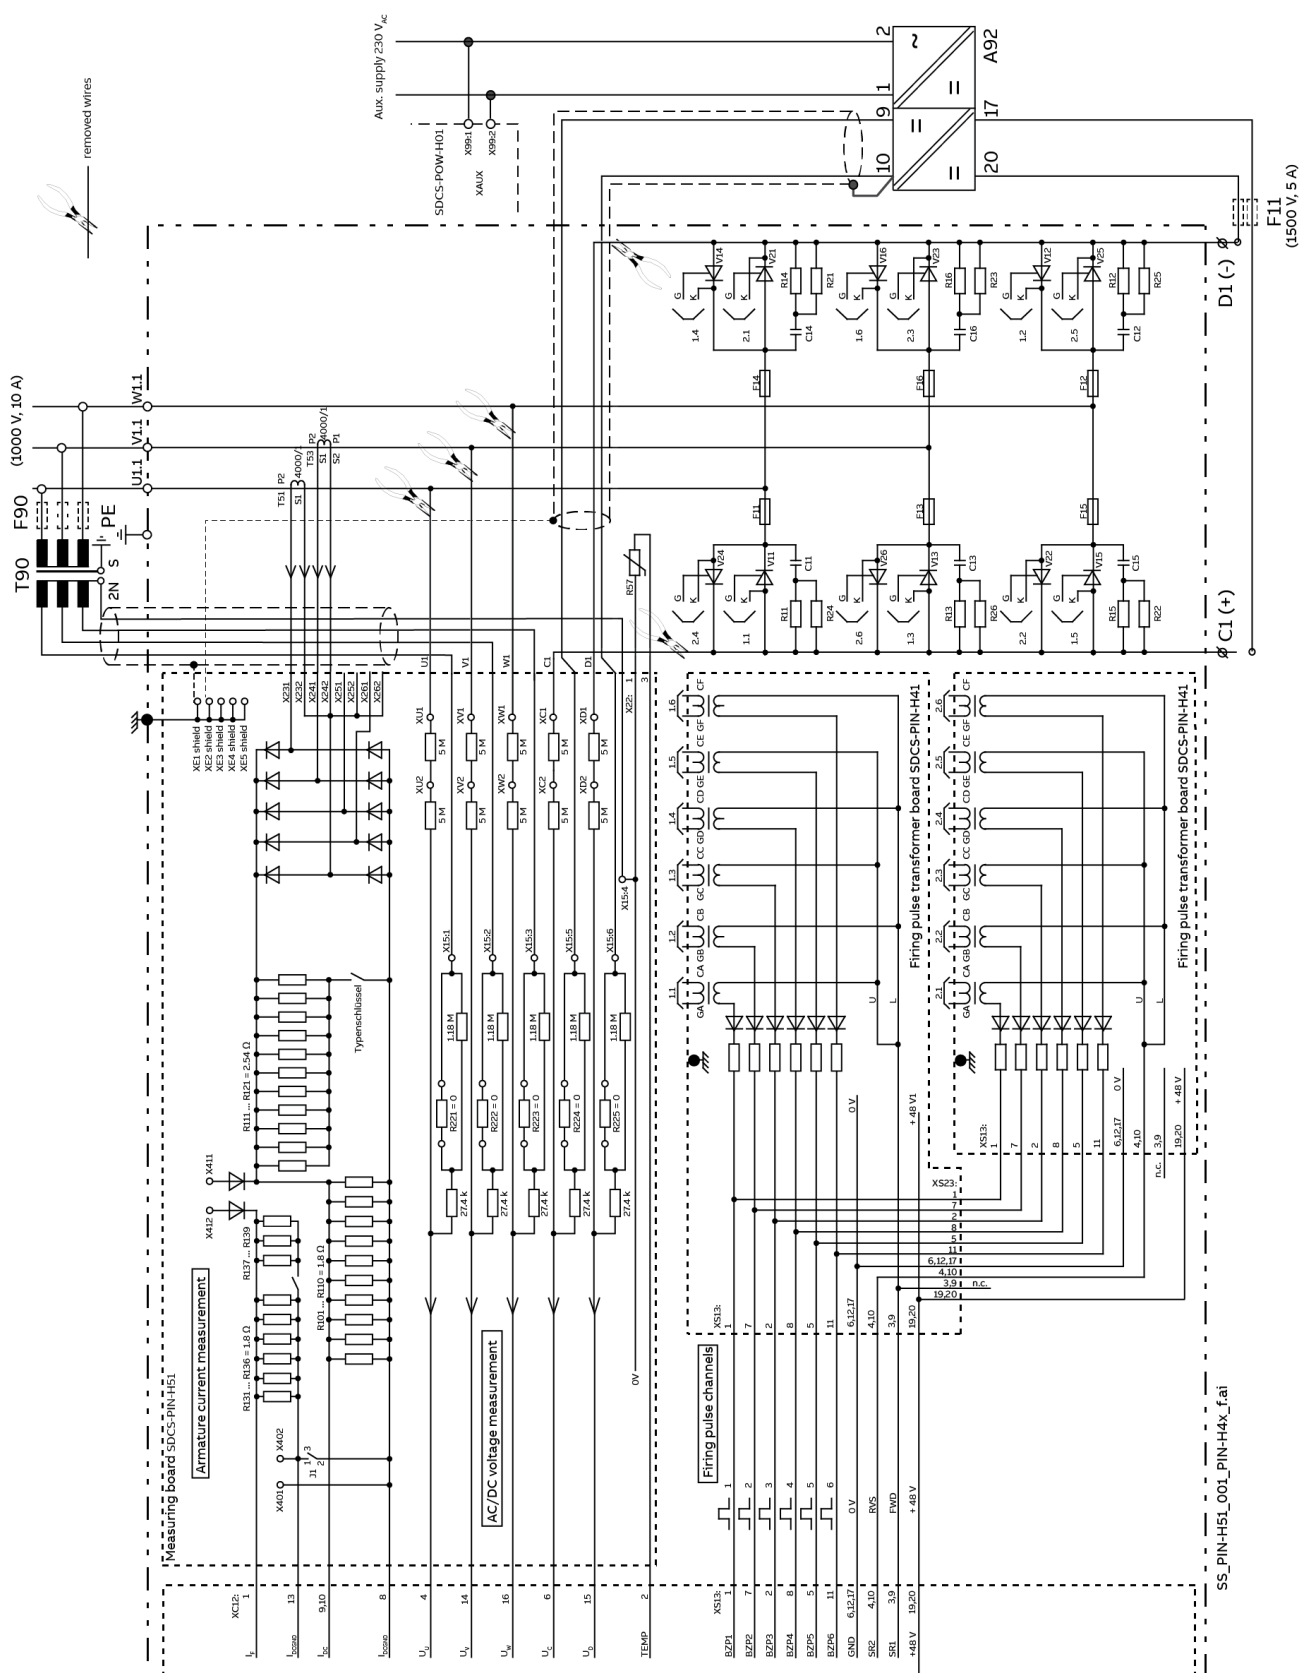

DC-DC transducer A92 (1)


Principle circuit diagram of the DC-DC transducer A92 (1)

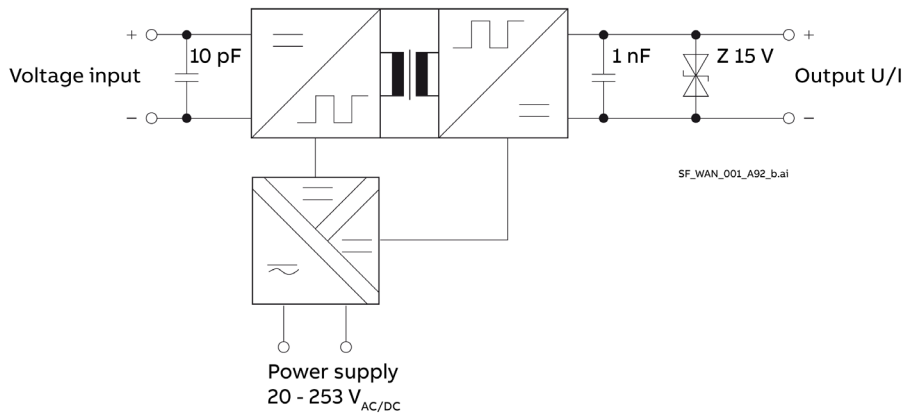

Data

Selectable voltage gains	675	810	945	1080	1350	1620	V _{DC}
Switch position	0	1	2	3	5	6	-

- Output voltage: 20 mA; ±10 V; 4 ... 20 mA
- Auxiliary power: 20 ... 253 V_{AC/DC}; 50/60 Hz; 3 W
- Clearance in air: Auxiliary power to Output: > 13 mm
Input/Output to Auxiliary power: > 14 mm
- Insulation voltage: 2200 V
- Insulation test voltage 10 kV_{AC}
- Ambient temperature range: -10 ... +70°C
- Weight: appr. 500 g




(P42000D3-0111)


Voltage gain and frequency response is especially designed for DCS880 converters.

Dimensions in mm

- Terminal assignments:
- 15 Voltage input -
- 23 Voltage input + (≤ 3600 V)
- 27 Power supply AC/DC
- 28 Power supply AC/DC
- 37 Current output +
- 38 Voltage output +
- 39 Current output -
- 40 Voltage output -

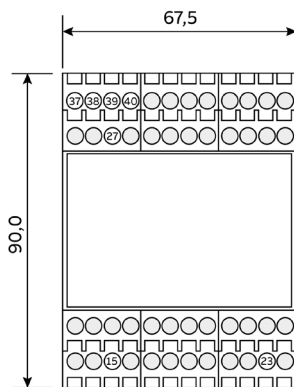


BE_KLE_001_a.ai

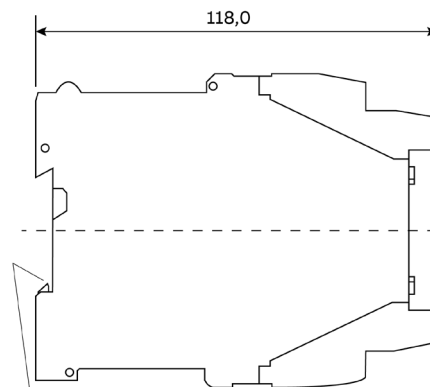

Snap-on mounting for 35 mm top-hat rail
DIN EN 50 022

Transformer T90

Principle diagram of the transformer T90

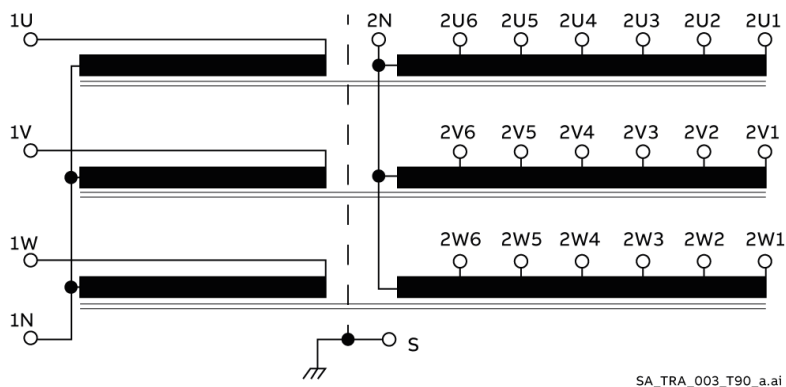

SA_TRA_003_T90_a.ai



(3ADT745047)

Data

Selectable transfer ratios, U_{prim} : 500, 600, 690, 800, 1000, 1200 V_{AC} rms

Output voltage: 7.3 V_{AC} rms


Insulation voltage: 1200 V

Isolation test voltage: 3500 V

Ambient temperature range: -10 ... +70 °C


Weight: 2.1 kg

Dimensions in mm

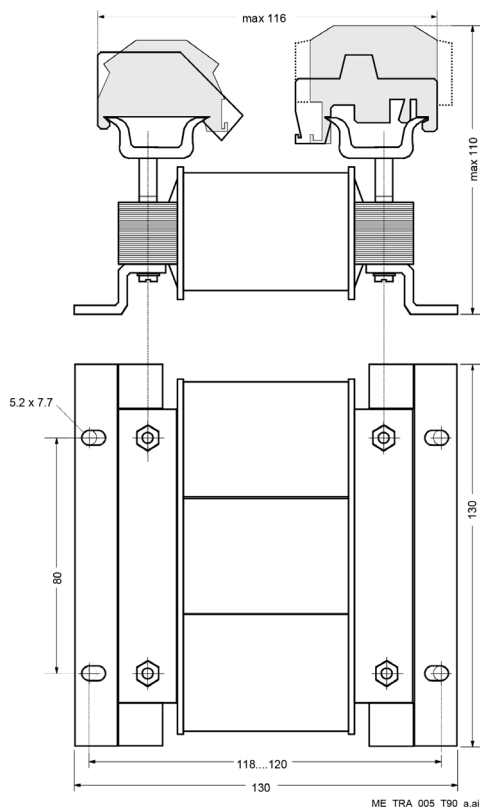

Note: The terminals on the primary side of the transformer are a special lug terminal design.

Handling hints: First turn the screw counterclockwise to the end stop, then swing out the shrouding cover. Put in the cable lug, swing in the shrouding cover, and fasten the connection by turning the screw clockwise.





Dimensions and weights

See the dimensional drawings of the DCS880 below. The dimensions are in millimeters.

Size	h x w x d [mm]	h x w x d [inch]	weight [kg]	weight [lbs]
H1	370 x 270 x 215	14.56 x 10.63 x 8.46	11	25
H2	370 x 270 x 271	14.56 x 10.63 x 10.67	16	36
H3	460 x 270 x 317	18.11 x 10.63 x 12.48	25	56
H4	645 x 270 x 352	25.39 x 10.63 x 13.86	38	84
H5	750 x 270 x 372	29.53 x 10.63 x 14.65	55	122
H6 (classic fan box)	944 x 510 x 410	37.17 x 20.10 x 16.15	110	243
H6 (ErP fan box)	979 x 510 x 410	38.55 x 20.10 x 16.15	110	243
H7	1750 x 460 x 410	68.90 x 18.11 x 16.14	180	397
H8	1750 x 760 x 570	68.90 x 29.92 x 22.44	315	695

Size H1



DCS880-S01-0020	DCS880-S02-0025
DCS880-S01-0045	DCS880-S02-0050
DCS880-S01-0065	DCS880-S02-0075
DCS880-S01-0090	DCS880-S02-0100

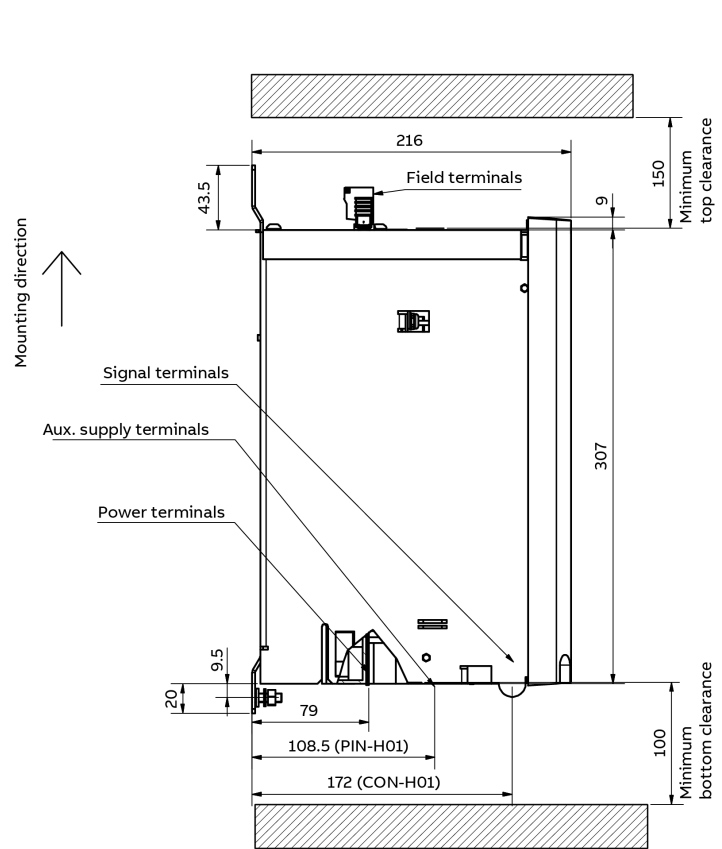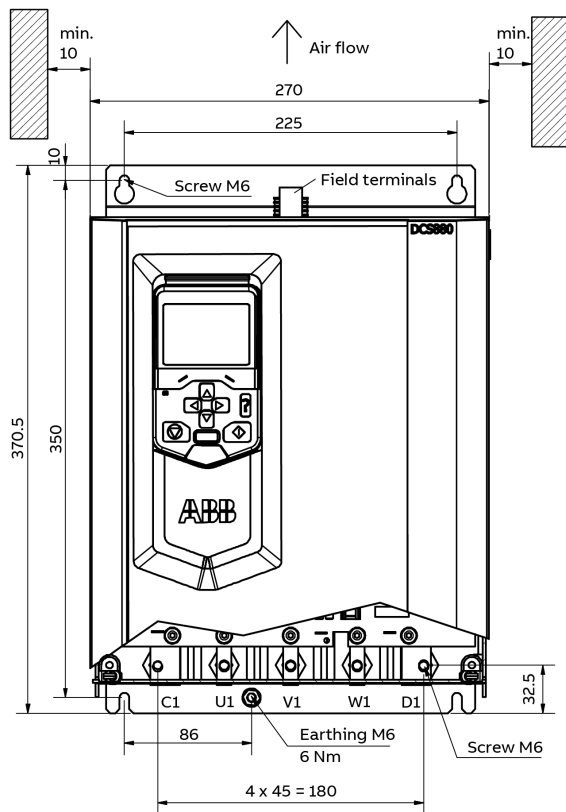

MG_880_001_H1_b.ai

Size H2

DCS880-S01-0135	DCS880-S02-0150
DCS880-S01-0180	DCS880-S02-0200
DCS880-S01-0225	DCS880-S02-0250
DCS880-S01-0270	DCS880-S02-0300

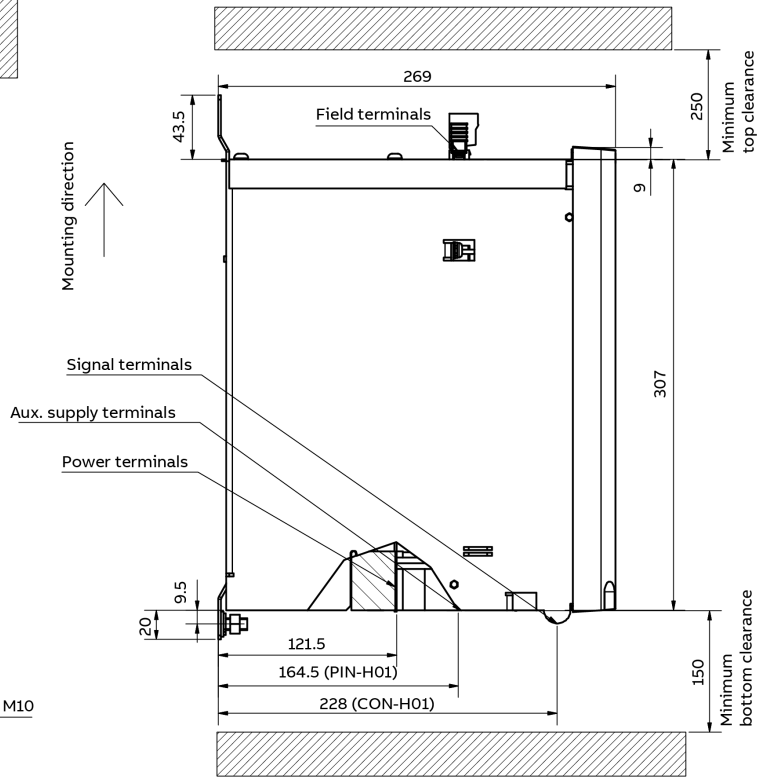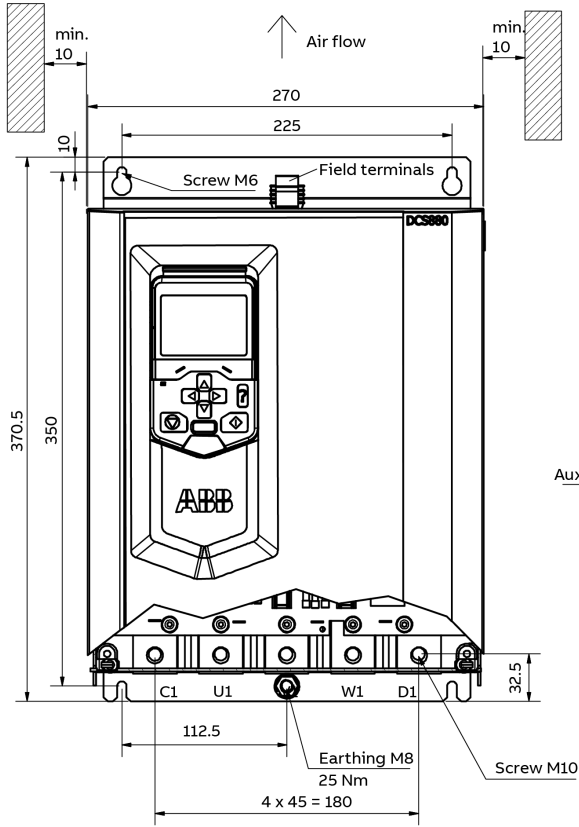



MG_880_002_H2_b.a1

Size H3

DCS880-S01-0315	DCS880-S02-0350
DCS880-S01-0405	DCS880-S02-0450
DCS880-S01-0470	DCS880-S02-0520

600 V Units

DCS880-S01-0290	DCS880-S02-0320
-----------------	-----------------

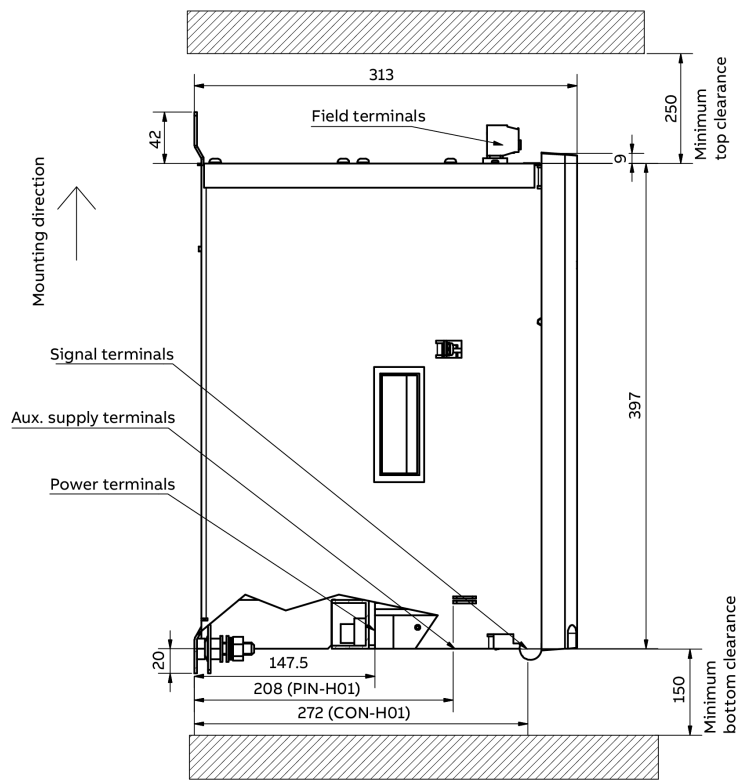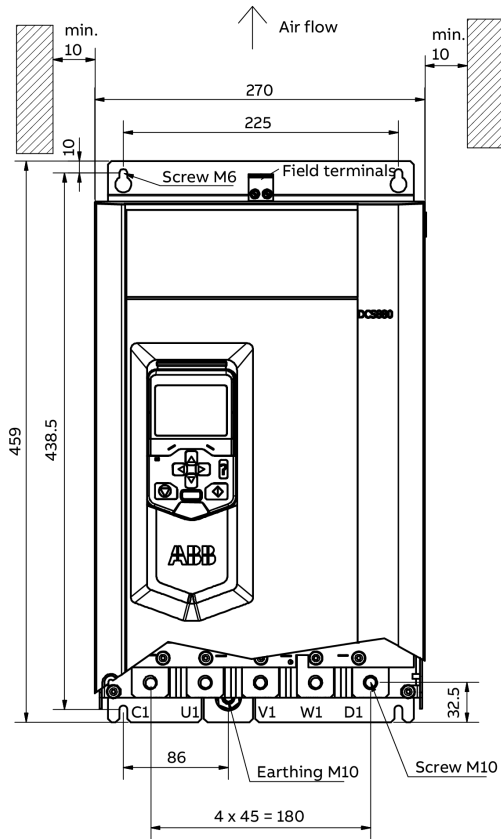



MG_880_003_H3_b.ai

Size H4

DCS880-S01-0610	DCS880-S02-0680
DCS880-S01-0740	DCS880-S02-0820
DCS880-S01-0900	DCS880-S02-1000

600 V Units


DCS880-S01-0590	DCS880-S02-0650
-----------------	-----------------

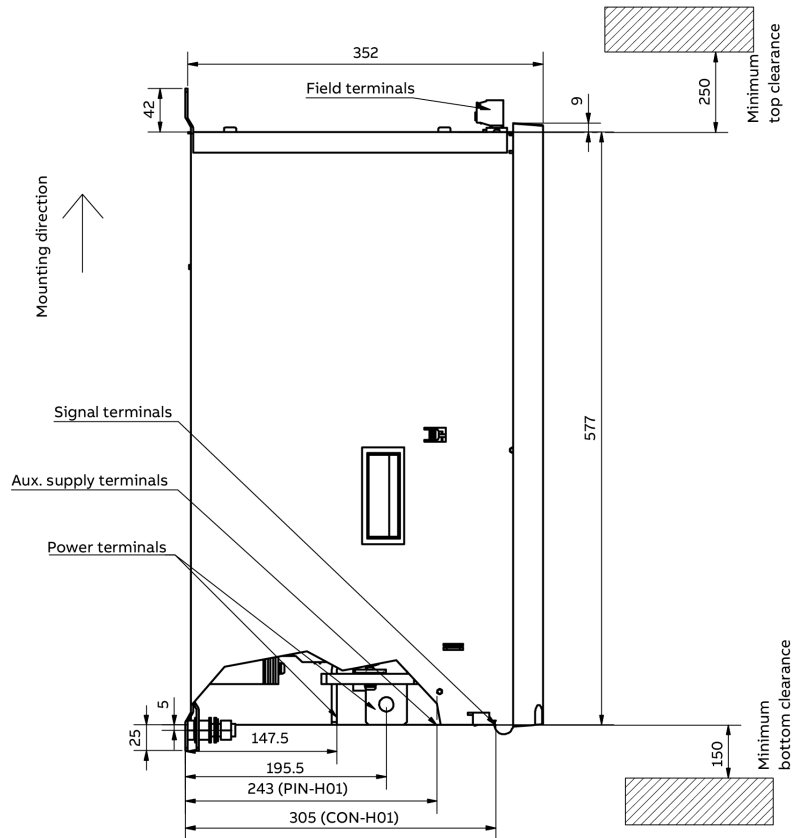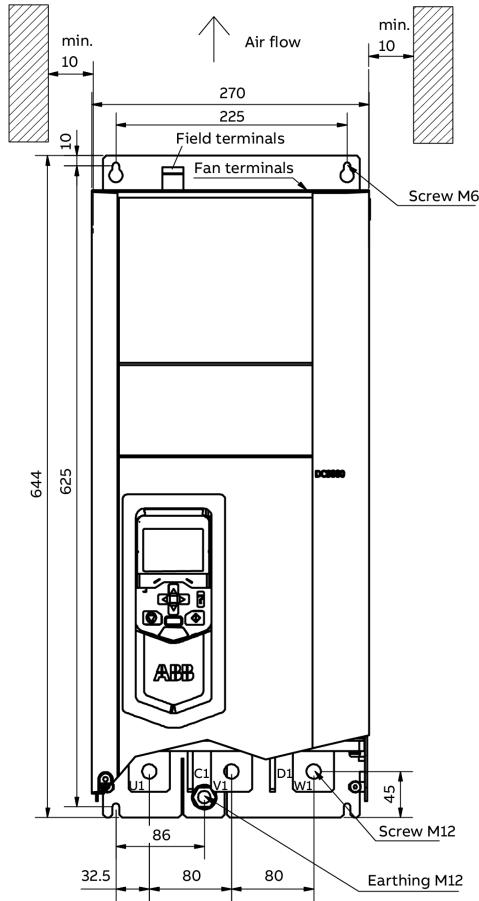


MG_880_004_H4_a.ai

Size H5

DCS880-S01-1190	DCS880-S02-1190
-----------------	-----------------

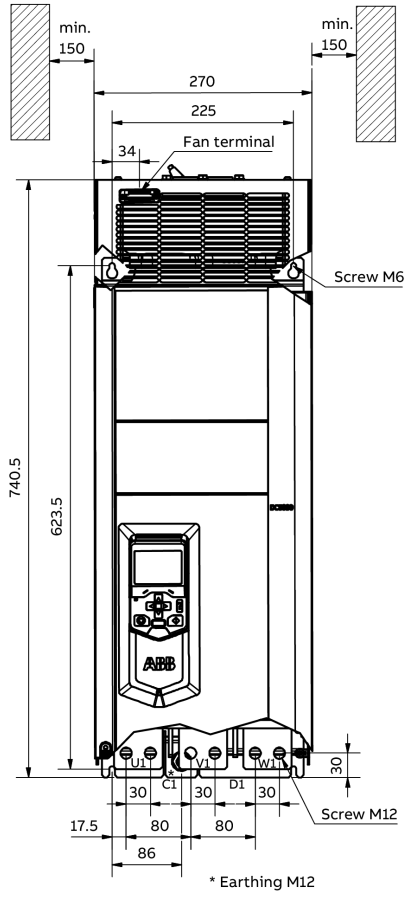


Mounting direction ↑

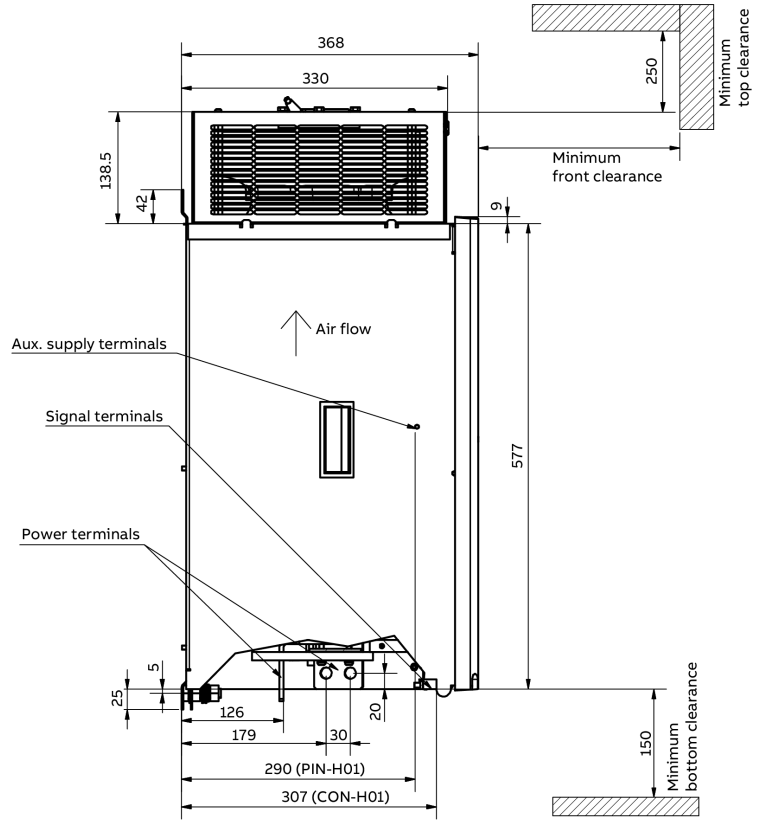

MG_880_005_H5_c.ai

Size H6 (classic fan box)

DCS880-S0b-0900-0dX0	Busbars in mm: DC: 80 x 10 AC: 60 x 5
DCS880-S0b-1200-0dX0	
DCS880-S0b-1500-0dX0	
DCS880-S0b-2000-0dX0	

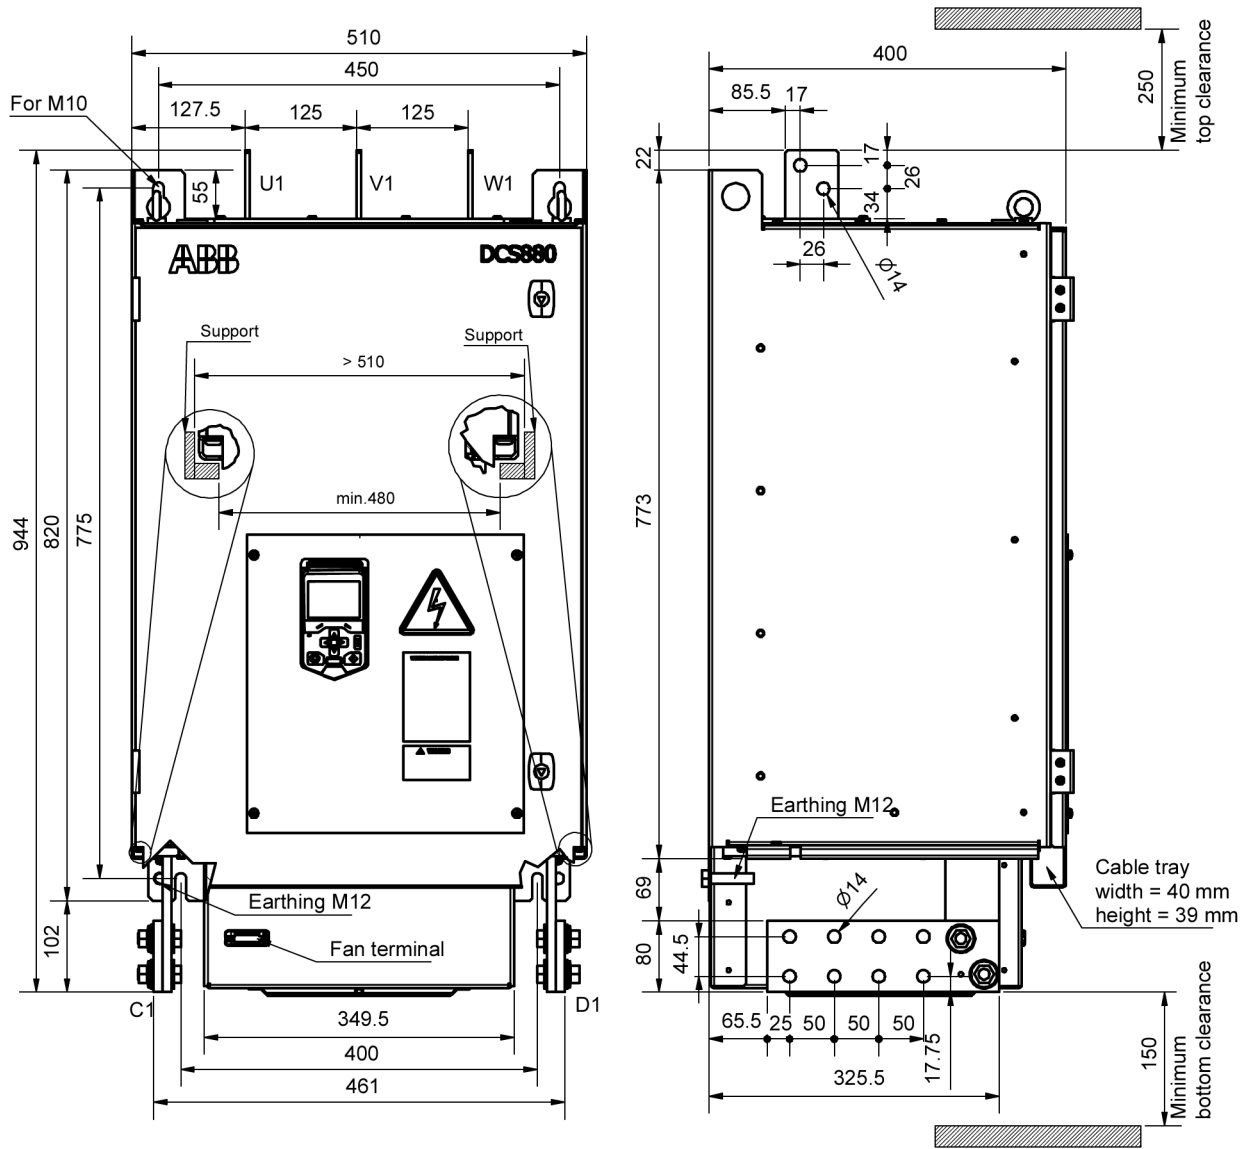

Mounting the module size H6 inside a cabinet


Two supports should be mounted inside the cabinet in such a way, that they can carry the module's weight. The minimum distance between the supports should not be less than 480 mm because of electrical clearance (DC busbars).

An L-shape support as indicated will allow to place the converter temporarily close to the front end of the support (weight still taken by a lifting device) and then push it back to the back plate of the cabinet. The upper and lower holes in the back plate of the converter should be used to fix the converter in that position.

Size H6 (ErP fan box)

DCS880-S0b-0900-0dX0
DCS880-S0b-1200-0dX0
DCS880-S0b-1500-0dX0
DCS880-S0b-2000-0dX0

Busbars in mm:
DC: 80 x 10
AC: 60 x 5

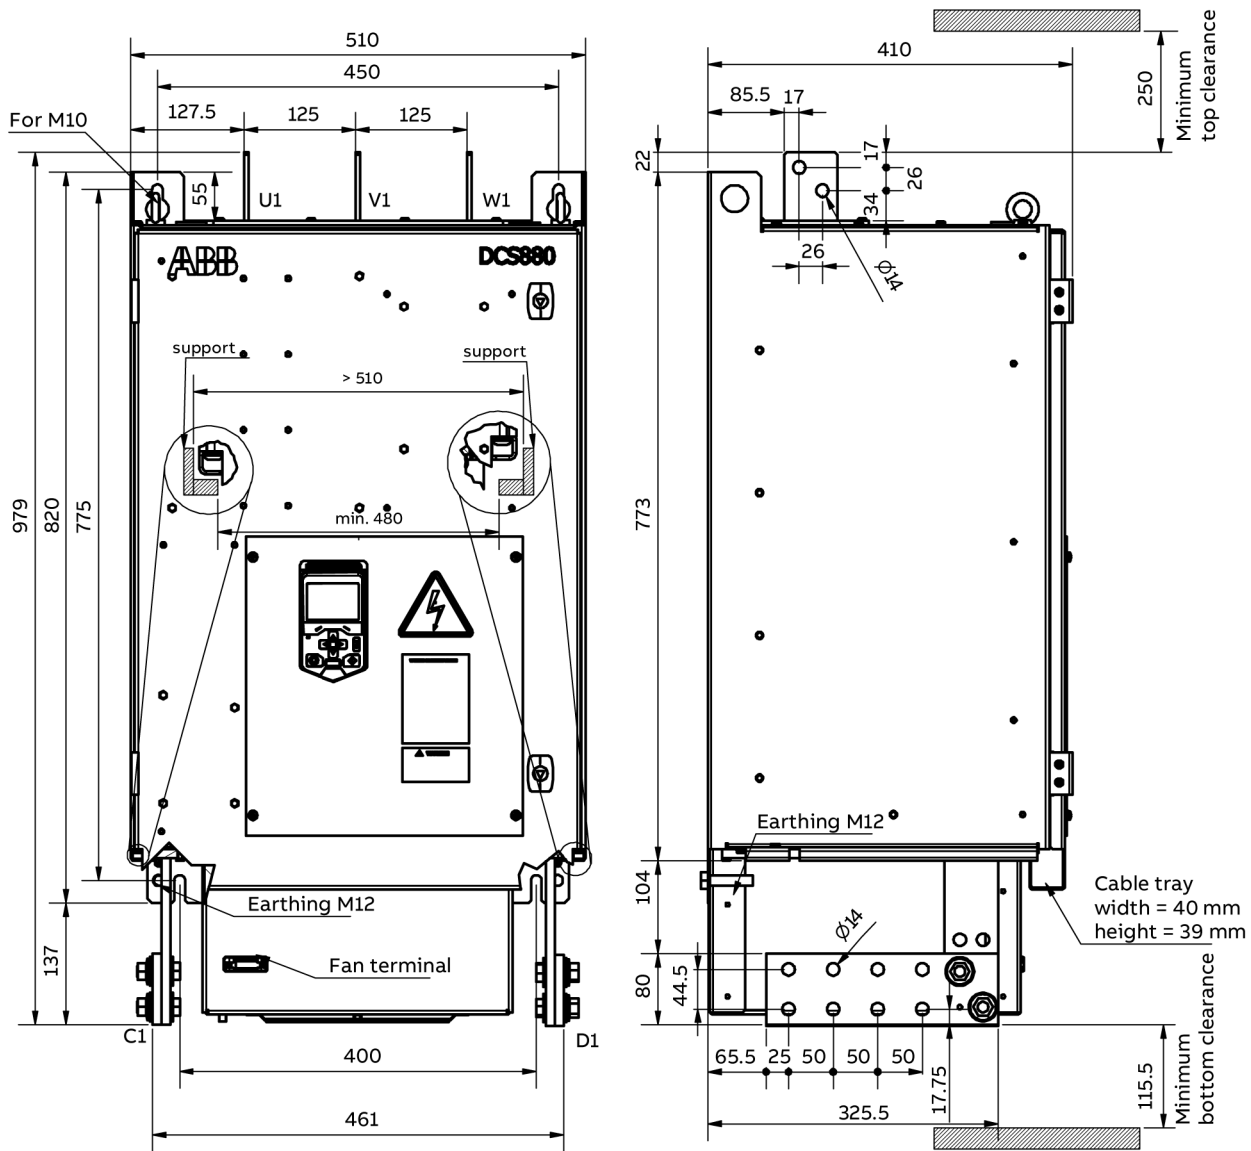

MG_880_006_H6_a.ai

Mounting the module size H6 inside a cabinet

Two supports should be mounted inside the cabinet in such a way, that they can carry the module's weight. The minimum distance between the supports should not be less than 480 mm because of electrical clearance (DC busbars).


An L-shape support as indicated will allow to place the converter temporarily close to the front end of the support (weight still taken by a lifting device) and then push it back to the back plate of the cabinet. The upper and lower holes in the back plate of the converter should be used to fix the converter in that position.

Note: Since the ErP compliant unit is higher it is possible to adjust the armature circuit busbars to the previous height.

Size H7 (+P906)

DCS880-S0b-1900
DCS880-S0b-2050
DCS880-S0b-2500
DCS880-S0b-3000

With external control unit (+P906)

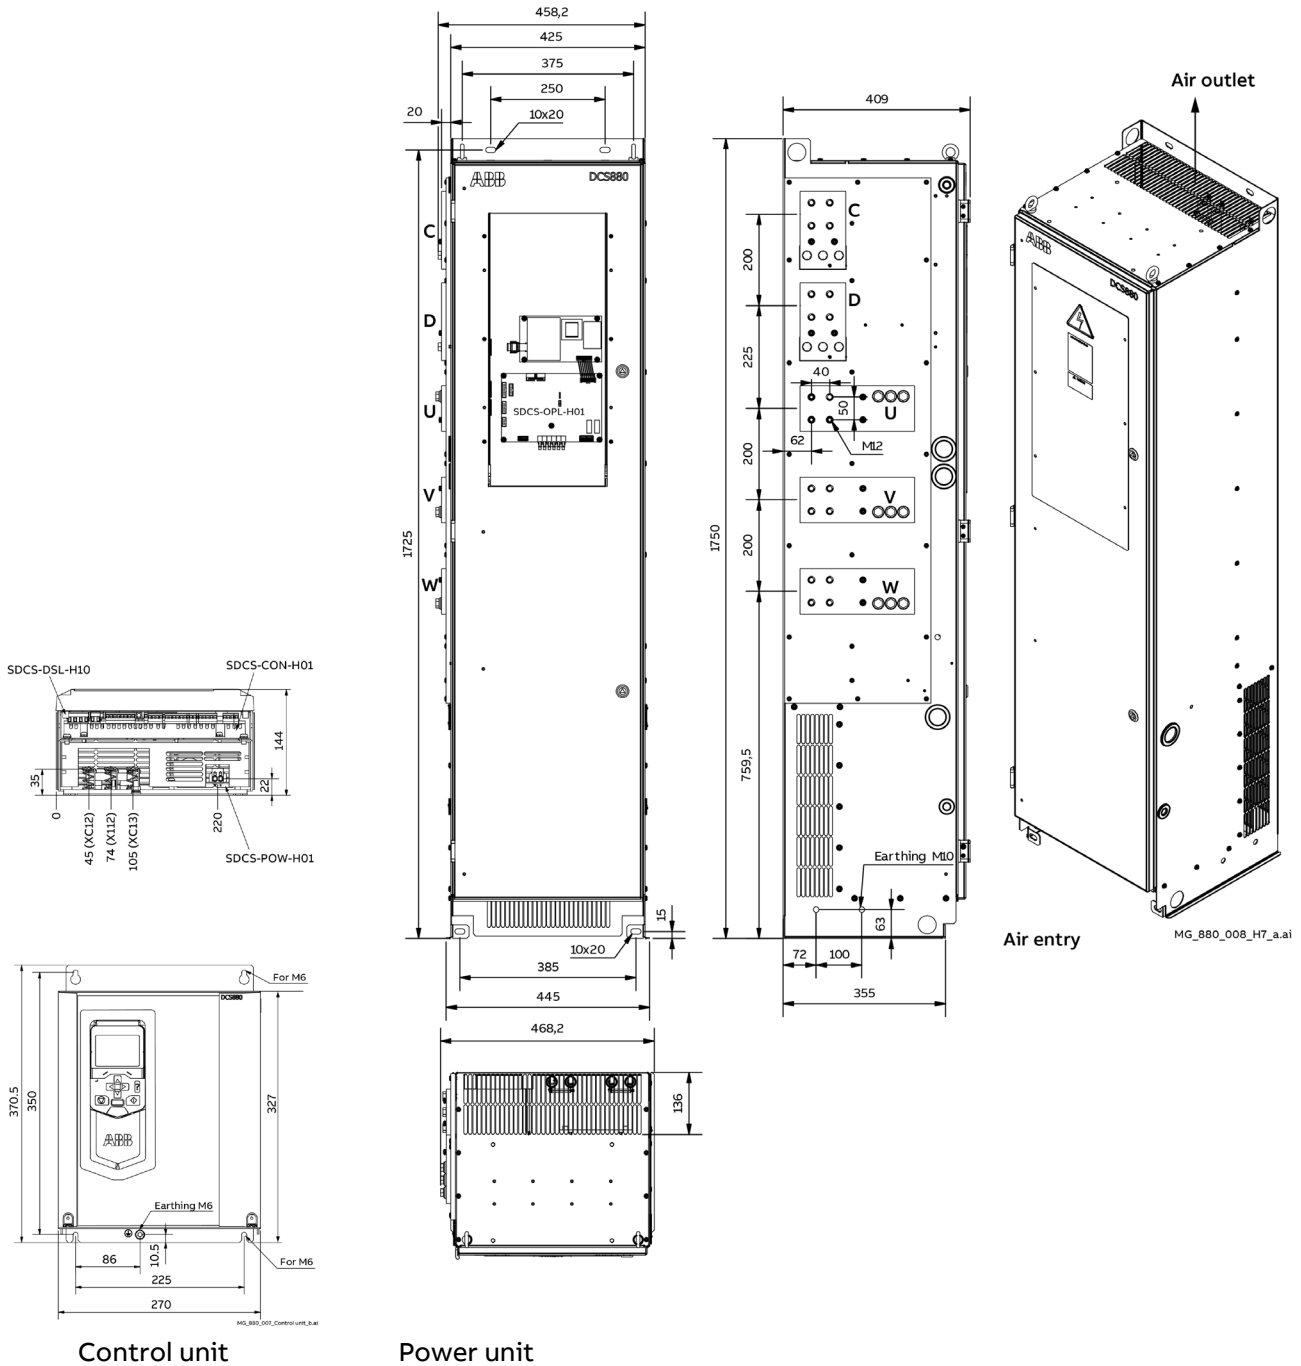


Control unit

Power unit

Size H8 left-hand (+P906)

DCS880-S0b-2050-ddL
DCS880-S0b-2600-ddL
DCS880-S0b-3300-ddL
DCS880-S0b-4000-ddL

With external control unit (+P906)	Busbars in mm:
	AC and DC: 100 x 10

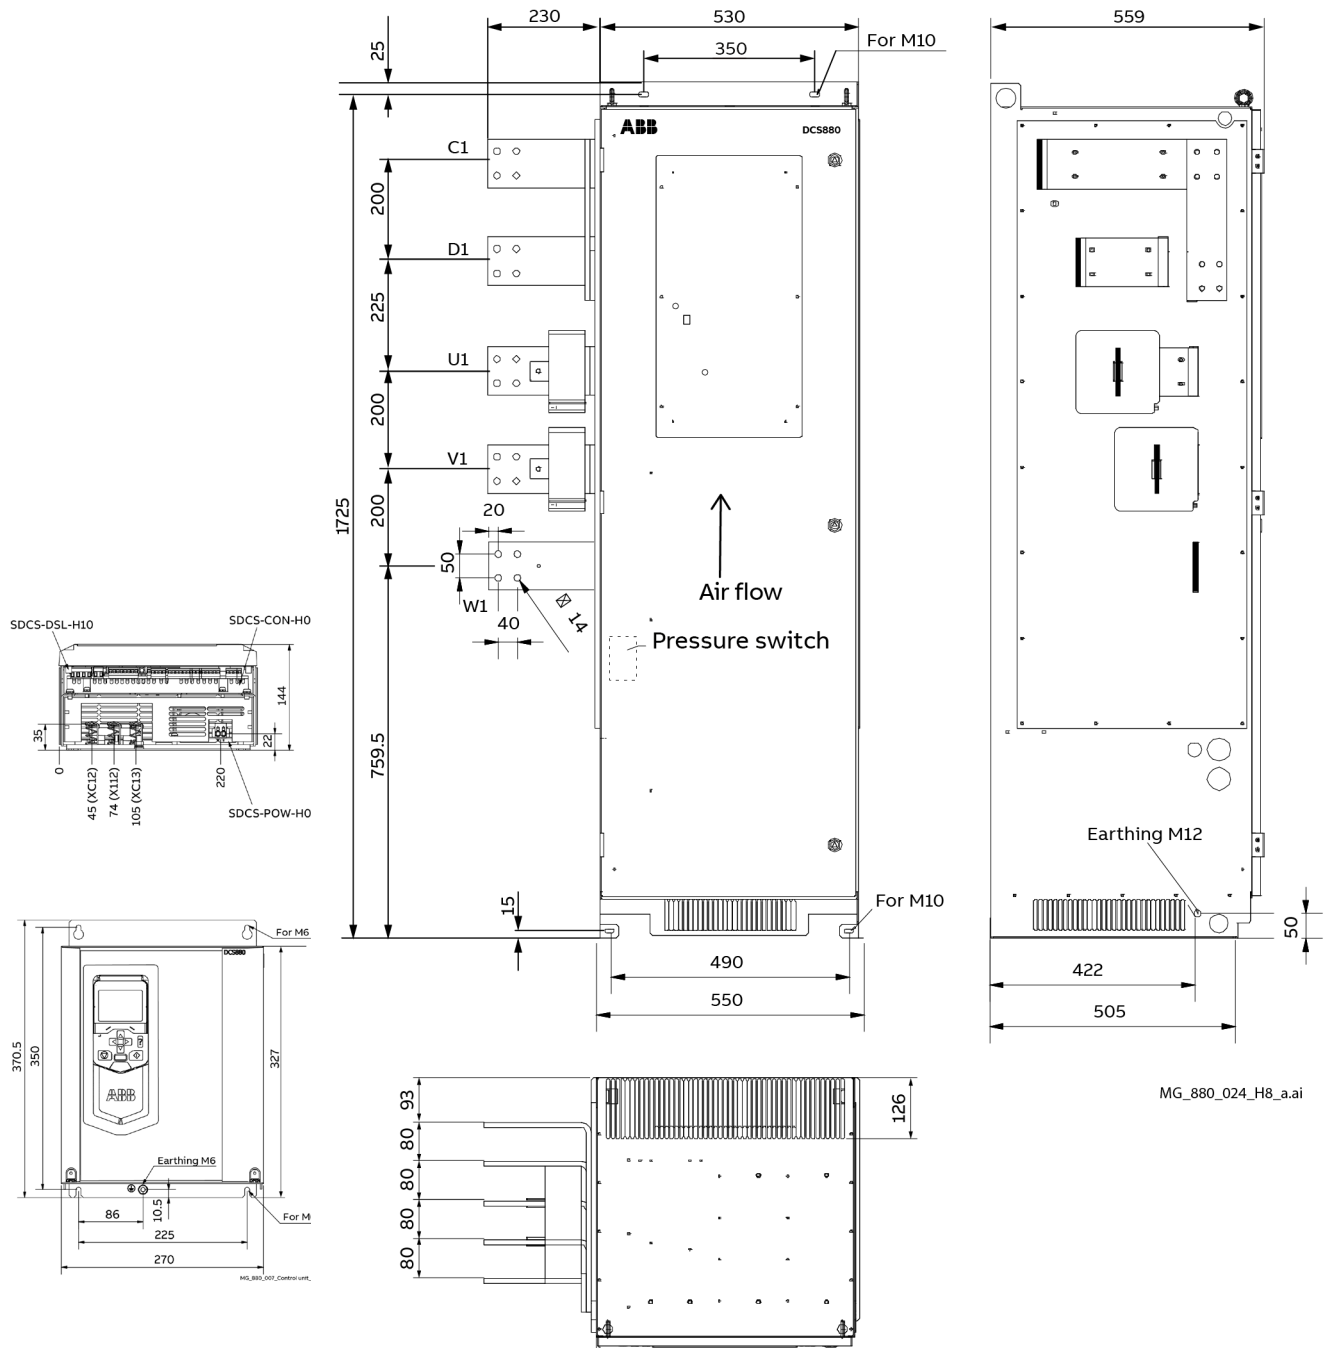


MG_880_024_H8_a.ai

Control unit Power unit

Size H8 left-hand (+P906)

DCS880-S0b-4800-0dL
DCS880-S0b-5200-0dL

With external control unit (+P906)	Busbars in mm:
	AC: 100 x 10
	DC: 2 x (100 x 10)

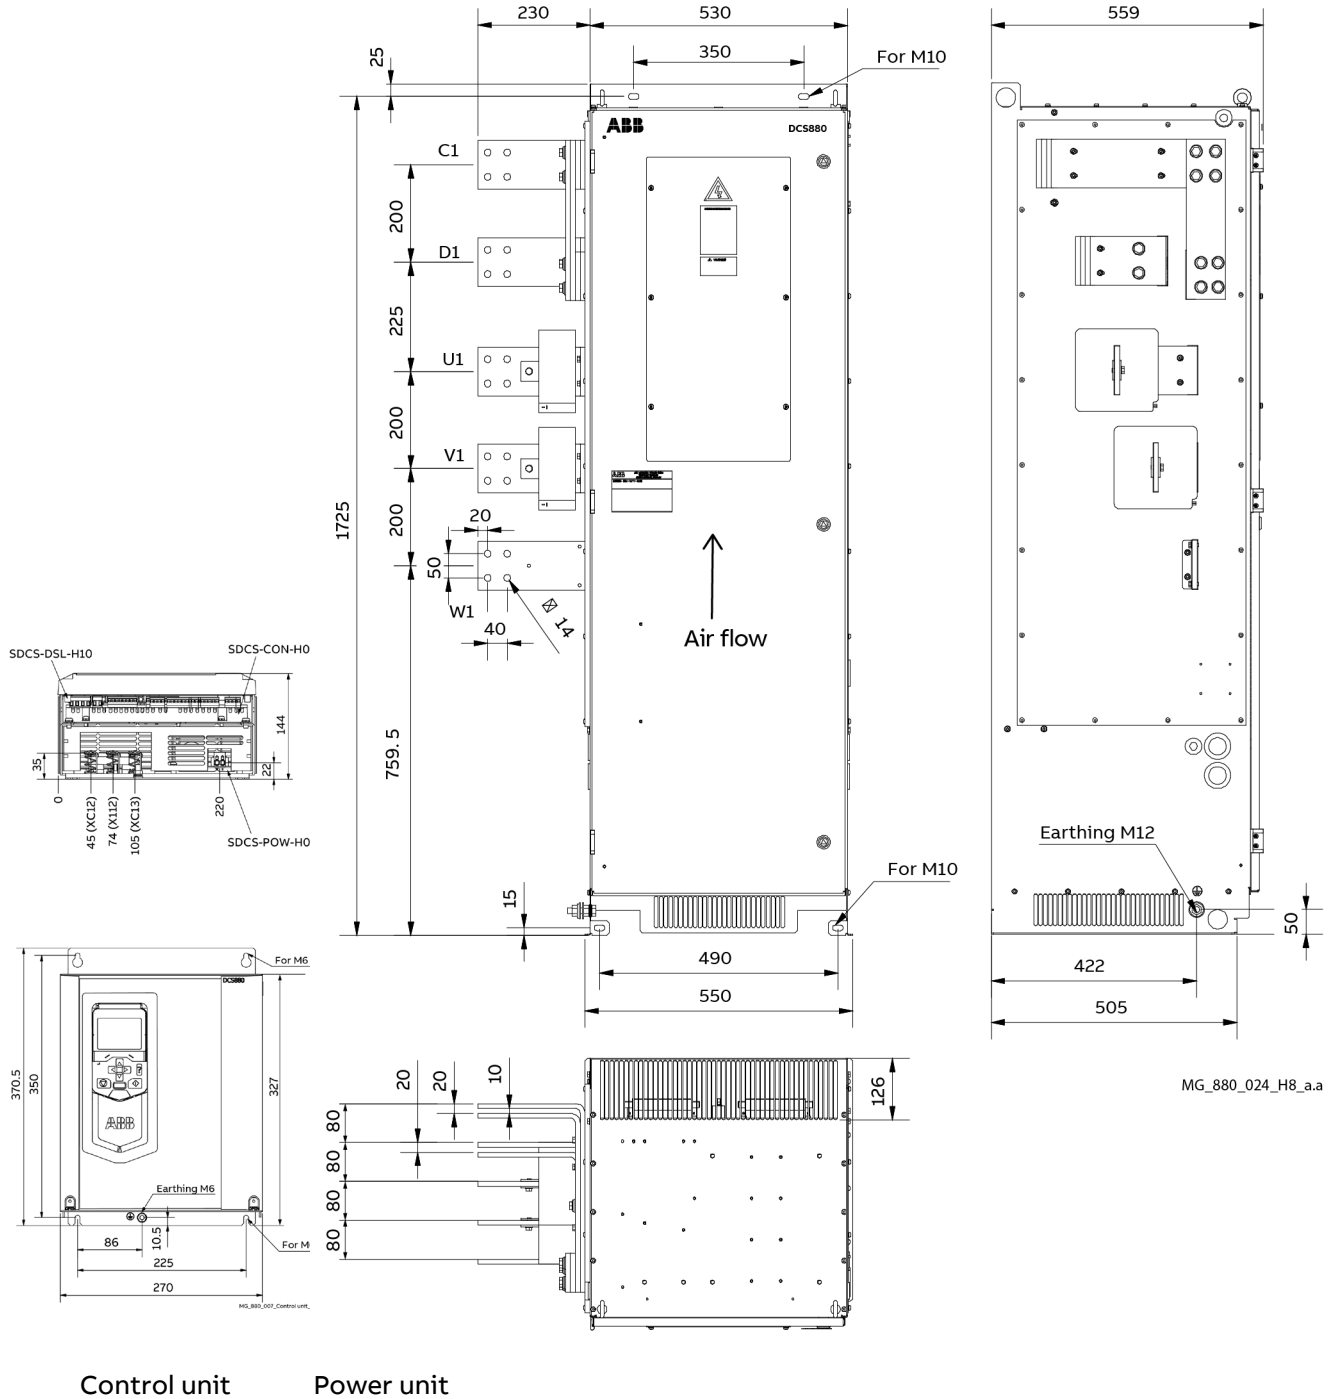

MG_880_024_H8_a.a


Control unit

Power unit

Size H8 right-hand (+P906)

DCS880-S0b-2050-ddR
DCS880-S0b-2600-ddR
DCS880-S0b-3300-ddR
DCS880-S0b-4000-ddR

With external control unit (+P906)	Busbars in mm:
	AC and DC: 100 x 10

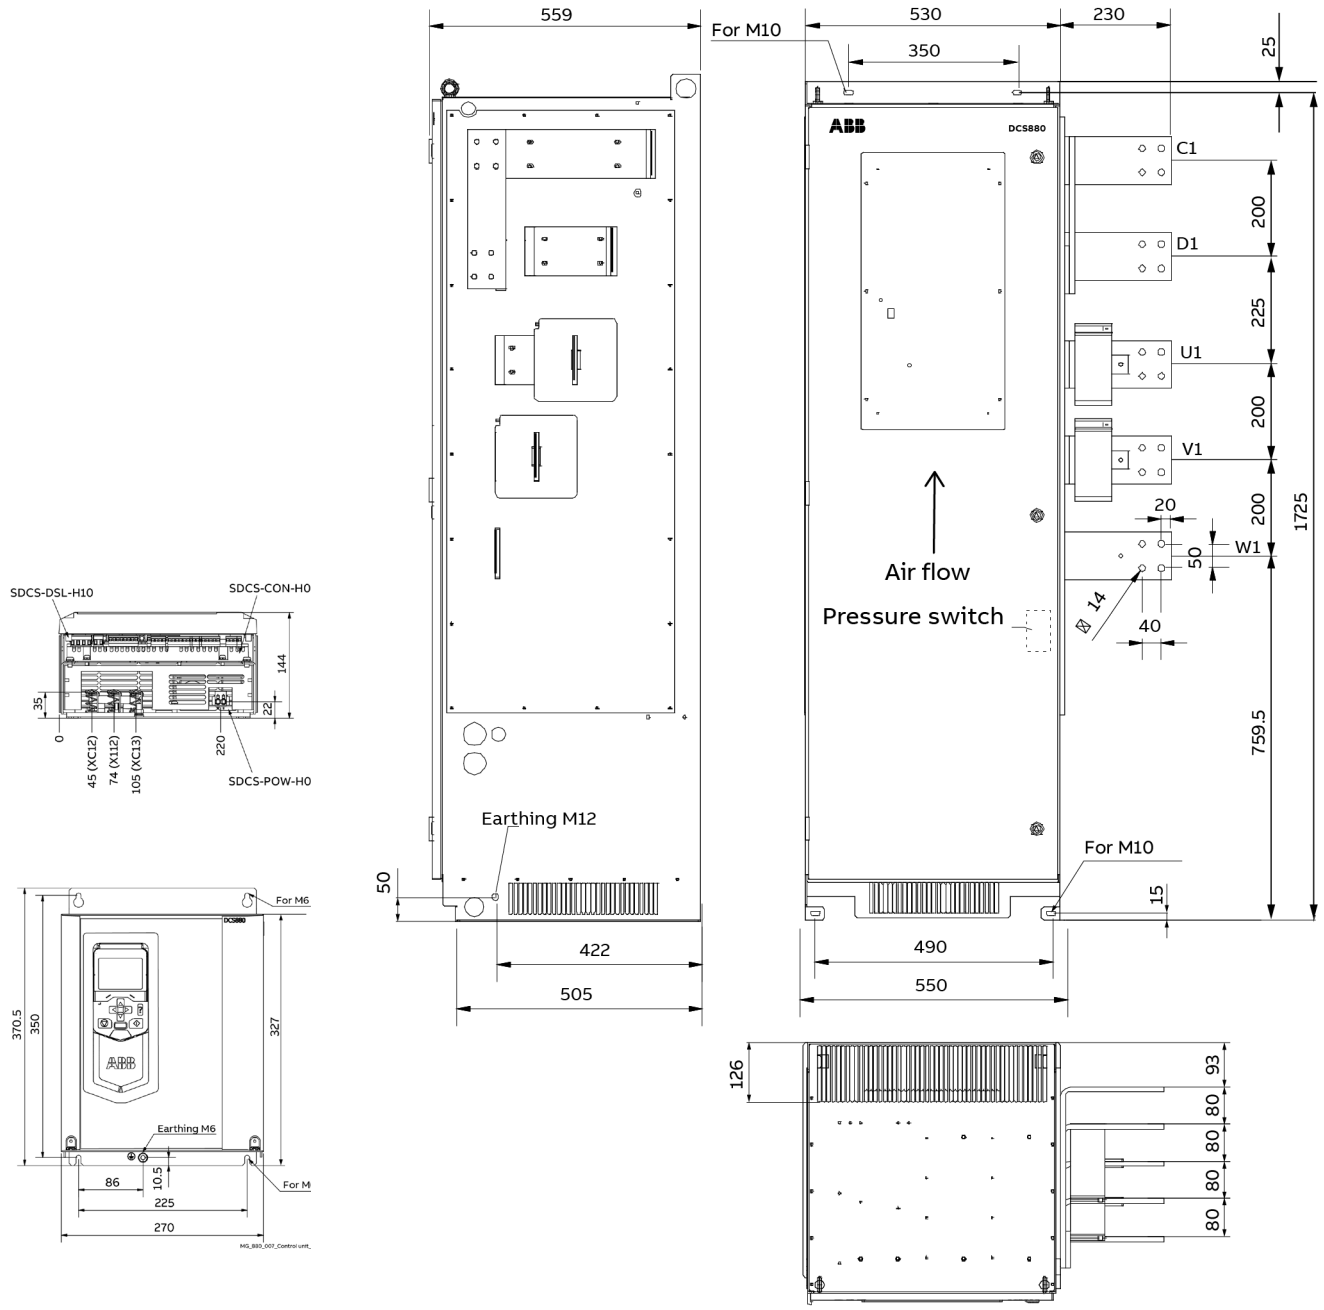


MG_880_024_H8_a.ai

Control unit Power unit

Size H8 right-hand (+P906)

DCS880-S0b-4800-0dR
DCS880-S0b-5200-0dR

With external control unit (+P906)	Busbars in mm:
	AC: 100 x 10
	DC: 2 x (100 x 10)

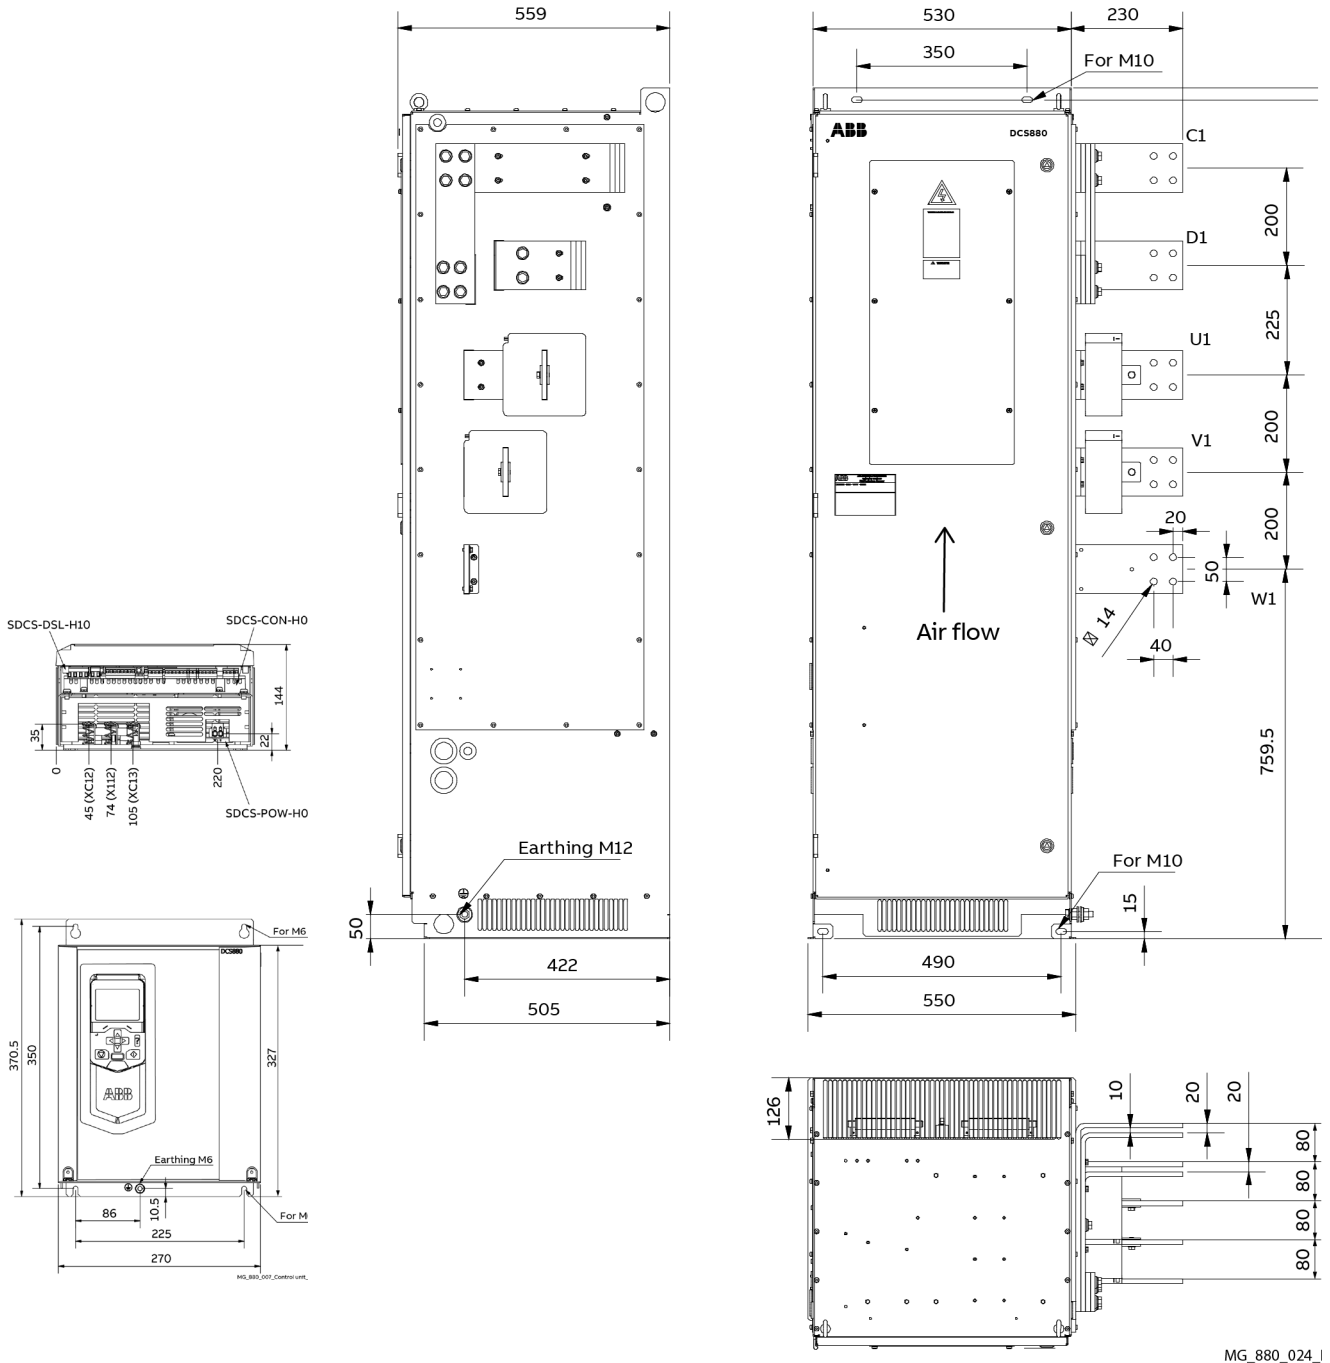


Control unit

Power unit

Branch fuses installed inside converters size H5 ... H8 (type X0)

Size	Converter type	Fuse type	Fuse size
	400 V/500 V (IEC)/525 V (UL)		
H5	DCS880-S0b-1190-04/05X0	UR 900 A/690 V	2
H6	DCS880-S0b-1200-04/05X0	UR 800 A/660 V	5
	DCS880-S0b-1500-04/05X0	UR 1250 A/660 V	5
	DCS880-S0b-2000-04/05X0	UR 1600 A/660 V	5
H7	DCS880-S0b-2050-05X0	UR 1500 A/660 V	5
	DCS880-S0b-2500-04/05X0	UR 900 A/660 V ①	5
	DCS880-S0b-3000-04/05X0	UR 1250 A/660 V ①	5
H8	DCS880-S0b-3300-04/05X0	UR 2500 A/660 V	7
	DCS880-S0b-4000-04/05X0	UR 3000 A/660 V	7
	DCS880-S0b-5200-04/05X0	UR 3500 A/690 V	7
	600 V/690 V		
H6	DCS880-S0b-0900-06/07X0	UR 630 A/1250 V	6
	DCS880-S0b-1500-06/07X0	UR 1100 A/1250 V	6
	DCS880-S01-2000-06/07X0	UR 1400 A/1100 V	6
H7	DCS880-S0b-2050-06/07X0	UR 700 A/1250 V ①	6
	DCS880-S0b-2500-06/07X0	UR 1000 A/1250 V ①	6
	DCS880-S0b-3000-06/07X0	UR 1100 A/1250 V ①	6
H8	DCS880-S0b-3300-06/07e0	UR 2500 A/1000 V	8
	DCS880-S0b-4000-06/07e0	UR 3000 A/1000 V	8
	DCS880-S0b-4800-06/07e0	UR 3000 A/1000 V	8
	800 V		
H7	DCS880-S0b-1900-08X0	UR 630 A/1250 V ①	6
	DCS880-S0b-2500-08X0	UR 1000 A/1250 V ①	6
	DCS880-S0b-3000-08X0	UR 1100 A/1250 V ①	6
H8	DCS880-S0b-3300-08e0	UR 2500 A/1000 V	8
	DCS880-S0b-4000-08e0	UR 3000 A/1000 V	8
	DCS880-S0b-4800-08e0	UR 3000 A/1000 V	8
	1000 V		
H8	DCS880-S0b-2050-10e0	UR 1800 A/1250 V	9
	DCS880-S0b-2600-10e0	UR 1800 A/1250 V	9
	DCS880-S0b-3300-10e0	UR 2500 A/1250 V	9
	DCS880-S0b-4000-10e0	UR 2500 A/1250 V	9
	1200 V		
H8	Data on request	-	-

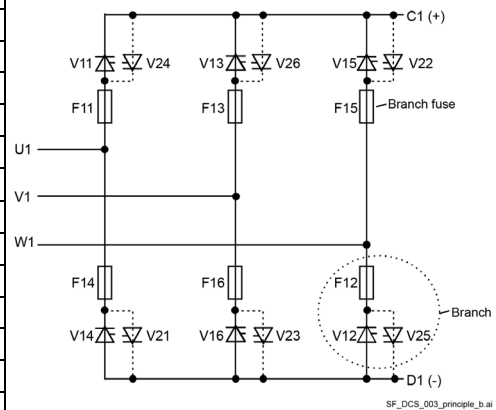


① Two fuses per thyristor (12 fuses per bridge).

Branch fuses installed inside converters size H7, (double fuse, type XA)

Size	Converter type	Fuse type	Fuse size
	400 V/500 V (IEC)/525 V (UL)		
H7	DCS880-S0b-2500-04/05XA	UR 2240 A/690 V ①	10
	DCS880-S0b-3000-04/05XA	UR 2240 A/690 V ①	10
	600 V/690 V		
H7	DCS880-S0b-2050-06/07XA	UR 1250 A/1250 V ①	11
	DCS880-S0b-2500-06/07XA	UR 2240 A/1250 V ①	11
	DCS880-S0b-3000-06/07XA	UR 2240 A/1250 V ①	11
	800 V		
H7	DCS880-S0b-1900-08XA	UR 1250 A/1250 V ①	11
	DCS880-S0b-2500-08XA	UR 2240 A/1250 V ①	11
	DCS880-S0b-3000-08XA	UR 2240 A/1250 V ①	11


① Double fuse. 2 fuses mechanically connected.

Size 2

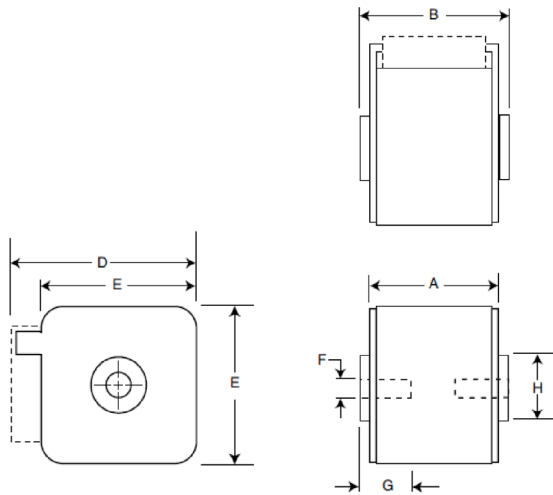


Size	A [mm]	B [mm]	D [mm]	E [mm]	F	G [mm]	H
2	50	51	77	61	M10	10	M24

Size 5, 6

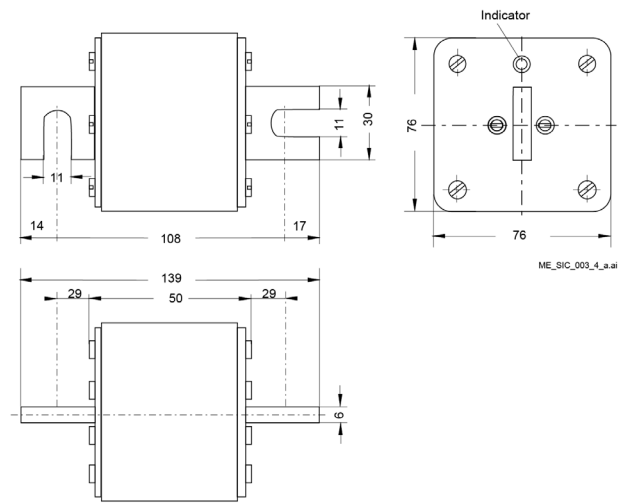


Size	a [mm]	b [mm]	c [mm]	d [mm]
5	50	29	30	76
6	80	14	30	76

Size 7 ... 9

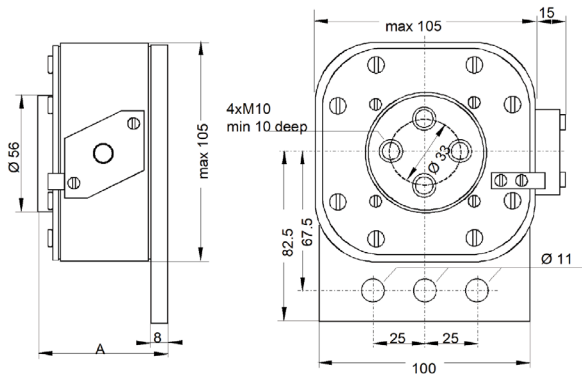

Size	A [mm]
7	62
8	90
9	105

Size 10, 11

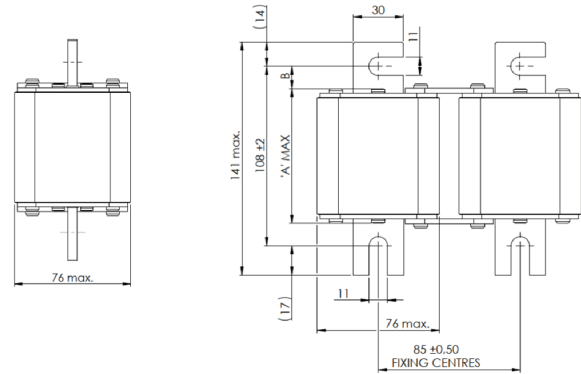

Size	A MAX [mm]	B [mm]	
10	52	29 ±2	53
11	82.5	14 ±2	51,52


Note: The given dimensions may be exceeded in some cases. Please take them only for information.

Accessories

DCF803-0016, FEX-425-Int and DCF803-0035


The field exciters DCF803-0016, FEX-425-Int and DCF803-0035 are half controlled 3-phase converters. All field exciters are based on the same control board SDCS-FEX-4. The board is equipped with its own synchronization and current control. The current measurement circuit is automatically scaled depending on the rated field current of the motor. The field exciter is fully controlled and monitored by the armature converter via drive-to-drive communication.

The field exciter is prepared to operate as 3-phase as well as single-phase converter. For single-phase operation connect terminals U and W.

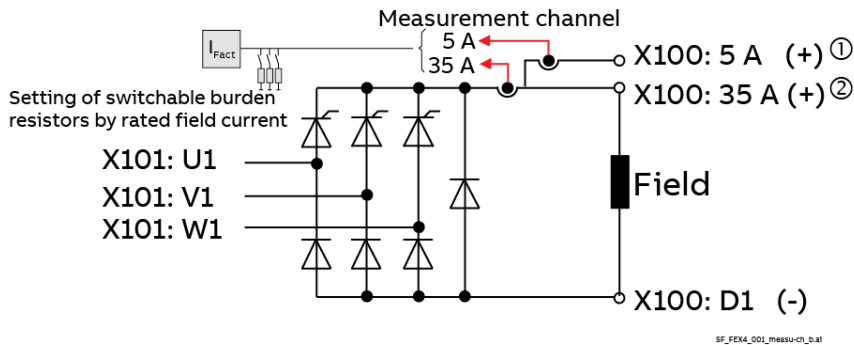

- ① Only for 99.07 M1 used field exciter type = DCF803 terminal 5 A.
- ② For 99.07 M1 used field exciter type = DCF803-0016, FEX-425-Int or DCF804-0035.

Layout of the SDCS-FEX-4

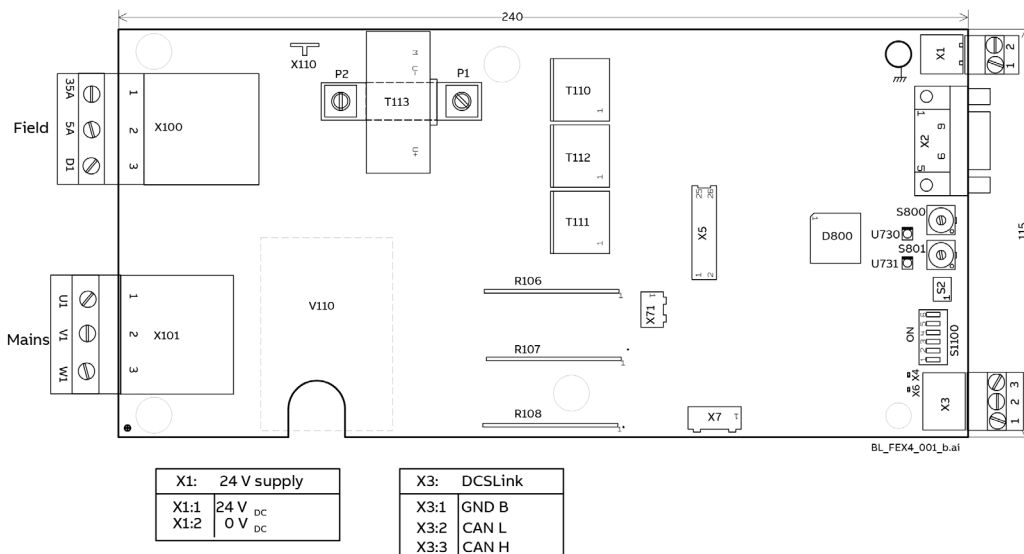

Cross section FEX-425, DCF803-0016, DCF803-0035

Terminal	Flex cable	
	Max [mm ²]	Torque [Nm]
X1 X3	0.25 ... 1.5	0.5 ... 0.6
X100 Field X101 Mains	6/AWG10	1.5 ... 1.7

Electrical data

Power part	
AC input voltage	110 V -15 % ... 500 V +10 %; single or 3-phase.
AC input current	< DC output current.
Frequency	Same as DCS converter.
AC isolation voltage	600 V.
Line reactor	External.
Line fuses	KTK25 for FEX-425-Int; external for DCF803-0016 and DCF803-0035.
DC output current ①	0.3 A ... 16 A = DCF803-0016. 0.3 A ... 25 A = FEX-425-Int. 0.3 A ... 35 A = DCF803-0035.
Power loss	< 130 W (at rated current).
Auxiliary supply	
DC input voltage	24 V _{DC} .
DC input current	< 200 mA supplied via X51 of SDCS-DSL-H1x.
Buffering	10 ms.

① 3-phase or single-phase operation.

Control unit

The control includes the following main blocks:

- Micro controller H8 for current control, synchronization, and fault handling.
- 2 channel measurement of actual field current in the DC circuit.
- High ohmic measurement of AC voltage. Residual resistance to ground $\approx 1.6 \text{ M}\Omega$.
- H8 controller for drive-to-drive communication based on CAN standard.
- Driver circuit to fire the half control bridge.
- The firmware is stored in a flash memory and contains:
 - The PI current controller for the field circuit.
 - The fault and reset logic.
 - The synchronization and PLL function.
 - The setting of the current measurement channel.

All parameters are set from the armature converter via drive-to-drive communication. The field current reference, actual field current, current control and status bits are cyclic sent via drive-to-drive communication.

The field exciter is equipped with an autoscaling function of the burden resistors based on the nominal field current of the motor.

Power part

The power part is a 3-phase half-controlled bridge with free-wheeling diode.


The external field exciter DCF803-0016 and DCF803-0035 are 3-phase half-controlled bridges including snubbers based on the SDCS-FEX-4. Line fuses, line reactors and transformers are installed outside the housing.

The FEX-425-Int (internal field exciter) can only be installed in H5 and H6 modules. The unit is based on a SDCS-FEX-4. For a H5 the supply must be connected via line reactors and fuses located outside of the module. For a H6 the supply must be connected via line reactors outside of the module. The fuses are installed in the module.

For single-phase operation connect terminals U and W. For single-phase operation an autotransformer for voltage adaptation is recommended.


Please see comparison of output voltage ripple between single-phase and 3-phase operation.

Voltage ripple of voltage UDC depending on operation modes.

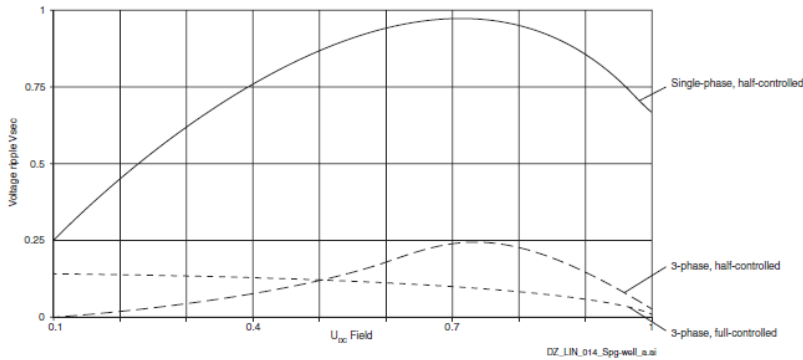


DCSLink communication

The field converter is controlled from armature converter via DCSLink based on CAN hardware.

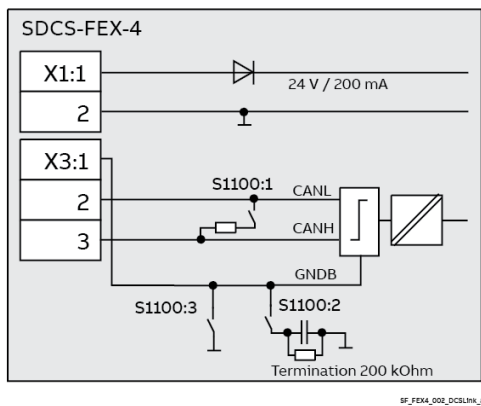

Incoming power		Remarks
24 V	≤200 mA	24 V grounded via X51 of SDCS-DSL-H1x.

DSL communication		Remarks
Bus termination		
S1100:	1 = ON	120 Ω.
	1 = OFF	No termination.
Ground termination		
S1100:	2 = ON	200 kΩ R-C ground termination.
	3 = ON	0 Ω ground termination.
	2, 3 = OFF	No termination.




Node address is set by:
 S800 digit 0 (node address 00 is not possible!).
 S801 digit 10.
 Same node address must be selected in the corresponding armature converter.
Example: Node address = 13 ==> S800 = 3 and S801 = 1.

The communication speed is set by S1100.

S1100:6	S1100:5	S1100:4	Baudrate [kBaud]	Selection in armature converter, parameter (70.06)
OFF	OFF	OFF	20	0
OFF	OFF	ON	50	1
OFF	ON	OFF	125	2
OFF	ON	ON	250	3
ON	OFF	OFF	500	4
ON	OFF	ON	800	5
ON	ON	OFF	888	6
ON	ON	ON	1000	7

DCF803-0016 and DCF803-0035 configuration (H1 ... H8)


3-phase connection, see also parameters 28.63 and 42.68.

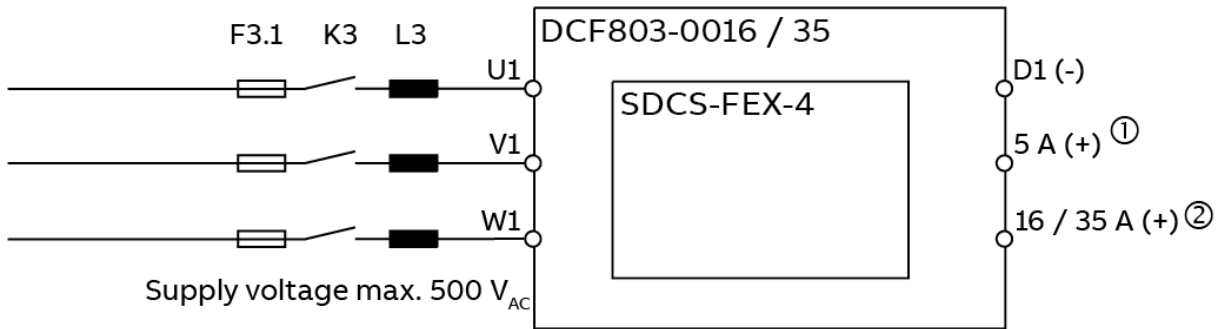

SF_DCF_003_FEX4_a.ai

- ① Only for 99.07 M1 used field exciter type = DCF803 terminal 5 A.
- ② For 99.07 M1 used field exciter type = DCF803-0016, FEX-425-Int or DCF804-0035.

Single-phase connection, see also parameters 28.63 and 42.68.

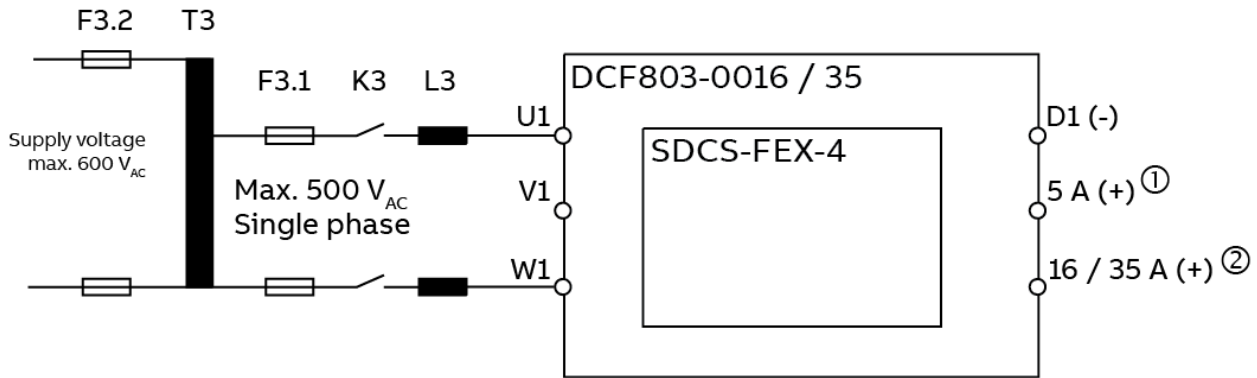

SF_DCF_003_FEX4_a.ai


- ① Only for 99.07 M1 used field exciter type = DCF803 terminal 5 A.
- ② For 99.07 M1 used field exciter type = DCF803-0016, FEX-425-Int or DCF804-0035.

Dimensions

DCF803-0016

Dimensions in mm


Weight appr. 6 kg

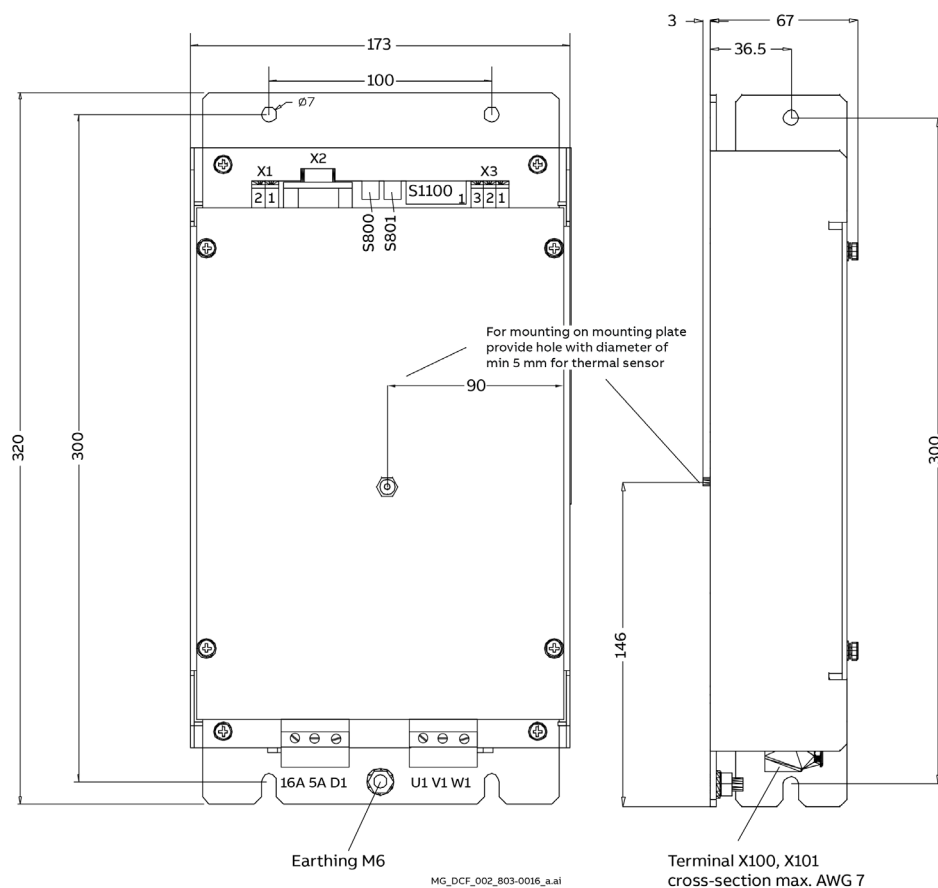

DCF803-0035


Dimensions in mm

Weight appr. 6 kg

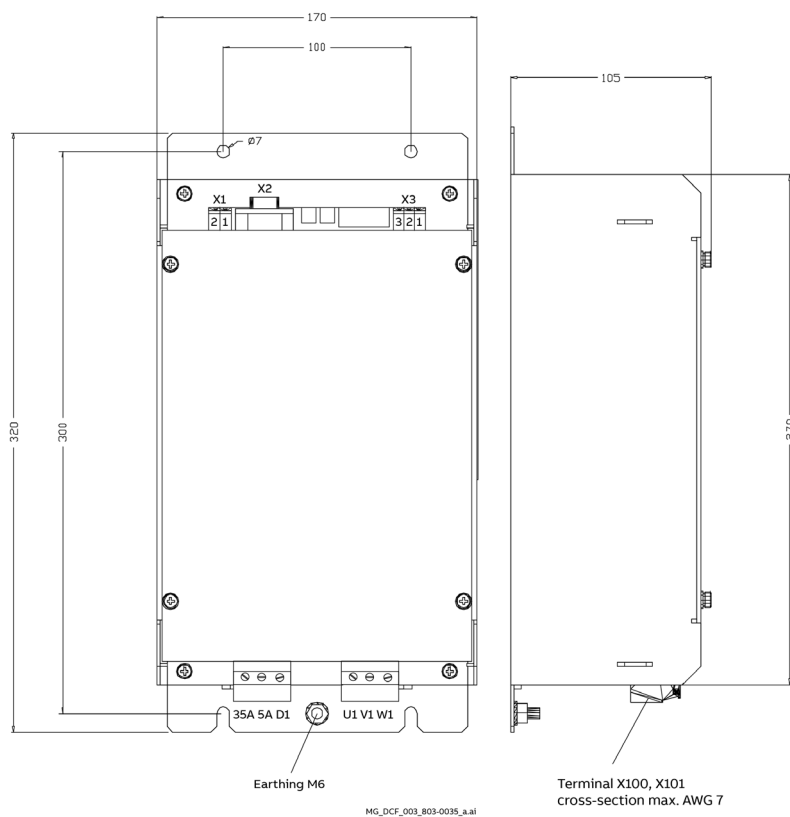


FEX-425-Int configuration (H5)

3-phase connection, see also parameters 28.63 and 42.68.

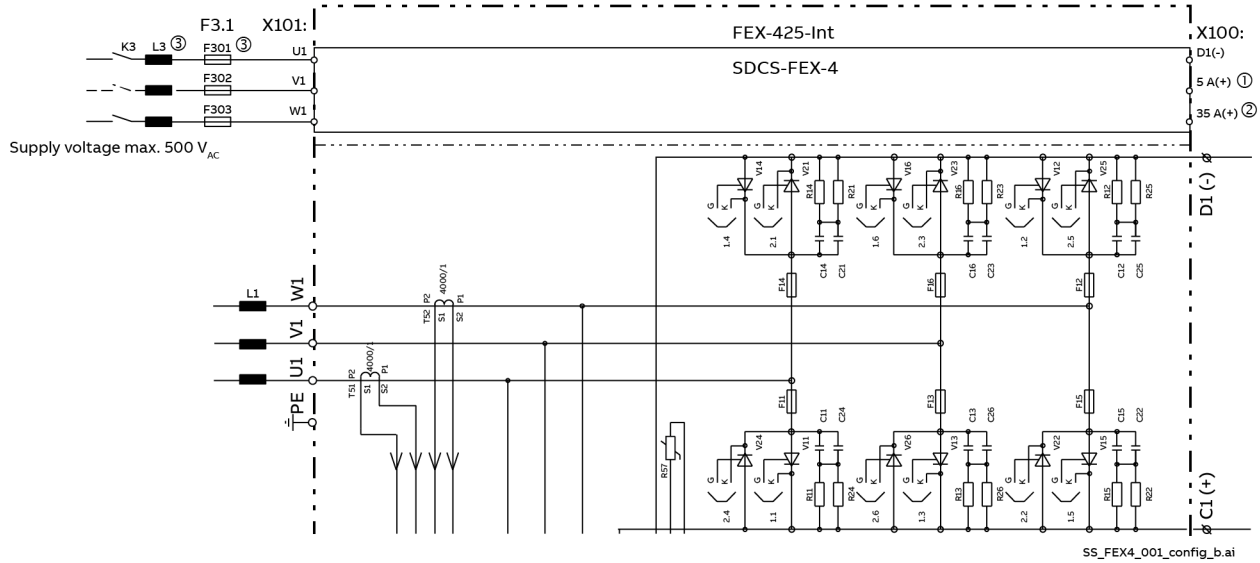

- ① Only for 99.07 M1 used field exciter type = DCF803 terminal 5 A.
- ② For 99.07 M1 used field exciter type = DCF803-0016, FEX-425-Int or DCF804-0035.

Single-phase connection, see also parameters 28.63 and 42.68.

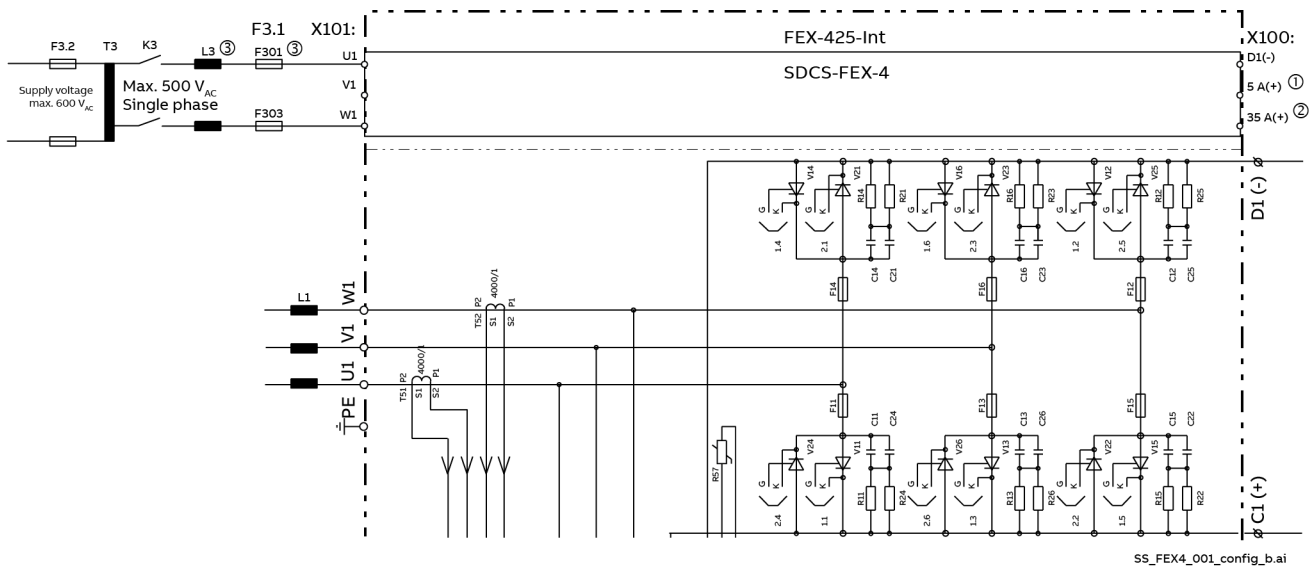


- ① Only for 99.07 M1 used field exciter type = DCF803 terminal 5 A.
- ② For 99.07 M1 used field exciter type = DCF803-0016, FEX-425-Int or DCF804-0035.
- ③ Field line reactor and field fuses are external.

Further information about line reactors, see sections [Line reactors \(L3\) \(ND30\)](#) and [Line reactors type ND401 ... 413 \(ND402\)](#) in this chapter.

FEX-425-Int configuration (H6)


3-phase connection, see also parameters 28.63 and 42.68.

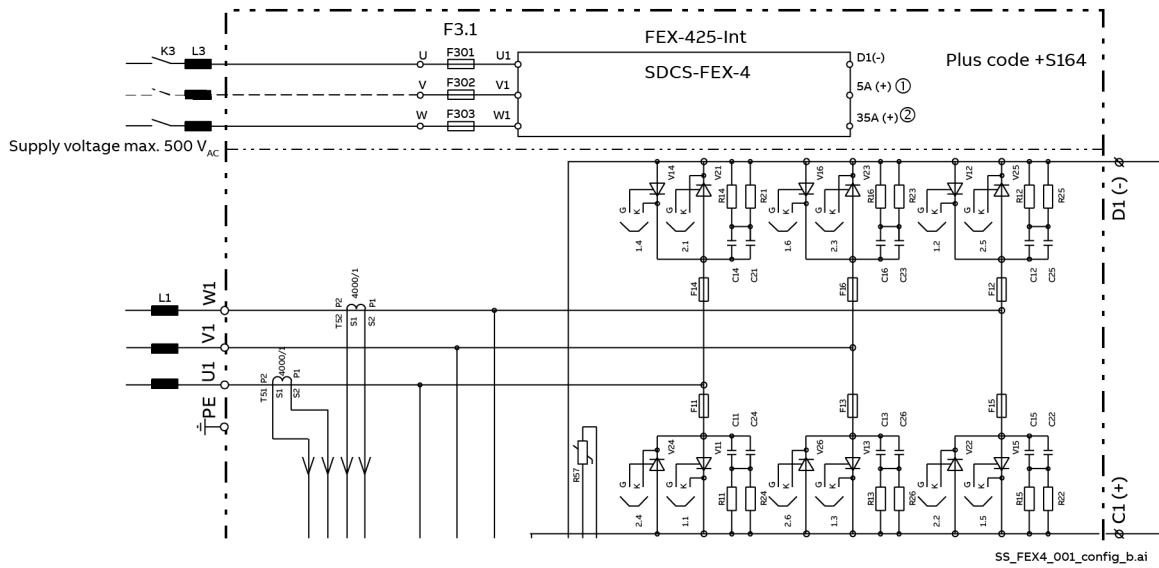

① Only for 99.07 M1 used field exciter type = DCF803 terminal 5 A.

② For 99.07 M1 used field exciter type = DCF803-0016, FEX-425-Int or DCF804-0035.

Single-phase connection, see also parameters 28.63 and 42.68.

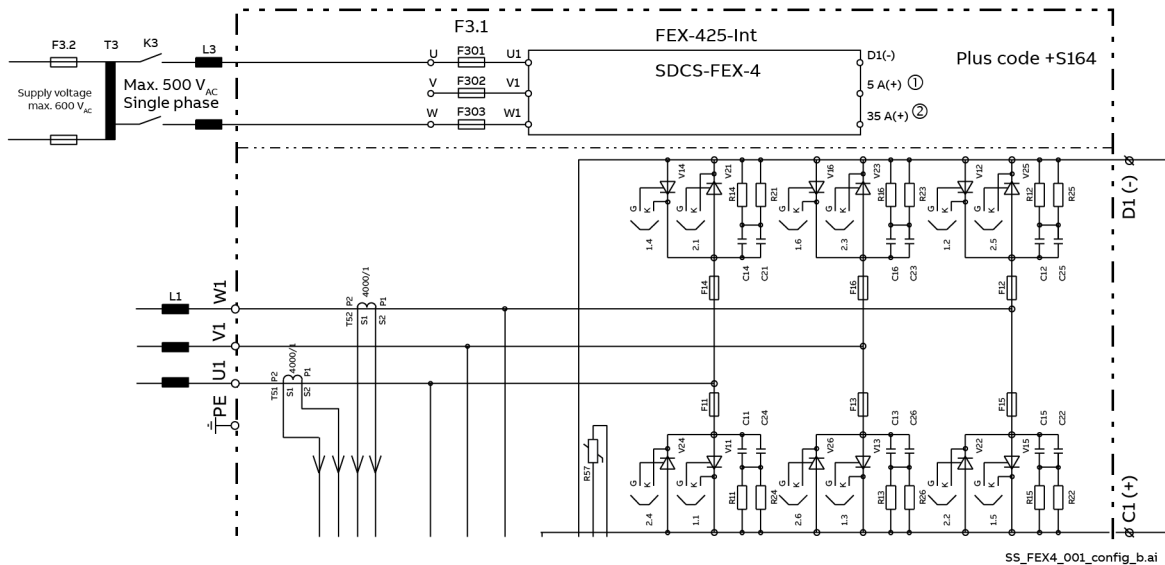

① Only for 99.07 M1 used field exciter type = DCF803 terminal 5 A.

② For 99.07 M1 used field exciter type = DCF803-0016, FEX-425-Int or DCF804-0035.



Further information about line reactors, see sections [Line reactors \(L3\) \(ND30\)](#) and [Line reactors type ND401... 413 \(ND402\)](#) in this chapter.

DCF803-0050, DCF804-0050, DCF803-0060 and DCF804-0060


DCF803-0050/0060 and DCF804-0050/0060 are external single-phase field converters. The **half-controlled** (1-Q) field exciters DCF803-0050/DCF803-0060 include the SDCS-FEX-82, two thyristor/diode power modules and auxiliaries (power supply, line reactor L1). The **fully controlled** (4-Q) field exciters DCF804-0050/DCF804-0060 include the SDCS-FEX-81, four anti-parallel thyristor power modules and auxiliaries (power supply, line reactor L1). The control structure is similar to the SDCS-FEX-4 in single-phase operation. A micro controller is used for controlling the field current and firing. The DC current is measured using an AC current transformer.

DCF803-0050/0060

DCF804-0050/0060

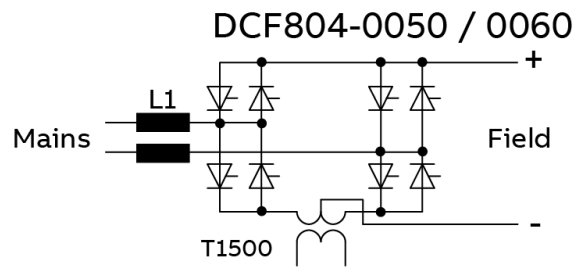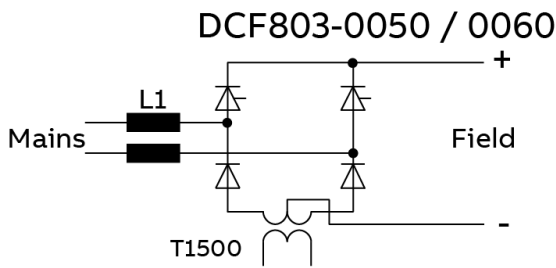


SS_DCF_001_part_b.ai

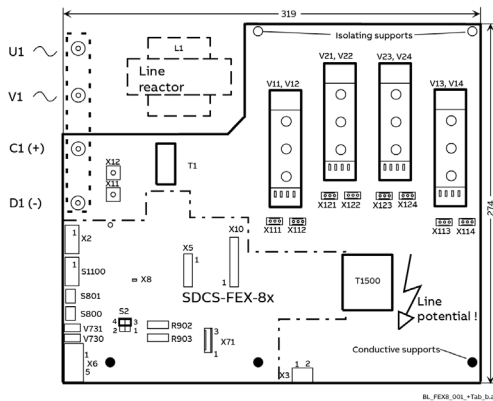

X2:1	reserved	
X2:2	reserved	
X2:3	GNDB	Ground of communication interface.
X2:4	CANL	DCSLink e.g., X52:2 or X53:2.
X2:5	CANH	DCSLink e.g., X52:3 or X53:3.
S1100:1	Termination	ON = 120 Ohm bus termination.
S1100:2	Grounding	ON = GNDB to ground via 200 kΩ.
S1100:3	Grounding	ON = GNDB to ground, hard.
S1100:4	Baudrate	Default = OFF (500 kBd).
S1100:5	Baudrate	Default = OFF (500 kBd).
S1100:6	Baudrate	Default = ON (500 kBd).
S1100:7	Bridge reversal	ON = extended bridge reversal (+20 ms.)
S1100:8	Oper. mode	OFF = reserved; ON = DCS800.
S801	Node x 10	DCSLink node address digit 10.
S800	Node 1 ... 9	DCSLink node address digit 0.
V730	Green	Fault and warning display, see chapter Diagnosis.
V731	Yellow	Fault and warning display, see chapter Diagnosis.

Cross section DCF803-0050, DCF803-0060, DCF804-0050, DCF804-0060

Terminal	Flex cable		
	Max [mm ²]	Torque [Nm]	
X2 X3	0.25 ... 1.5	0.5 ... 0.6	
X:U1 X:V1 X:C1 X:D1	10	10	M6
PE	10	10	M6

Electrical data

Power part	
AC input voltage	110 V -15 % ... 500 V +10 %; single-phase.
AC input current	< DC output current.
Frequency	Same as DCS converter.
AC isolation voltage	690 V.
Line reactor	160 μ H; 45 ... 65 Hz (built in).
DC output current ① 50 A	0.3 A ... 50 A.
DC output current ① 60 A	0.3 A ... 60 A; forced cooling (2 fans).
Power loss at $I_{F \text{ rated}}$	< 180 W (at rated current).
Load condition	Always L/R > 100 ms (saturation).
X2 Serial communication	
X2: 1	reserved
X2: 2	reserved
X2: 3	GNDB, ground of commutation interface.
X2: 4	CANL.
X2: 5	CANH.
X3 Auxiliary voltage	
AC input voltage	110 V -15 % ... 230 V +10 %; single-phase.
Frequency	45 ... 65 Hz.
AC input power	15 W; 30 VA.
Inrush current	< 5 A/20 ms.
Mains buffering	Minimum 30 ms.
X4 Fan supply	Only 60 A units.
AC input current	0.15 A.

① If Field weakening is needed, the minimum field current of the motor at top speed must be higher than 0.3 A.

Electronic power supply

X3 is connected to a switch mode power supply with mains of 230 V_{AC} or 115 V_{AC}.

The power supply unit provides the galvanic isolated DC voltages 30 V, 15 V, 5 V and -15 V for the control electronics.

In addition, the power supply generates galvanically isolated 5 V for the serial communication drivers.

The voltages can be measured at following terminals:

Voltages	Terminals	Ground
+5 V	X10:18	X10:16 (GND)
+30 V	X10:20	X10:16 (GND)
+15 V	X10:19	X10:16 (GND)
-15 V	X10:17	X10:16 (GND)
+ 5 V	X7:1	X8:1 (GNDB)

Control unit

The control unit includes the following main blocks:

- Micro controller H8 for control and firing.
- Actual DC current measurement using an AC current transformer.
- High ohmic measurement of AC and DC voltage.
- Residual resistance to ground:
 - $\approx 3.5 \text{ M}\Omega$ (DCF803).
 - $\approx 1.9 \text{ M}\Omega$ (DCF804).
- RS485 interface and DCSTLink interface to the converter's control board SDCS-CON-H01.
- The firmware of the field exciter is stored in a flash memory and contains:
 - The PI current controller for the field circuit.
 - The fault and reset logic.
 - The synchronization and PLL function.
 - The bridge reversal function (only DCF804-0050/0060).

All control parameters are set from armature converter via drive-to-drive communication. The field current reference, actual field current, current control and status bit are cyclic sent via drive-to-drive communication.

The field exciter is equipped with an autoscaling function of the burden resistors based on the nominal field current of the motor.

Power part

The DCF803-0050/0060 is a half-controlled single-phase bridge. A half-controlled bridge does not need a freewheeling circuit.

The DCF804-0050/0060 is a fully controlled single-phase bridge. During normal operation it is fired in half-controlled mode to reduce the current ripple.

Fully controlled bridges require separate freewheeling circuits. The firing control enables the freewheeling of a thyristor if the DC voltage increases. See also parameters 28.62 and 42.67 in the armature converter.

A MOV (Metal Oxide Varistor) protects the AC input against voltage spikes from the mains.

Another MOV protects the DC output against voltage surges which can be caused by the field winding of a DC machine.



The power section is equipped with a line reactor (L1). Thus, an external line reactor is not needed.

Single-phase field exciters are typically supplied by autotransformers if the rated field voltage is less than 60 % of the AC supply voltage.



The AC input current can be estimated like this:

$$I_{AC} = 1.1 \times I_{DC} \times U_{DC \text{ field}} / U_{AC \text{ supply}}$$

R902:

	SDCS-FEX-81	DCF804-0050/0060
	SDCS-FEX-82	DCF803-0050/0060


R903:

	50 A
	60 A

DCSLink communication

The field converter is controlled from armature converter via DCSLink based on CAN hardware.

<p>SF_DCF_002_DCSLink_b.ai</p>	DSL communication	Remarks
	Bus termination	
	S1100: 1 = ON	120 Ω.
		1 = OFF
	Ground termination	
	S1100: 2 = ON	200 kΩ R-C ground termination.
3 = ON		0 Ω ground termination.
2, 3 = OFF		No termination.



Node address is set by:
 S800 digit 0 (node address 00 is not possible!).
 S801 digit 10.
 Same node address must be selected in the corresponding armature converter.
Example: Node address = 13 ==> S800 = 3 and S801 = 1.

The communication speed is set by S1100.

S1100:6	S1100:5	S1100:4	Baudrate [kBaud]	Selection in armature converter, parameter (70.06)
OFF	OFF	OFF	20	0
OFF	OFF	ON	50	1
OFF	ON	OFF	125	2
OFF	ON	ON	250	3
ON	OFF	OFF	500	4
ON	OFF	ON	800	5
ON	ON	OFF	888	6
ON	ON	ON	1000	7

RS232-Port

The RS232 interface is used to download the 'Field exciter firmware package'.
 The firmware download is activated by setting S2:1-2 before the auxiliary voltage is switched ON.
 Field exciter mode is S2:3-4 (default).

Diagnosics

All messages are sent to the armature converter and displayed in Signals 04.26, 04.27, 04.36 and 04.37. If the communication is broken or node numbers are mixed up the simple fault display on the SDCS-FEX-4 can be used.

Therefore, the unit is equipped with two small LEDs.

V730 = Green and V731 = Yellow

Following messages are displayed:

- Both OFF No 24 V supply.
- Green and yellow continuous No firmware or S2:1-2.
- Green blinking 50 A/60 A output active, waiting for DCSLink communication.
- Green continuous 50 A/60 A output active, DCSLink communication OK.
- Green and yellow toggling:

X times yellow	Y times green	Warning or Fault	
X = 1	Y = 1	Warning	Phase missing, see parameters 28.63/42.68.
	Y = 2		Heatsink temperature.
	Y = 6		Parameters added.
	Y = 7		Parameter up- or download failed.
	Y = 8		Compatibility.
	Y = 9		Parameters restored.
X = 2	Y = 1	Fault	DCSLink communication.
	Y = 2		Supply voltage synchronization.
	Y = 3		Overcurrent.
	Y = 4		Fast voltage rise, see parameters 28.62/42.67.
	Y = 5		AC supply voltage < 30 V _{AC} .
	Y = 6		AC supply voltage > 650 V _{AC} .
	Y = 9		Heatsink temperature.
	Y = 10		Parameter flash read.
	Y = 11		Compatibility.
	Y = 12		Auxiliary voltage.
	Y = 14		General hardware (no reset possible).
	Y = 15		General firmware (no reset possible).

[Autotransformer \(T3\),](#)

[Fuses \(F3.x\).](#)

DCF803-0050/0060 and DCF804-0050/0060 configuration (e.g., 2 motors)


The data exchange between SDCS-CON-H01 and DCF803-0050/0060 or DCF804-0050/0060 via serial communication is configured as a bus. This link is used to transfer references, actual values, and settings for up to two field exciters.

The firmware on the SDCS-CON-H01 provides two field exciter functions, one for motor 1 and one for motor 2.

Note: Only motors with the same electrical data, especially base speed, and maximum speed, can be run at the same time.

The communication works using a screened two-wire cable.

For distances see chapter DCSLink wiring.

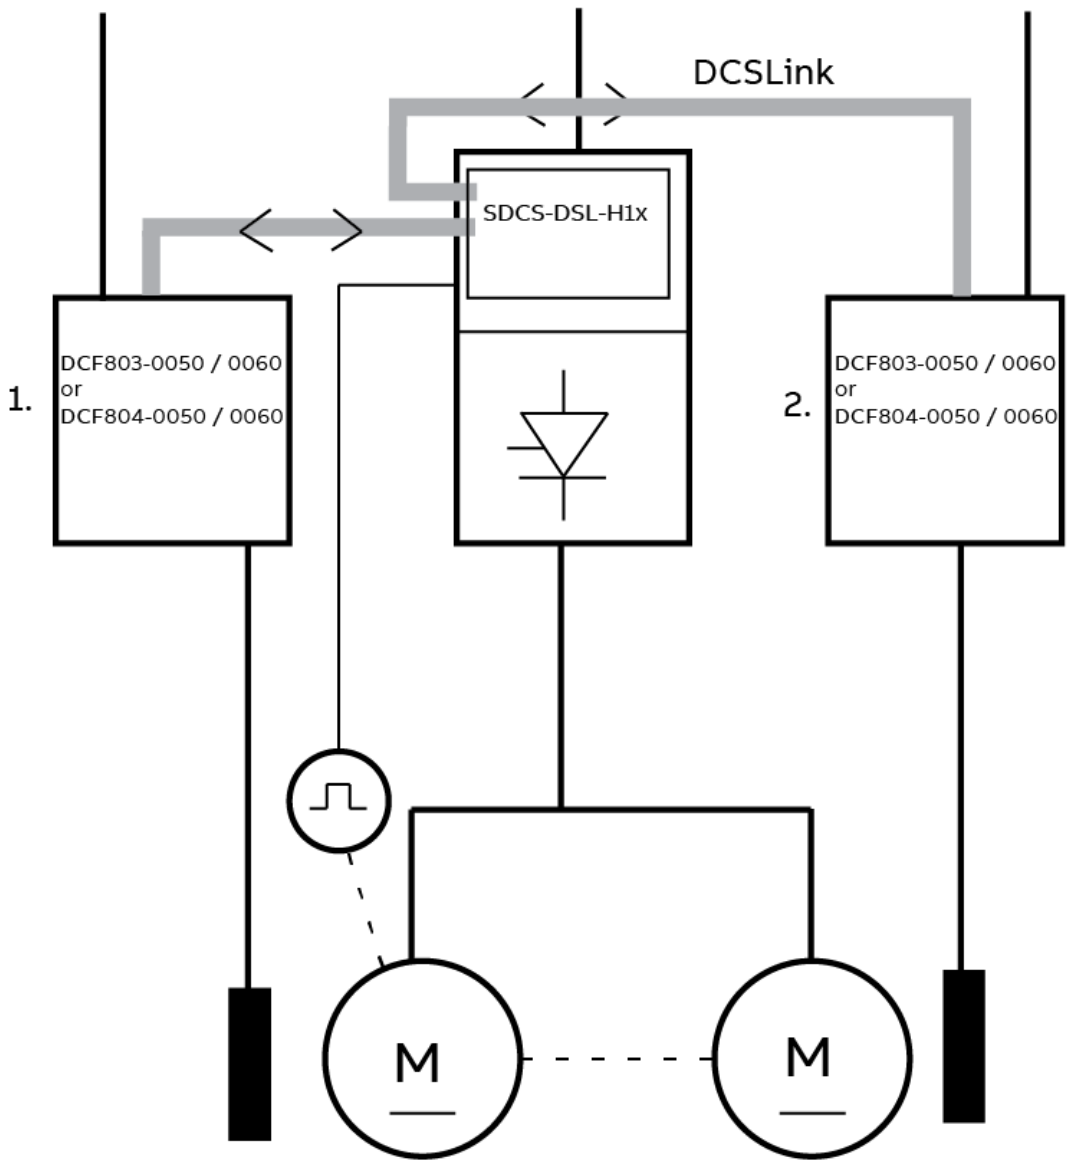

SB_DCF_002_b.ai


Connection example

The DCSELink communication is activated by S1100:8 = ON.

The bus setting is made using S1100. The node numbers are set using S800 and S801.


Procedure to change the node number:

- Switch off the electronics supply voltage.
- Set the appropriate switch according to chapter [DCSELink communication](#).
- Switch on the electronics supply voltage.

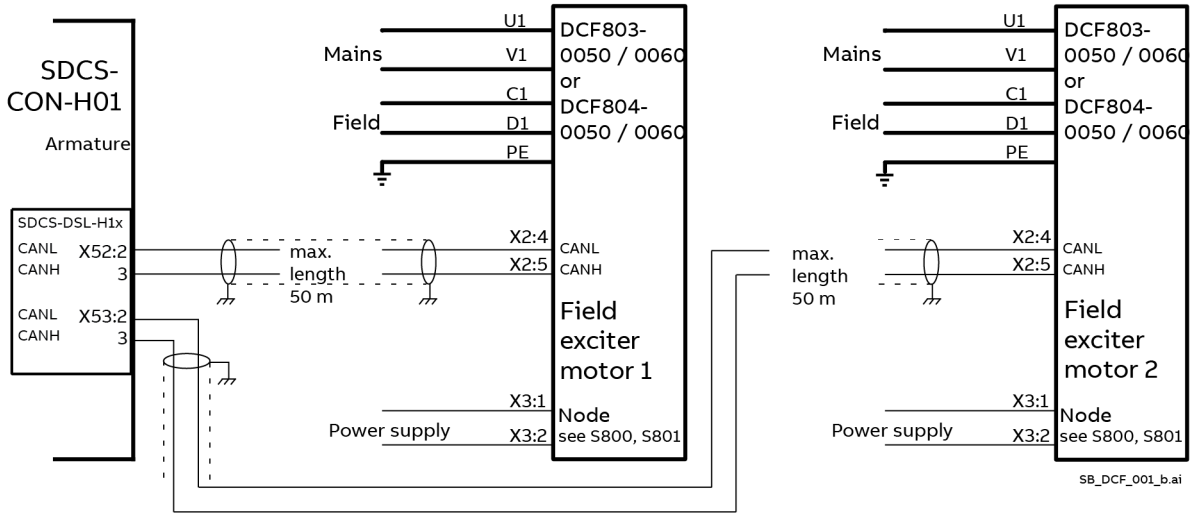


Note: As standard maximum 2 field exciters can be controlled by one DCS880.

DCF803-0050/DCF804-0050

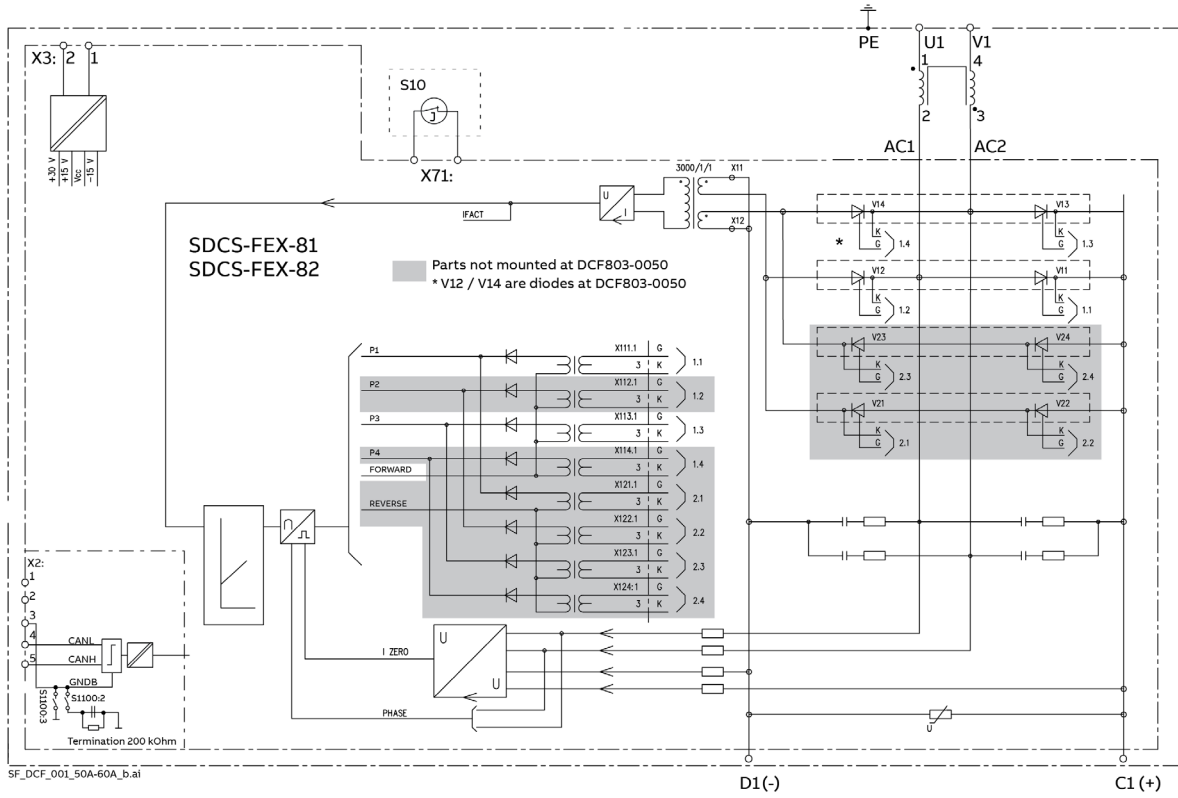

DCF803-0060/DCF804-0060

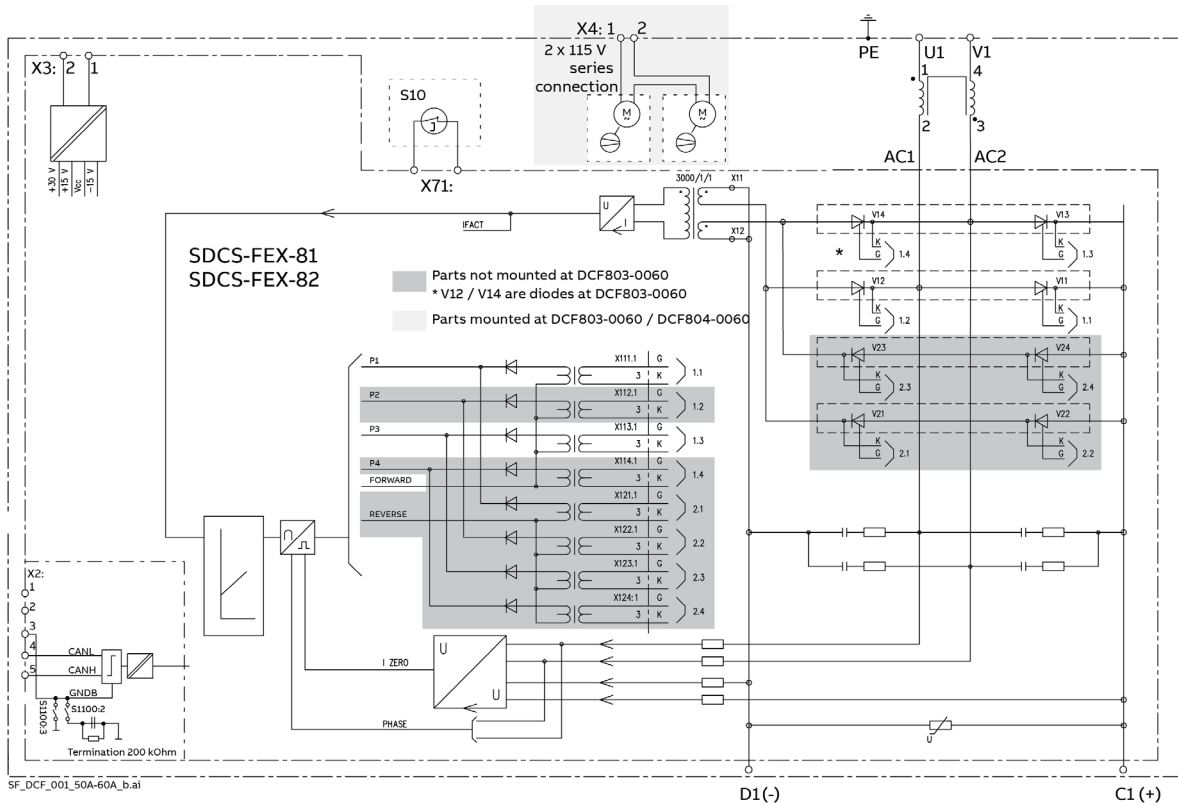


Dimensions

DCF803-0050

DCF804-0050

Dimensions in mm
Weight appr. 11 kg

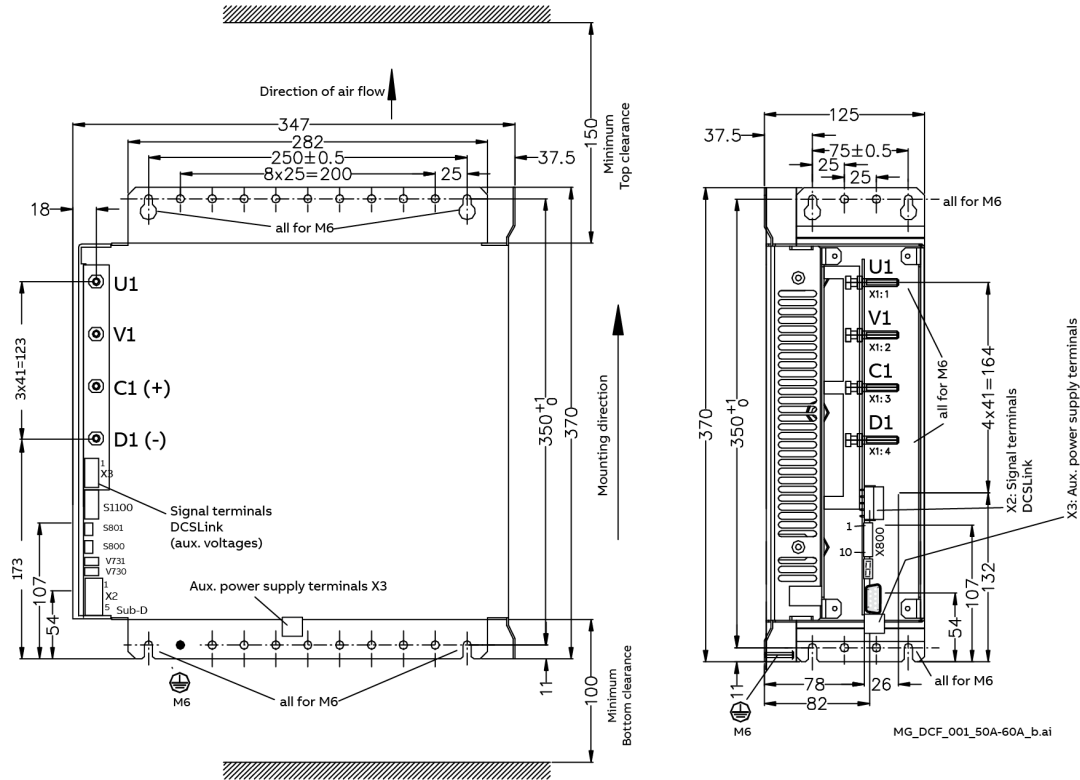


Note: In case of vibrating environments use fixing holes (A).

DCF803-0060

DCF804-0060


Dimensions in mm
Weight appr. 11 kg

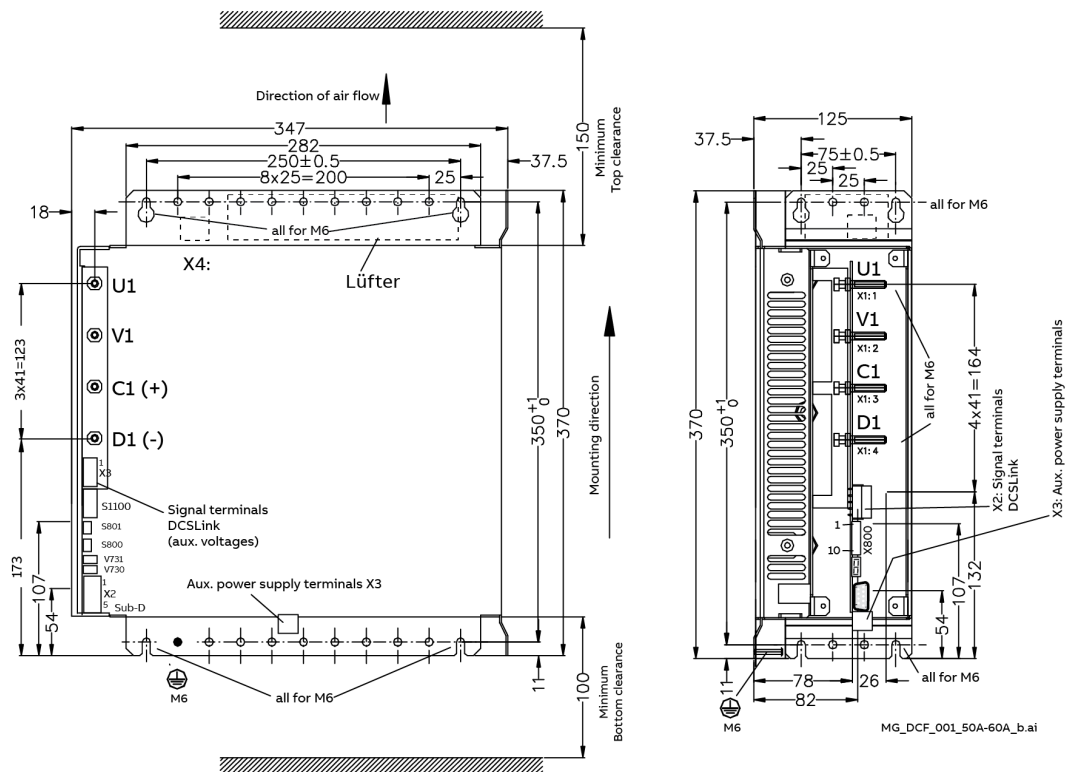




DCF505/DCF506 Overvoltage protection and large field exciters

Certain converter modules sizes H1 ... H4 can be used as motor field supply. This operation needs separate active overvoltage protection DCF505 or DCF506. They protect the power part against inadmissibly high voltages.

The overvoltage protection activates a free-wheeling circuit between connectors F+ and F- in case an overvoltage occurs. The DCF505/506 consists of a trigger unit (SDCS-FEP-x) and a free-wheeling thyristor (two anti-parallel thyristors in a DCF506). To connect, use the same size wire as the field exciter. The DCF506 consists of a relay output to indicate a free-wheeling condition to the field converter. When the free-wheeling function is triggered, it will last until the DC current is less than 0.5 A. During this time the relay contacts are closed.

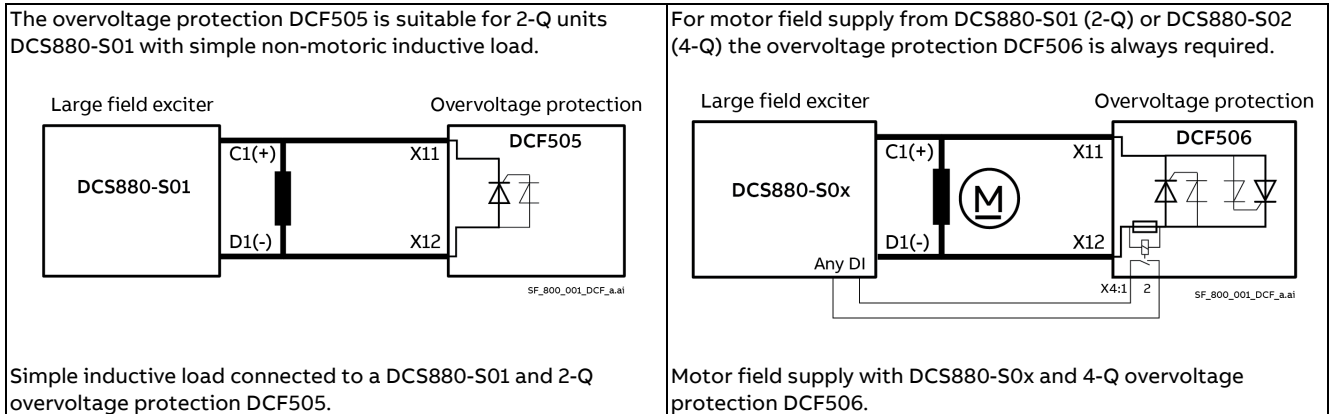




Assignment field supply converter, overvoltage protection and cross-sectional areas

Large field exciters for motor fields ①	Size	Overvoltage Protection	Cross-sectional areas		
			 [mm²]	 [Nm]	
X4		DCF505 DCF506	Flex cable 0.25 ... 1.5		0.5 ... 0.6
2-Q, 400 V/500 V (IEC)/525 V (UL)					
DCS880-S01-0020-04/05 DCS880-S01-0045-04/05 DCS880-S01-0065-04/05 DCS880-S01-0090-04/05	H1	DCF506-0140-51	1 x 4	1 x M8	13
DCS880-S01-0135-04/05 DCS880-S01-0180-04/05 DCS880-S01-0225-04/05 DCS880-S01-0270-04/05	H2	DCF506-0520-51	1 x 10	1 x M8	13
DCS880-S01-0315-04/05 DCS880-S01-0405-04/05	H3				
DCS880-S01-0610-04/05 ②	H4				
4-Q, 400 V/500 V (IEC)/525 V (UL)					
DCS880-S02-0025-04/05 DCS880-S02-0050-04/05 DCS880-S02-0075-04/05 DCS880-S02-0100-04/05	H1	DCF506-0140-51	1 x 4	1 x M8	13
DCS880-S02-0150-04/05 DCS880-S02-0200-04/05 DCS880-S02-0250-04/05 DCS880-S02-0300-04/05	H2	DCF506-0520-51	1 x 10	1 x M8	13
DCS880-S02-0350-04/05 DCS880-S02-0450-04/05	H3				
DCS880-S02-0680-04/05 ②	H4				


① Only these converter types are allowed to be used as large field exciters. A 10 % current de-rating is strongly recommended.

② Limited to 520 A_{DC} field current due to the overvoltage protection.

Inductive load supply for other applications	Overvoltage Protection	Cross-sectional areas		
		 [mm ²]	 [mm]	 [Nm]
4-Q, 400 V/500 V (IEC)/525 V (UL)				
DCS880-S0b-1200-04/05	DCF506-1200-51	1 x 25	1 x M8	13
DCS880-S0b-1500-04/05				
4-Q, 690 V				
DCS880-S0b-0900-07	DCF506-1500-71	1 x 25	1 x M8	13
DCS880-S0b-1500-07				

b = Bridge type

Diagram of overvoltage protection DCF505/DCF506.

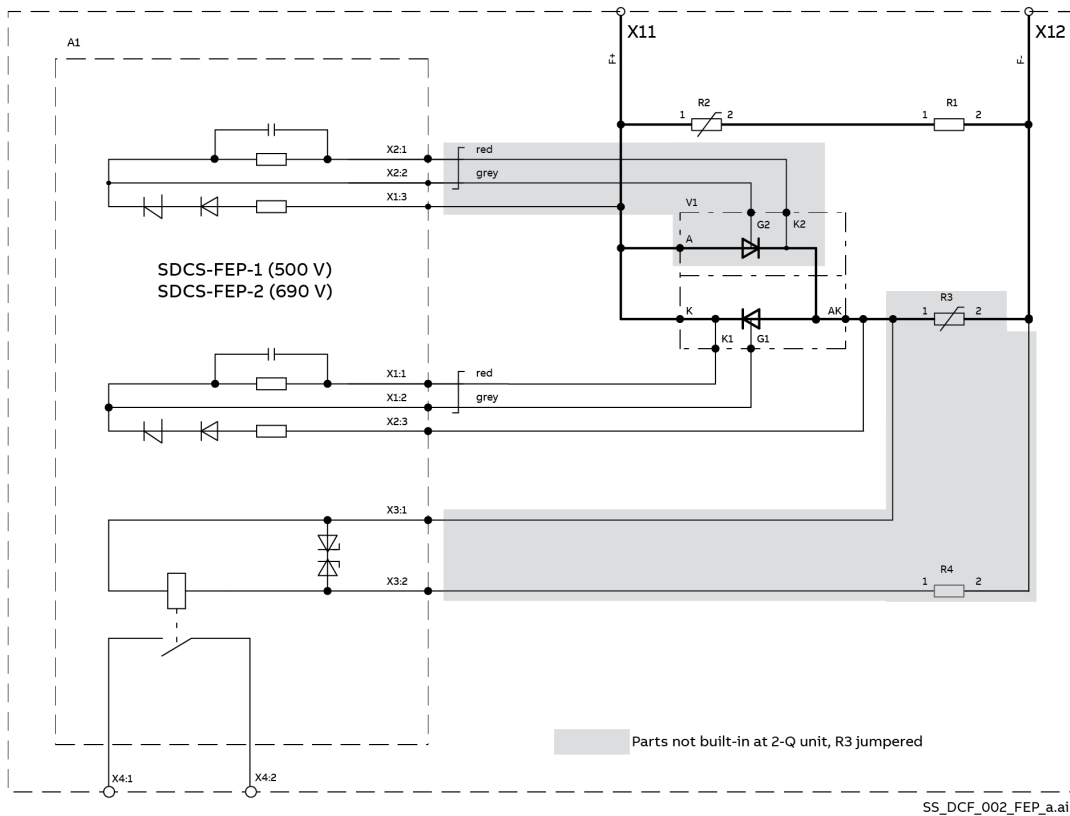

Layout of SDCS-FEP-1 / FEP-2.

	<p>Output X4:1, 2 Potential isolated by relay (NO contact). Contacts are not protected. Contact rating:</p> <ul style="list-style-type: none"> AC: ≤ 60 V~/≤ 50 mA~. DC: ≤ 60V-/≤ 50 mA-. <p>There are two trigger units in use:</p> <ul style="list-style-type: none"> SDCS-FEP-1 for systems, used for mains up to 500 V (IEC)/525 V (UL). This board is equipped with a 1,400 V trigger diode. SDCS-FEP-2 for systems, used for mains up to 690 V. This board is equipped with a 1,800 V trigger diode.
--	--

Accessories

Dimensions


Overvoltage protection

DCF506-0140-51

DCF506-0520-51

Dimensions in mm

Weight appr. 8 kg

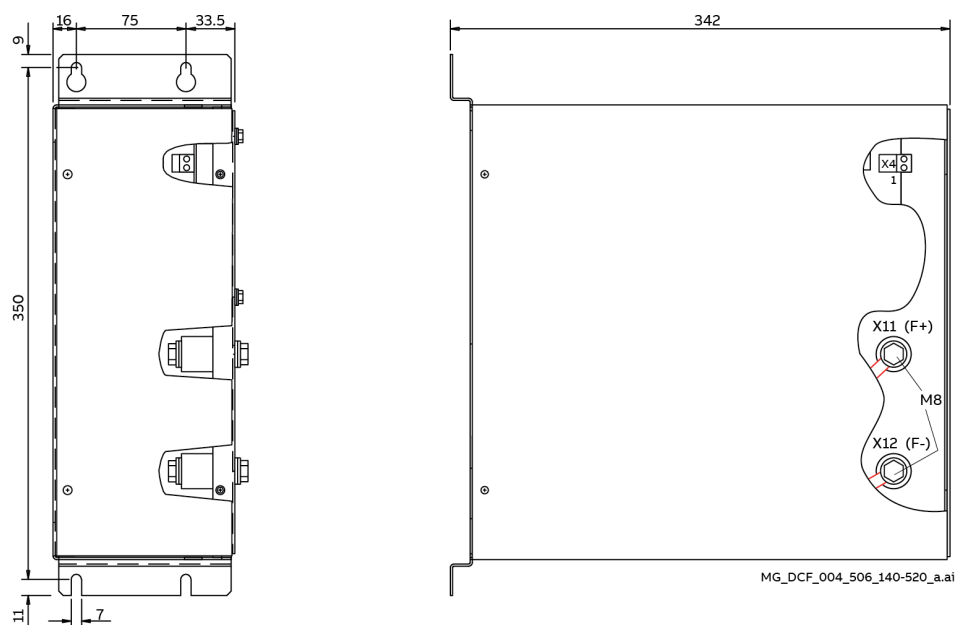


Overvoltage protection

DCF506-1200-51


DCF506-1500-71

Dimensions in mm

Weight appr. 20 kg

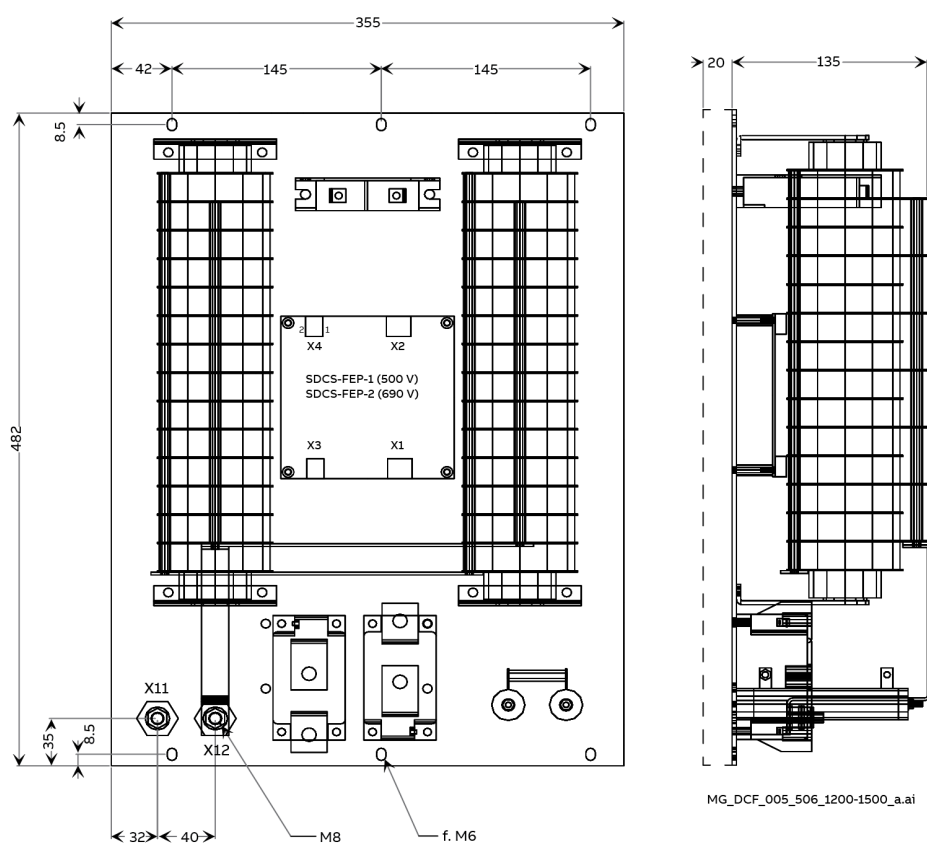

Fuses and fuse holders IEC



Semiconductor fuses and fuse holders for AC and DC power lines


The DCS880 size H1 ... H4 requires external mains fuses. For regenerative drives, DC fuses are recommended.

The 4th column of the table below assigns the AC fuse to the unit. In case the unit should be equipped with DC fuses, use the same type of fuse as used on the AC side.

Size	Converter type (2-Q)	Converter type (4-Q)	Fuse type	Fuse size	Resistance [mΩ]	Fuse holder
-	-	-	10A 660V UR	0	30	OFAZ 00 S3L
-	-	-	25A 660V UR		15	
H1	DCS880-S01-0020-05	DCS880-S02-0025-05	50A 660V UR		6	
	DCS880-S01-0045-05	DCS880-S02-0050-05	80A 660V UR		3	
	DCS880-S01-0065-05	DCS880-S02-0075-05	125A 660V UR	1.80		
	DCS880-S01-0090-05	DCS880-S02-0100-05				
H2	DCS880-S01-0135-05	DCS880-S02-0150-05	200A 660V UR	1	0.87	OFAZ 1 S3
	DCS880-S01-0180-05	DCS880-S02-0200-05	250A 600V UR		0.59	
	DCS880-S01-0225-05	DCS880-S02-0250-05	315A 660V UR	2	0.47	
	DCS880-S01-0270-05	DCS880-S02-0300-05	500A 660V UR		3	
H3	DCS880-S01-0290-06	DCS880-S02-0320-06				
	DCS880-S01-0315-05	DCS880-S02-0350-05				
	DCS880-S01-0405-05	DCS880-S02-0450-05	700A 660V UR		0.22	
	DCS880-S01-0470-05	DCS880-S02-0520-05				
H4	DCS880-S01-0590-06	DCS880-S02-0650-06	900A 660V UR	4	0.15	3 x 170H 3006
	DCS880-S01-0610-05	DCS880-S02-0680-05				
	DCS880-S01-0740-05	DCS880-S02-0820-05				
	DCS880-S01-0900-05	DCS880-S02-1000-05	1250A 660V UR		0.09	


Dimensions of fuses

Size 0 ... 3

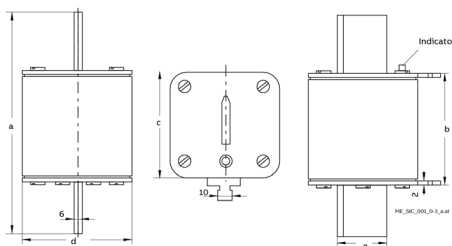

Size	a [mm]	b [mm]	c [mm]	d [mm]	e [mm]
0	78.5	50	35	21	15
1	135	69	45	45	20
2	150	69	55	55	26
3	150	68	76	76	33


Size 4

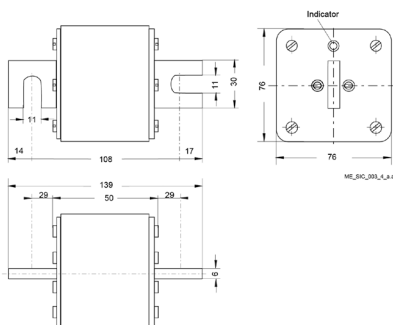


Accessories

Dimensions of fuse holders

OFAZ xx xxx

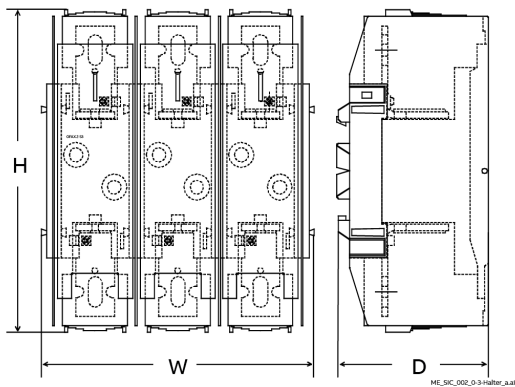

170H 3006 (IP00)

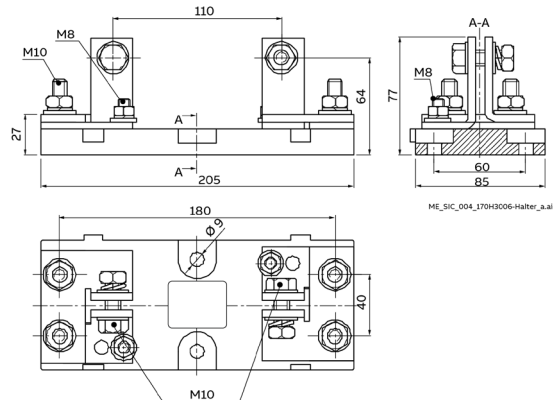

Fuse holder	H x W x D [mm]	Protection
OFAZ 00 S3L	148 x 112 x 111	IP20
OFAZ 1 S3	250 x 174 x 123	IP20
OFAZ 2 S3	250 x 214 x 133	IP20
OFAZ 3 S3	265 x 246 x 160	IP20

Line reactors IEC

Line reactors type ND01 ... ND17 ($u_k = 1\%$)

Line reactors of Types ND01 ... ND17 are sized to the unit's nominal current and frequency (50/60 Hz). These line reactors with a u_k of 1 % are designed for use in industrial environment (minimum requirements). They have a low inductive voltage drop, but deep commutation notches. Line reactors ND01 ... ND06 are equipped with cables. The larger ones ND07 ... ND17 are equipped with busbars.


When connecting them to other components, please consider relevant standards in case the busbar materials are different.

Attention: Do not use reactor terminals as cable or busbar support!

Line reactor ($u_k = 1\%$)	L [μ H]	I_{RMS} [A]	I_{peak} [A]	Rated voltage [V]	Weight [kg]	Power losses	
						FE [W]	Cu [W]
ND01	512	18	27	500	2.0	5	16
ND02	250	37	68	500	3.0	7	22
ND03 ①	300	37	68	600	3.8	9	20
ND04	168	55	82	500	5.8	10	33
ND05 ①	135	82	122	600	6.4	5	30
ND06	90	102	153	500	7.6	7	41
ND07	50	184	275	500	12.6	45	90
ND08	56.3	196	294	600	12.8	45	130
ND09	37.5	245	367	500	16.0	50	140
ND10	25	367	551	500	22.2	80	185
ND11 ①	33.8	326	490	600	22.6	80	185
ND12	18.8	490	734	500	36.0	95	290
ND112	13	698	1047	525	35.0	490	
ND13	18.2	698	1047	690	46.8	170	160
ND14	9.9	930	1395	500	46.6	100	300
ND15	10.9	1163	1744	690	84.0	190	680
ND16	6.1	1510	2264	500	81.2	210	650
ND17	4	1800	2700	800	86.0	250	700

① Not used for DCS880.


Line reactors type ND01 ... ND06

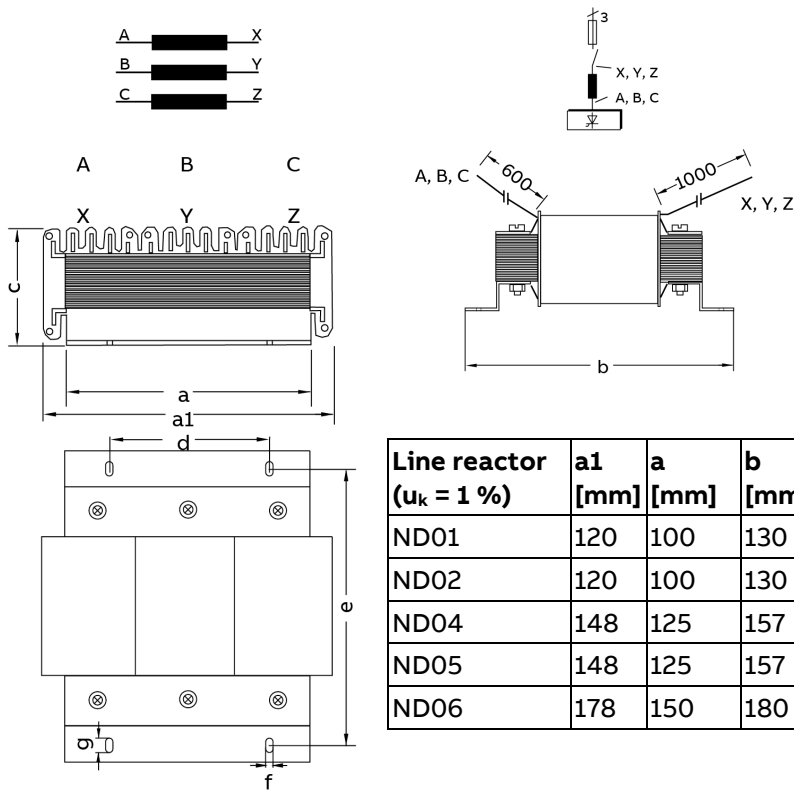

ME_DRO_001_ND1-6_a.ai

Line reactor ($u_k = 1\%$)	a1 [mm]	a [mm]	b [mm]	c [mm]	d [mm]	e [mm]	f [mm]	g [mm]	[mm ²]
ND01	120	100	130	48	65	116	4	8	6
ND02	120	100	130	58	65	116	4	8	10
ND04	148	125	157	78	80	143	5	10	16
ND05	148	125	157	78	80	143	5	10	25
ND06	178	150	180	72	90	170	5	10	35


Line reactors type ND07 ... ND12

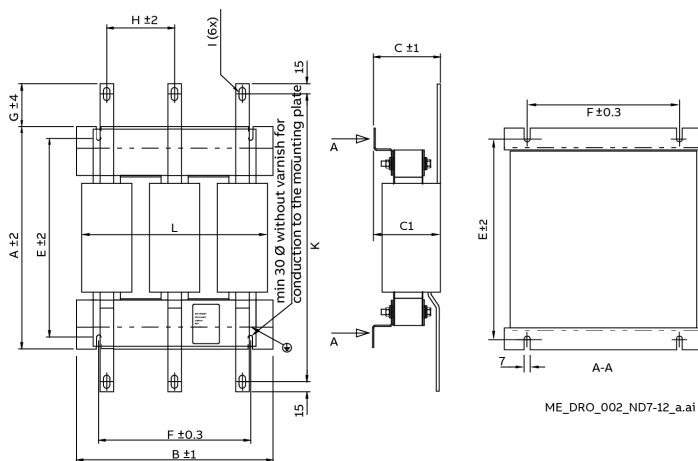


ME_DRO_002_ND7-12_a.ai

Line reactor ($u_k = 1\%$)	A [mm]	B [mm]	C [mm]	C1 [mm]	E [mm]	F [mm]	G [mm]	H [mm]	I [mm]	K [mm]	L [mm]	Busbar	Torque [Nm]
ND07, 08	285	230	86	100	250	176	65	80	9 x 18	385	232	20 x 4	M6 6
ND09	327	250	99	100	292	224	63	100	9 x 18	423	280	30 x 5	
ND10, 11	408	250	99	100	374	224	63	100	11 x 18	504	280	30 x 6	
ND12	458	250	112	113	424	224	63	100	13 x 18	554	280	40 x 6	


Line reactor type ND112

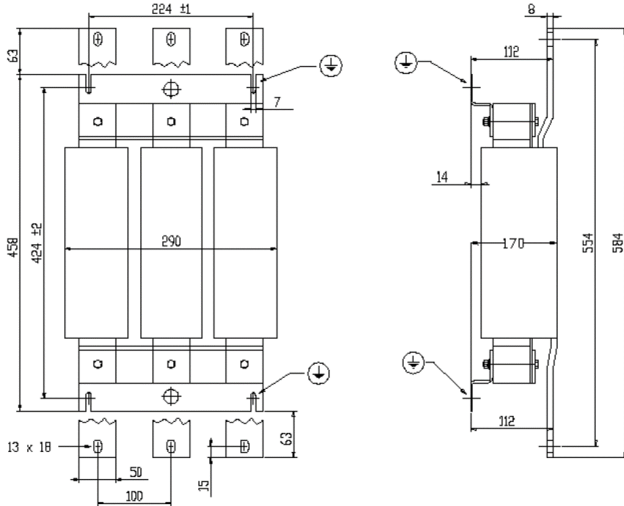

Tightening torque


Line reactor ($u_k = 1\%$)		Torque [Nm]
ND112	M6	6

Line reactors type ND13, 14 all busbars are 40 x 10

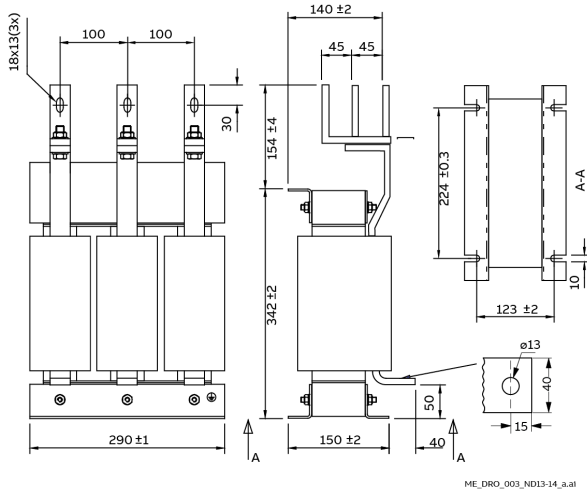


ME_DRO_003_ND13-14_a.ai

Tightening torque


Line reactor ($u_k = 1\%$)		Torque [Nm]
ND13, 14	M10	25

Line reactors type ND15, 16 all busbars are 60 x 10

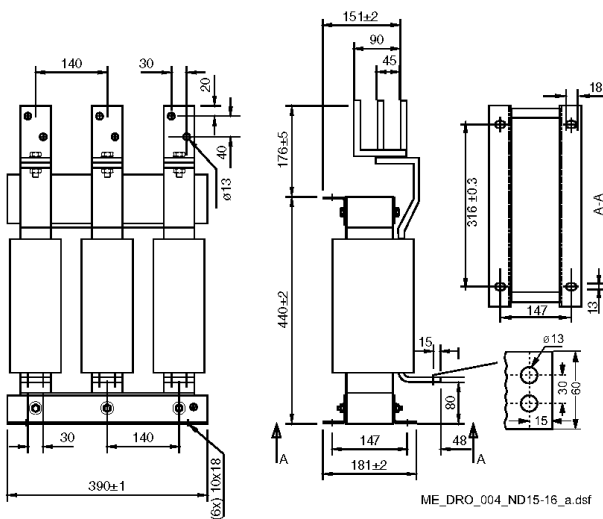


ME_DRO_004_ND15-16_a.dsf


Tightening torque

Line reactor ($u_k = 1\%$)		Torque [Nm]
ND15, 16	M12	50

Line reactors type ND17

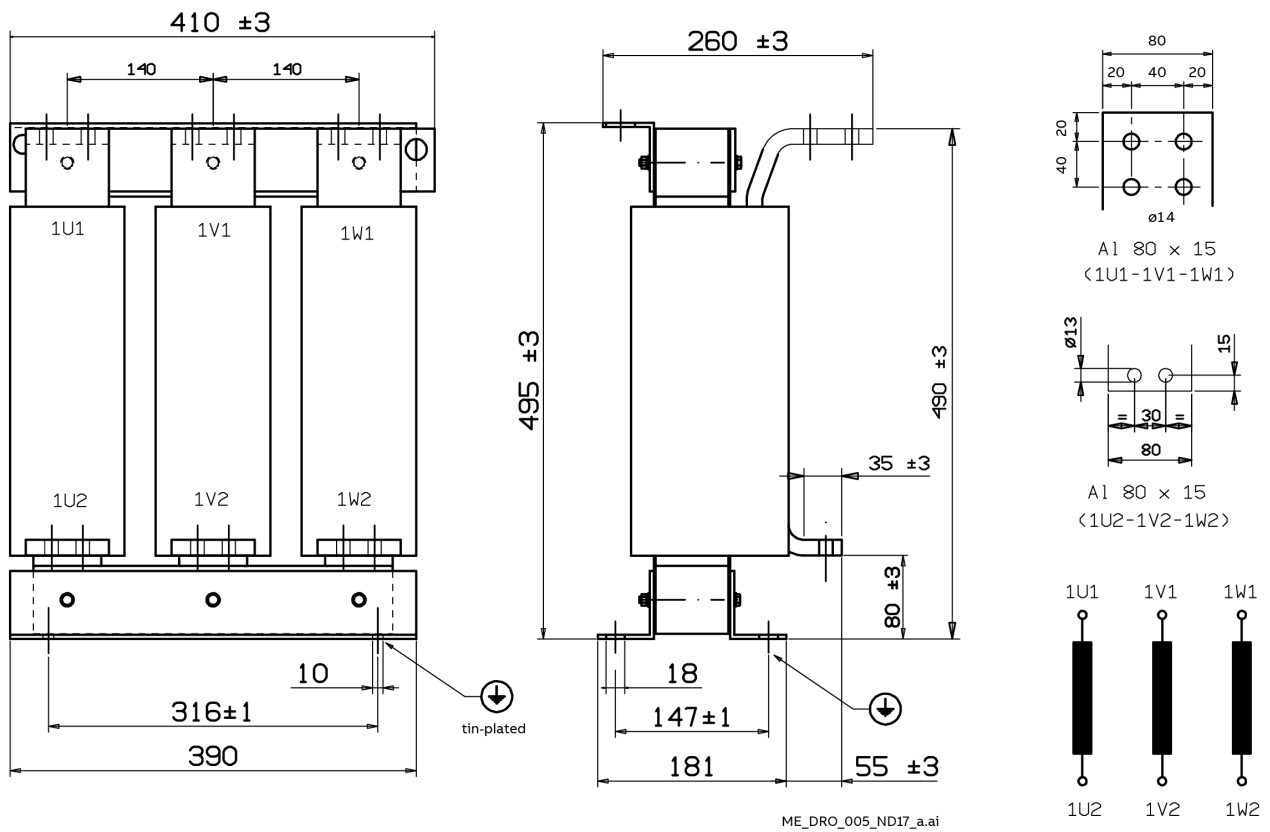

Tightening torque

Line reactor ($u_k = 1\%$)	 Torque [Nm]
ND17	M12 50

Line reactors type ND401 ... ND413 ($u_k = 4\%$)

Line reactors of types ND401 ... ND413 are sized to the unit's nominal current and frequency (50/60 Hz). These line reactors with a u_k of 4 % are designed for use in light industrial / residential environment. They have a high inductive voltage drop, but reduced commutation notches. These line reactors are designed for drives, which usually operate in speed control mode with 400 V_{AC} or 500 V_{AC} mains. Thus, the load cycle must be considered. The percentage which is to be considered for that duty cycle is different depending on the mains.


- For $U_{\text{Mains}} = 400 \text{ V}_{\text{AC}}$ follows $I_{\text{DC1}} = 90\%$ of nominal current.
- For $U_{\text{Mains}} = 500 \text{ V}_{\text{AC}}$ follows $I_{\text{DC2}} = 72\%$ of nominal current.

Line reactors ND401 ... ND402 are equipped with terminals. The larger ones ND403 ... ND413 are equipped with busbars. When connecting them to other components, please consider relevant standards in case the busbar materials are different.

Attention: Do not use the line reactor terminals as cable or busbar support!


Line reactor ($u_k = 4\%$)	L [μH]	I_{RMS} [A]	I_{peak} [A]	Rated voltage [V]	Weight [kg]	Power losses		DC current for $U_{\text{mains}} = 400 \text{ V}_{\text{AC}}$	DC current for $U_{\text{mains}} = 500 \text{ V}_{\text{AC}}$
						FE [W]	Cu [W]		
ND401	1000	18.5	27	400	3.5	13	35	22.6	18
ND402	600	37	68		7.5	13	50	45	36
ND403	450	55	82		11	42	90	67	54
ND404	350	74	111		13	78	105	90	72
ND405	250	104	156		19	91	105	127	101
ND406	160	148	220		22	104	130	179	143
ND407	120	192	288		23	117	130	234	187
ND408	90	252	387		29	137	160	315	252
ND409	70	332	498		33	170	215	405	324
ND410	60	406	609		51	260	225	495	396
ND411	50	502	753		56	260	300	612	490
ND412	40	605	805		62	280	335	738	590
ND413	35	740	1105		75	312	410	900	720


Line reactors type ND401, 402

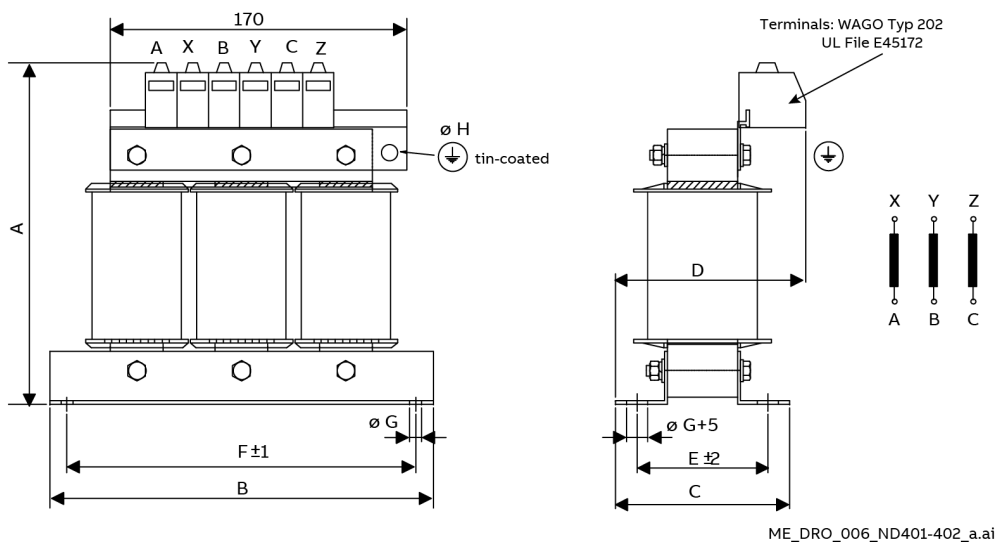


Line reactor ($u_k = 4\%$)	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	F [mm]	$\varnothing G$ [mm]	$\varnothing H$ [mm]	\varnothing Conductor [mm]
ND401	160	190	75	80	51	175	7	9	max. 10
ND402	200	220	105	115	75	200	7	9	max. 10


Line reactors type ND403 ... ND408

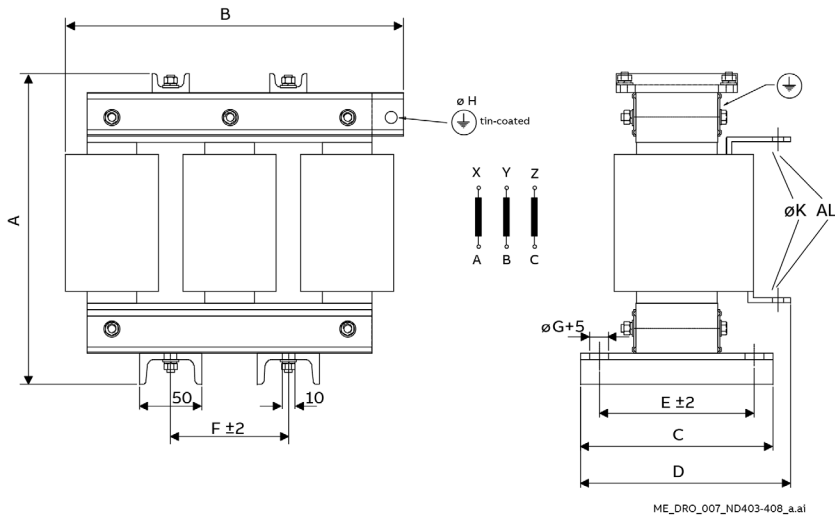

Line reactor (uk = 4%)	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	F [mm]	ØG [mm]	ØH [mm]	ØK [mm]		Torque [Nm]
ND403	220	230	120	135	100	77.5	7	9	6.6	M6	6
ND404	220	225	120	140	100	77.5	7	9	6.6		
ND405	235	250	155	170	125	85	10	9	6.6		
ND406	255	275	155	175	125	95	10	9	9	M8	18
ND407	255	275	155	175	125	95	10	9	11	M10	37
ND408	285	285	180	210	150	95	10	9	11		

Line reactors type ND409 ... ND413

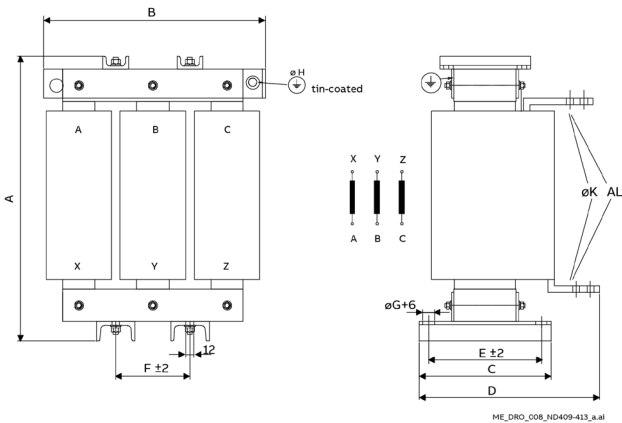


Line reactor (uk = 4%)	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	F [mm]	ØG [mm]	ØH [mm]	ØK [mm]		Torque [Nm]
ND409	320	280	180	210	150	95	10	11	11	M10	37
ND410	345	350	180	235	150	115	10	13	14	M12	63
ND411	345	350	205	270	175	115	12	13	2 * 11	M10	37
ND412	385	350	205	280	175	115	12	13	2 * 11		
ND413	445	350	205	280	175	115	12	13	2 * 11		

Autotransformer (T3)

Autotransformer (T3)	Field current [A]	Secondary current [A]	Weight [kg]	Power losses [W]	Fuse F3.2 [A]
		$U_1 = 500 \text{ V} \pm 10 \%$, 50/60 Hz			
T3, 01	$I_F \leq 6$	≤ 7	15	65	10
T3, 02	$I_F \leq 12$	≤ 13	20	100	16
T3, 03	$I_F \leq 16$	≤ 17	20	120	25
T3, 04	$I_F \leq 30$	≤ 33	36	180	50
T3, 05	$I_F \leq 50$	≤ 57	60	250	63
		$U_1 = 690 \text{ V} \pm 10 \%$, 50/60 Hz			
T3, 11	$I_F \leq 6$	≤ 7 ①	15	80	10
T3, 12	$I_F \leq 12$	≤ 13 ①	20	125	16
T3, 13	$I_F \leq 16$	≤ 17 ①	30	150	20
T3, 14	$I_F \leq 30$	≤ 33 ①	60	230	50
T3, 15	$I_F \leq 50$	≤ 57	60	320	63



① The 690 V autotransformer input cannot be used for the field converters DCF803-0016, FEX-425-Int and DCF803-0035 (maximum isolation voltage is 600 V).

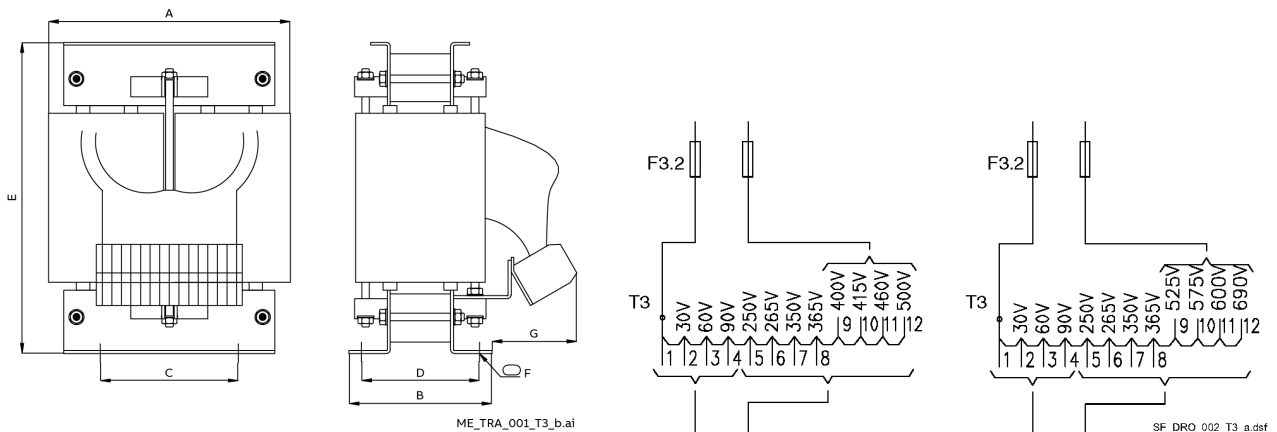



Autotransformer (T3)	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	F [mm]	Ø G [mm]
T3, 01/T3, 11	210	110	112	75	240	10 x 18	95
T3, 02/T3, 03/T3, 12	210	135	112	101	240	10 x 18	95
T3, 13	230	150	124	118	270	10 x 18	95
T3, 04	260	150	144	123	330	10 x 18	95
T3, 05/T3, 14/T3, 15	295	175	176	141	380	12 x 18	95

Line reactor (L3)


The ND30 is used for single-phase connection of DCF803-0016, FEX-425-Int and DCF803-0035 up to a field current of 16 A.

Input voltage: max. 500 V
 Frequency: 50/60 Hz

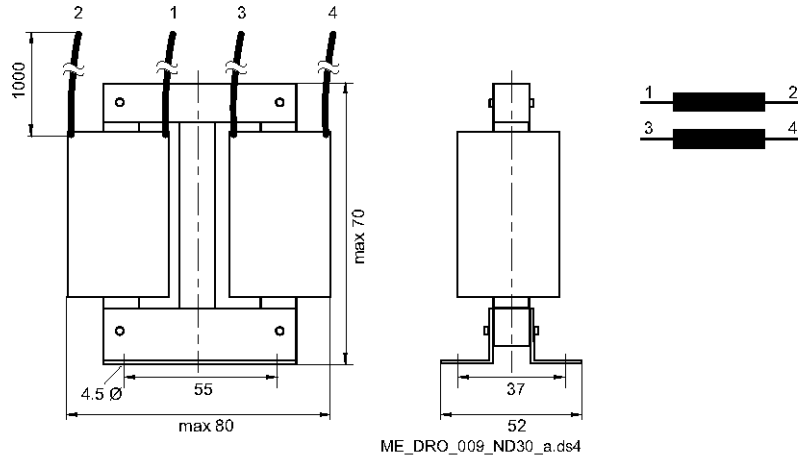


Line reactor (L3)	L3 [mH]	I _{RMS} [A]	I _{PEAK} [A]	Weight [kg]	Power losses [W]	 [mm2]
ND30	2 x > 500	16	16	1.1	8	2

Connection example

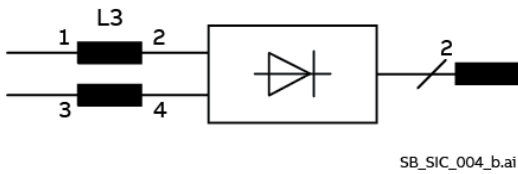

Auxiliary transformer (T2) for converter electronics and fans

The auxiliary transformer (T2) is designed to supply the module's electronics and cooling fans. One transformer's power and current allow supplying the single-phase fans and electronics of e.g., two H6 converters.



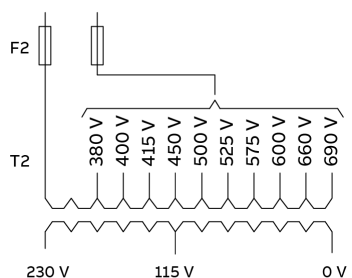


Input voltage: 230/380 ... 690 V_{AC} ±10 %, single-phase.

Input frequency: 50 ... 60 Hz.

Output voltage: 115/230 V_{AC} single-phase.

Transformer (T2)	Power [VA]	Weight [kg]	Power losses [W]	Fuse F2 [A]	Secondary current [A]
T2	1,400	15	100	16	6 @ 230 V 12 @ 115 V

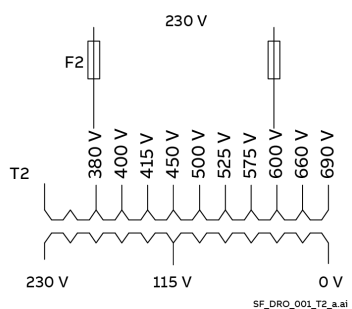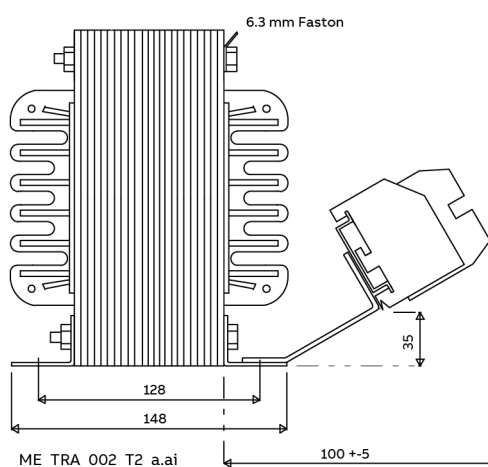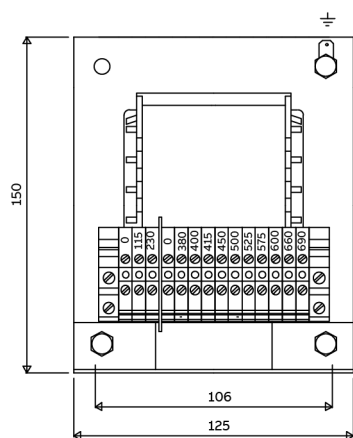


Commissioning hint:

T2 is designed to work as a 230 V_{AC} to 230 V_{AC} isolation transformer to open or avoid ground loops. Connect the 230 V_{AC} at the 380 V_{AC} and 600 V_{AC} tapings according to the drawing on the left-hand side.

Supply transformer (T8) for cooling fans


The three-phase autotransformer (T8) is designed to supply the cooling fan in a H8 converter.
Cooling fan: 460 V or 500 V.

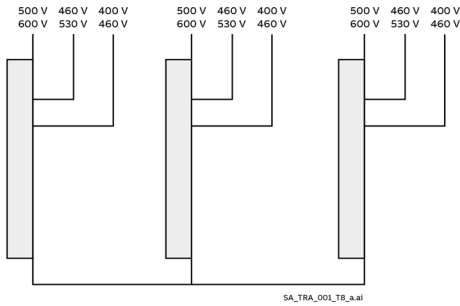


Input voltage: 500/460 V_{AC} or 600/530 V_{AC} ±15 %, 3-phase.
Input frequency: 50 ... 60 Hz.
Output voltage: 400 V_{AC} or 460 V_{AC} 3-phase.

Transformer (T8)	Power [VA]	Weight [kg]	Power losses [W]	Secondary current [A]
T8	5,580	20	16	7 @ 460 V

Connection example for cooling fan at 500 V_{AC}.

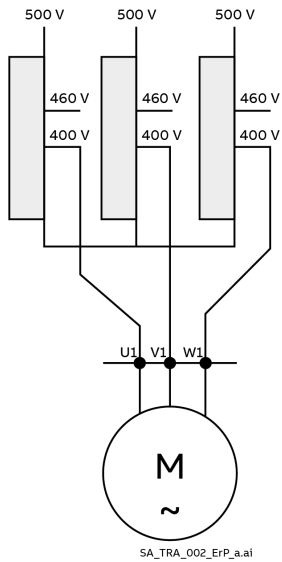

Dimensions

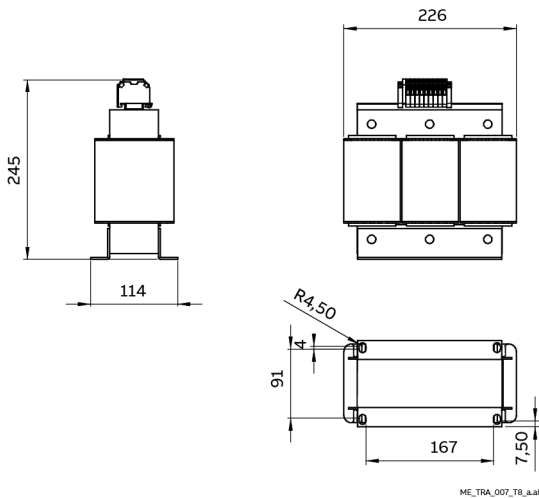

Accessories


Residual current detection

Schematic and function principle

In case it is required to measure the residual current the DCS880 can be connected via an SDCS-IOB-4 to a dedicated, special designed current transformer (CT). The dimensions of the current transformer need to be large enough to lead through all cables/busbars of the three phases.

The residual current detection via SDCS-IOB-4 board can only be used at grounded networks.

Below a schematic drawing of the residual current detection measurement circuit:

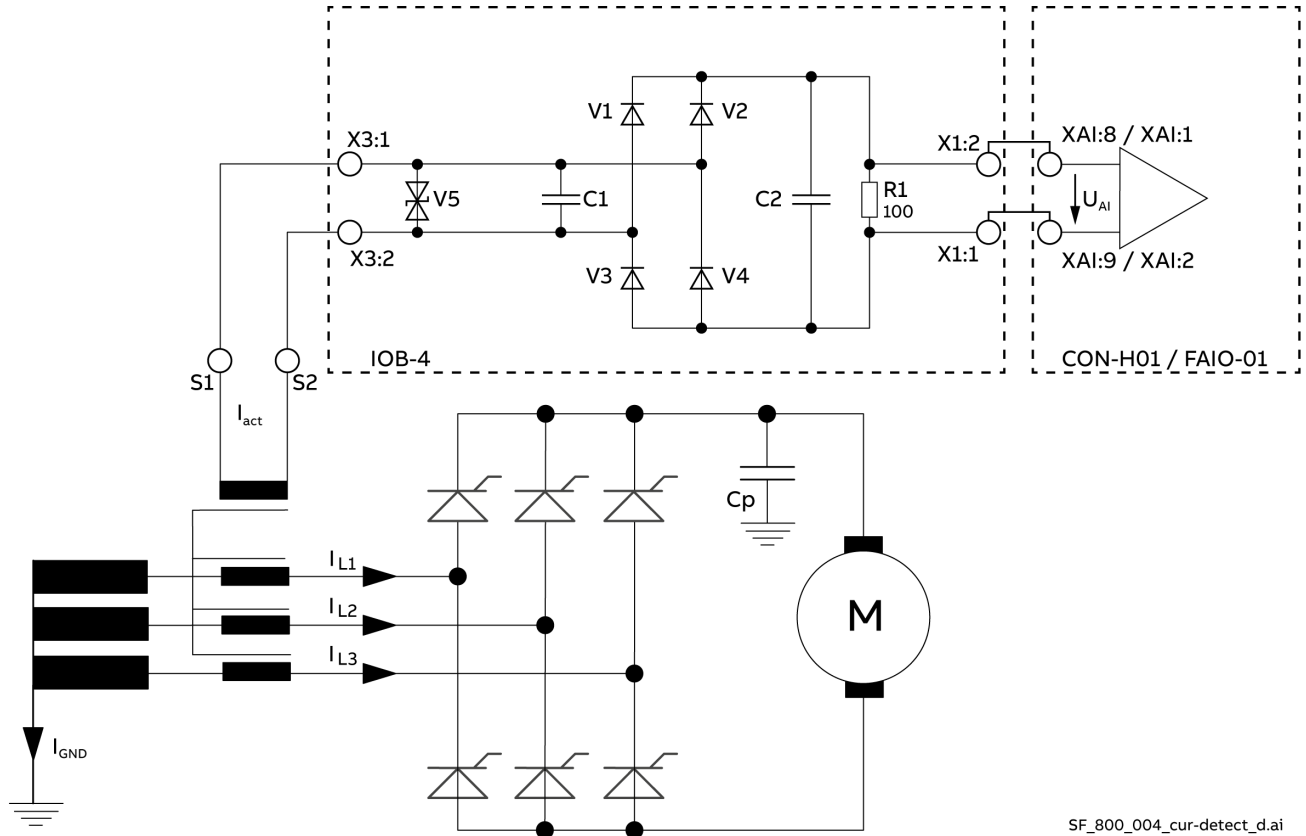

SF_800_004_cur-detect_d.ai

Electrical and mechanical data of the CTs

The SDCS-IOB-4 board can work with several different CTs, having different characteristics.

When doing the final mechanical work, make sure the conductors are placed symmetrically within the available cross-sectional area.

The CT might not have a built-in burden resistor. The output of the CT (S1, S2) has to be connected to the SDCS-IOB-4 input X3:1 and X3:2 via a shielded twisted pair cable (polarity does not matter).


The maximum cable length is 1 m.




Do not leave the pins S1 and S2 of the current transformer open as this can lead to high voltages at the terminal and thus to sparking.

In the following table typically used CT types and their image rated currents and transmission ratios are listed.

Type	Max current [A]	Transmission ratio
WR70x175S(P), WR115x3055(P), WR150x350S(P)	1500	600:1
KOKM 06 J23	2000	400:1

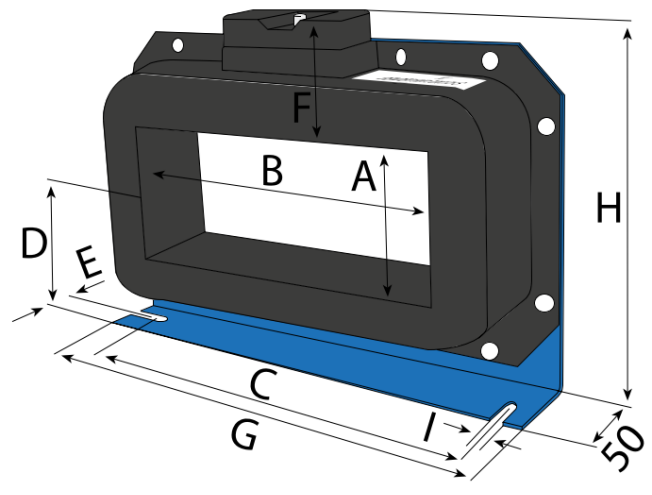

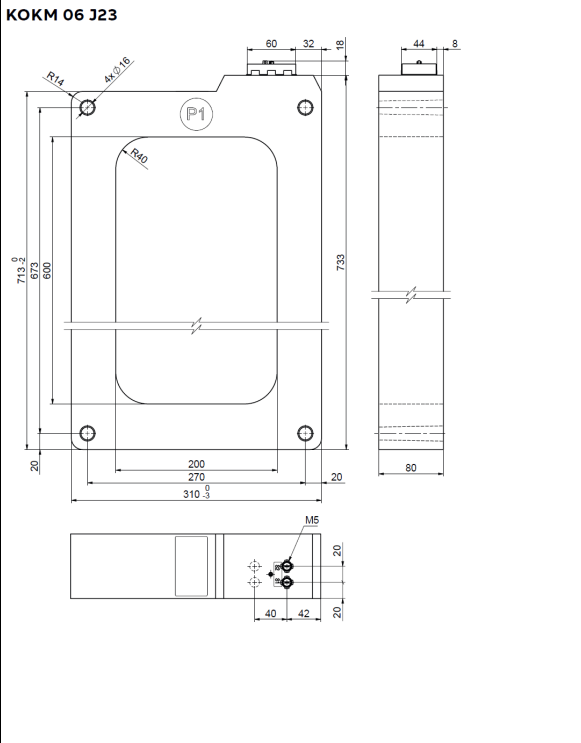


Dimensions and weights of CTs WR70x175S(P), WR115x3055(P) and WR150x350S(P)


Type	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	F [mm]	G [mm]	H [mm]	I [mm]	Weight [g]
WR70x175S(P)	70	175	225	85	22	46	261	176	7.5	2900
WR115x3055(P)	115	305	360	116	25	55	402	240	8	6300
WR150x350S(P)	150	350	415	140	28	55	460	285	8	8250

Electrical and mechanical data of the SDCS-IOB-4

The output of the SDCS-IOB-4 (X1:1 and X1:2) is connected to analog input AI3 (XAI:9 and XAI:8) of the DCS880 or to an FAIO-01 extension module (XAI1:2 and XAI1:1), via a shielded twisted pair cable. The maximum cable length is 1 m.

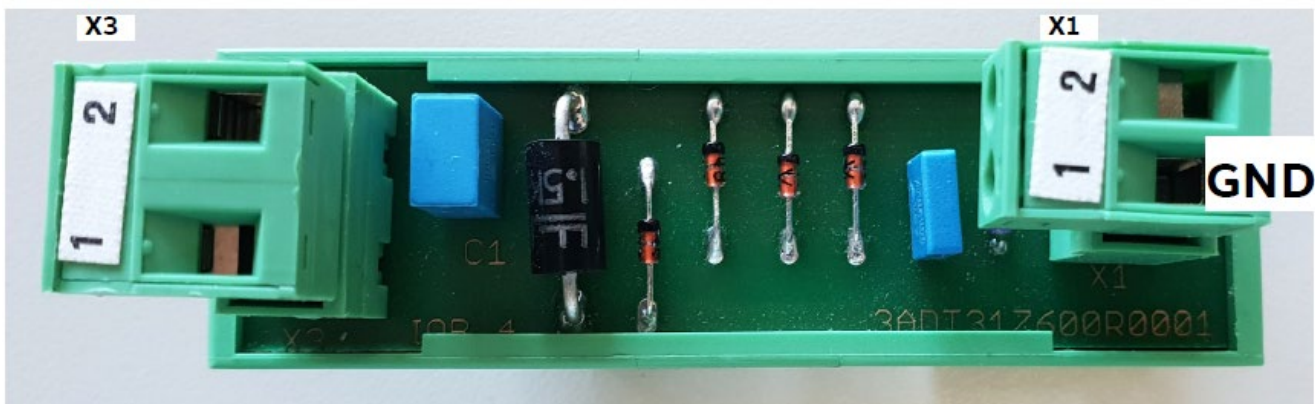


The SDCS-IOB-4 board is mounted on a DIN rail (35 mm) housing with the following dimensions:

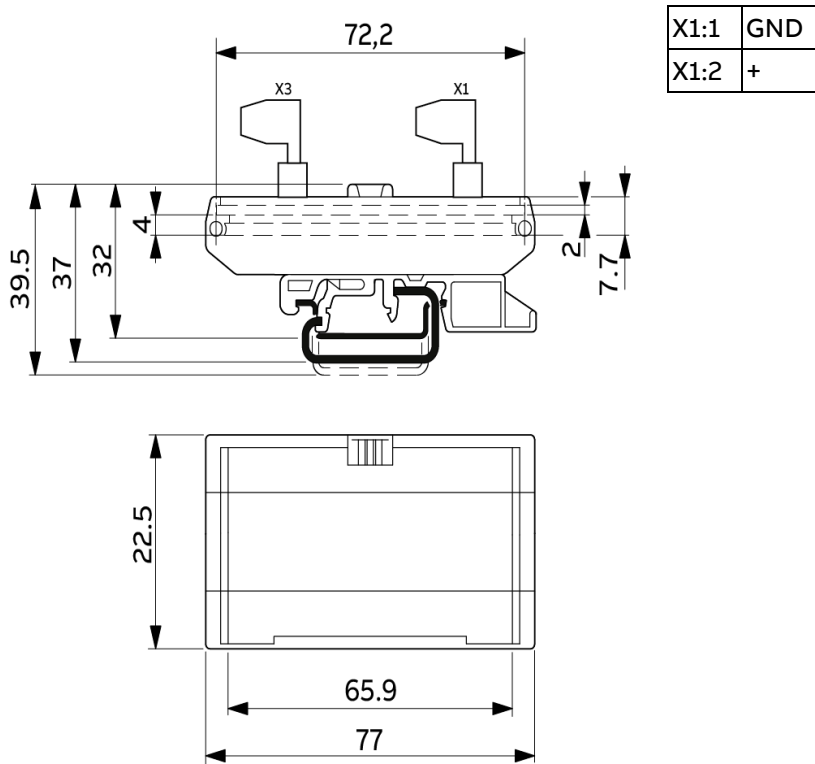

ME_STE_001_phoenix_a.ai

General information about the DCS880 residual current detection

The measurement of small currents via CT with large dimensions (see CTs in the table above) cannot provide accurate transfer ratios for small current values due to the coupling. The following diagram shows the recommended minimum residual current to ground detection corresponding to the nominal current/rating of the application.

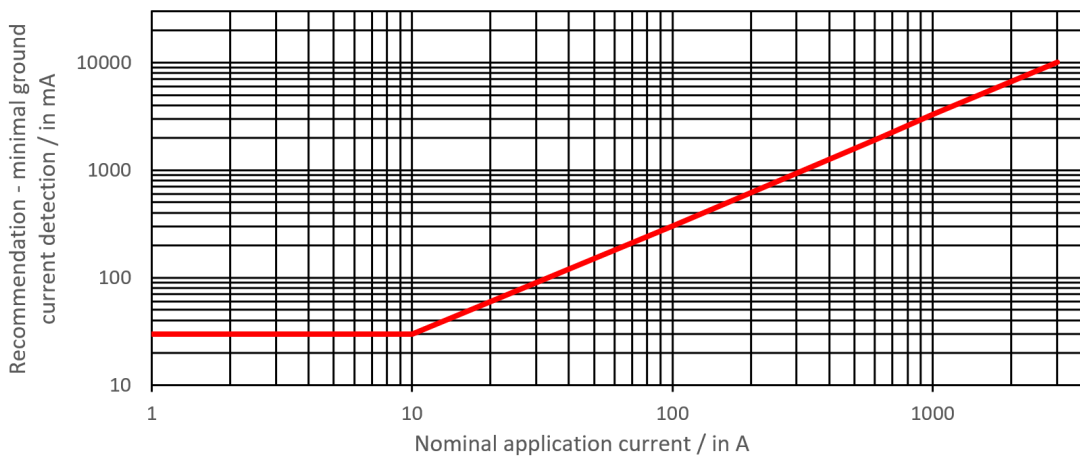

It is recommended to use a measurement adaptation factor (K_{adaption}). The measurement adaptation factor can be set to $K_{\text{adaption}} = 0.7$ for currents from 0.5 A ... 5 A.

The adaptation of the measurement can be adjusted via the scaling of the analog input to provide a correct residual current display.

The fault or warning function can be set in the user event functions in combination with the Adaptive Program (AP). The threshold value can be set in parameter group 47. Typical values are 0.5 A ... 5 A (see commissioning example).

Commissioning hints

As mentioned before, the application defines the maximum acceptable residual current to ground ($I_{\text{to gnd}}$).

The following equations provide an overview of the relation between measured analog input voltage and the residual current to ground.

CT	Current transformer ratio (for example 400).
K_{CT}	Magnetic coupling (depending on dimensions and current - CT type KOKM 06J23 coupling between 0.65 ... 0.9).
R_{burden}	100 Ω .
$K_{adaption}$	0.7 (recommended).
U_{AI}	Analog input voltage.
$I_{\text{gnd displayed}}$	Residual current to ground transmitted via the current transformer.
I_{gnd}	Actual residual current to ground.
$K_{adaption}$	Measurement adaption factor.
AI_{scale}	Analog Input scale factor to transform U_{AI} to $I_{\text{gnd displayed}} \sim I_{\text{gnd}}$.

$$U_{AI} = \frac{I_{\text{gnd displayed}}}{CT} * R_{burden} * K_{adaption} \text{ with } I_{\text{gnd displayed}} = I_{\text{gnd}} * K_{CT}$$

Therefore, the analog input scaling can be adapted to the residual current to ground by:

$$I_{\text{gnd displayed}} = \frac{U_{AI}}{R_{burden} * K_{adaption}} * CT = U_{AI} * \frac{CT}{R_{burden} * K_{adaption}} = U_{AI} * \frac{400}{100 \Omega * 0.7} = U_{AI} * AI_{\text{scale}}$$

The equation shows that $AI_{\text{scale}} \sim I_{\text{gnd displayed}}$. The value $I_{\text{gnd displayed}}$ is corresponding to the actual residual current to ground I_{gnd} with measurement accuracy of $\leq 20\%$.

After installation of all components, make sure to:

- Select AI3 or an analog input on the FAIO-01 module (set switches correctly) for the monitoring function via parameters or adaptive programming.
- Scale the analog input signal corresponding to the equations mentioned above.
- Activate the monitoring function via parameters or adaptive programming.
- Define the threshold in ampere via parameters or adaptive programming.
- If necessary, delay the fault message via parameters or adaptive programming to avoid actions caused by disturbances or similar effects.

Commissioning example using the Adaptive Program

The following example should give an overview about the mentioned steps in the commissioning hints. To adapt the analog input voltage and scale the residual current to ground set the value of $AI_{\text{scale max}}$ by:

$$I_{\text{gnd displayed}} = \frac{U_{AI}}{R_{burden} * K_{adaption}} * CT = U_{AI} * \frac{CT}{R_{burden} * K_{adaption}} = U_{AI} * \frac{400}{100 \Omega * 0.7} = U_{AI} * AI_{\text{scale}}$$

$$AI_{\text{scale max}} = 5.7143 * \frac{1}{\Omega} * U_{AI \text{ max}} = 5.7143 * \frac{1}{\Omega} * 10 \text{ V} = 57.143 \text{ A}$$


Example configuration of the analog input parameters:

Index	Name	Value	Unit	Min	Max	Default
12. Standard AI						
31	AI3 actual value	-0.002	V	-11,000	11,000	0,000
32	AI3 scaled value	0.000	NoUnit	-32768,...	32767,0...	0,000
34	AI3 offset	0.000	V	-0,100	0,100	0,000
36	AI3 filter time	0.100	s	0.000	30,000	0,100
37	AI3 min	0.000	V	-11,000	11,000	-10,000
38	AI3 max	10.000	V	-11,000	11,000	10,000
39	AI3 scaled at AI3 min	0.000	NoUnit	-32768,...	32767,0...	-100,000
40	AI3 scaled at AI3 max	57,143	NoUnit	-32768,...	32767,0...	100,000

It is recommended to set the filter time of the analog input to 100 ms to suppress 50 Hz and classic capacitive motor current ripple (see parameter 12.36). Following an example configuration of the threshold for the maximum acceptable residual current to ground (in mA):

Index	Name	Value	Unit	Min	Max	Default
47. Data storage						
11	Data storage 1 int32	1000	NoUnit	-21474...	214748...	0

The adaptive program in this example adapts 12.32 AI3 scaled value, here in A, to mA with the multiplier function block and compares the value with the threshold stored in parameter 47.11. See the adaptive program for residual current detection to ground with fault/warning event:

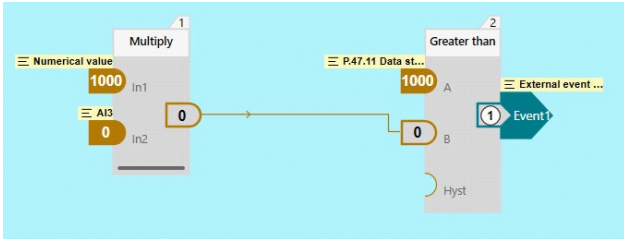

In this example the adaptive program will activate an event which can be set in parameter group 28.

Index	Name	Value	Unit	Min	Max	Default
28. Unit Faults						
1	External event 1 source	Adaptive program	NoUnit			Inactive
2	External event 1 type	Warning	NoUnit			Fault

More information can be found in the [DCS880 firmware manual](#) and the [Adaptive programming manual](#).

Optical cables

Different optical cables are available.

Kind of cable	Connector	Cable length	Ident number.	Figure
Plastic optic fiber single cable.	Plug	0.5 ... 30 m	3ADT693324P000x	1
Plastic optic fiber double cable.	Plug	0.5 ... 30 m	3ADT693318P000x	2
Plastic optic fiber double cable.	Plug	5 m	3ADT693752P0004	3
HCS silica (double) without plastic jacket.	Plug	30 ... 50 m	3ADT693355P00xx	4
HCS silica (double) with plastic jacket.	Plug	50 ... 200 m	3ADT693356P0xxx	5

Figure 1

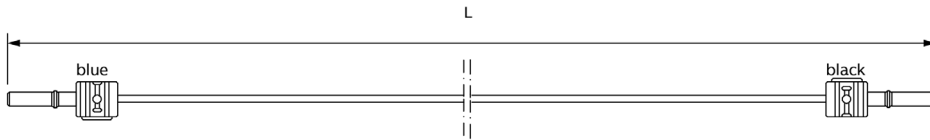


Figure 2

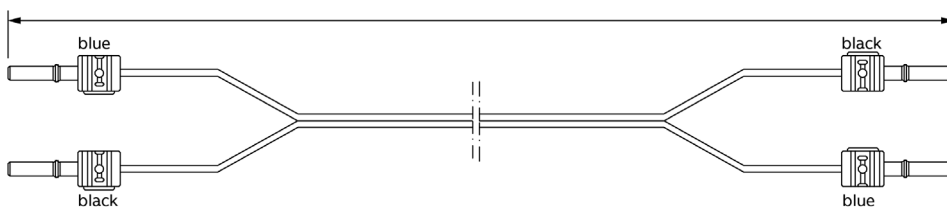


Figure 3

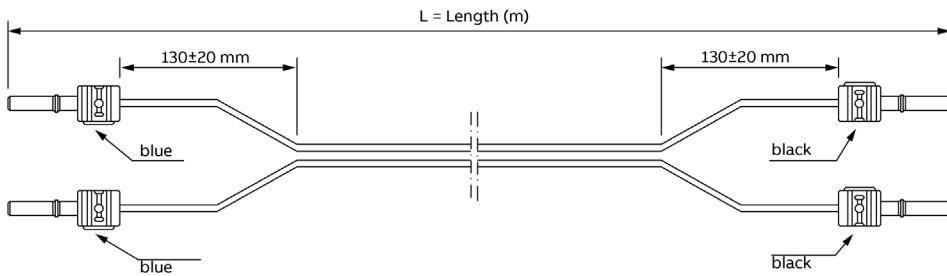


Figure 4



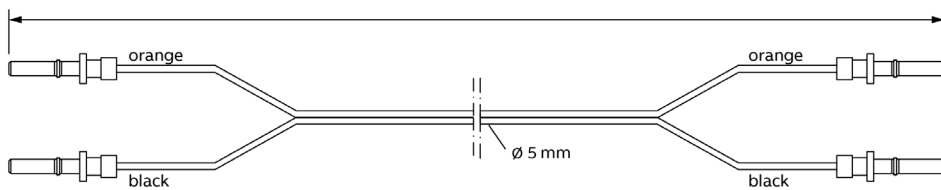


Figure 5

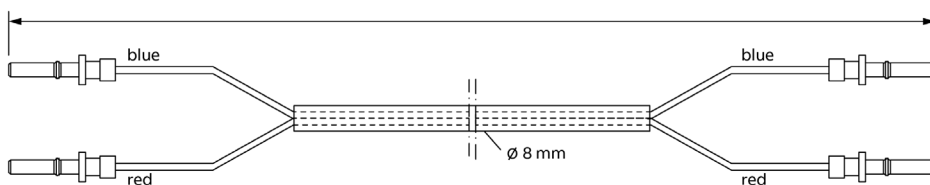

Other cables

DCSLink cable

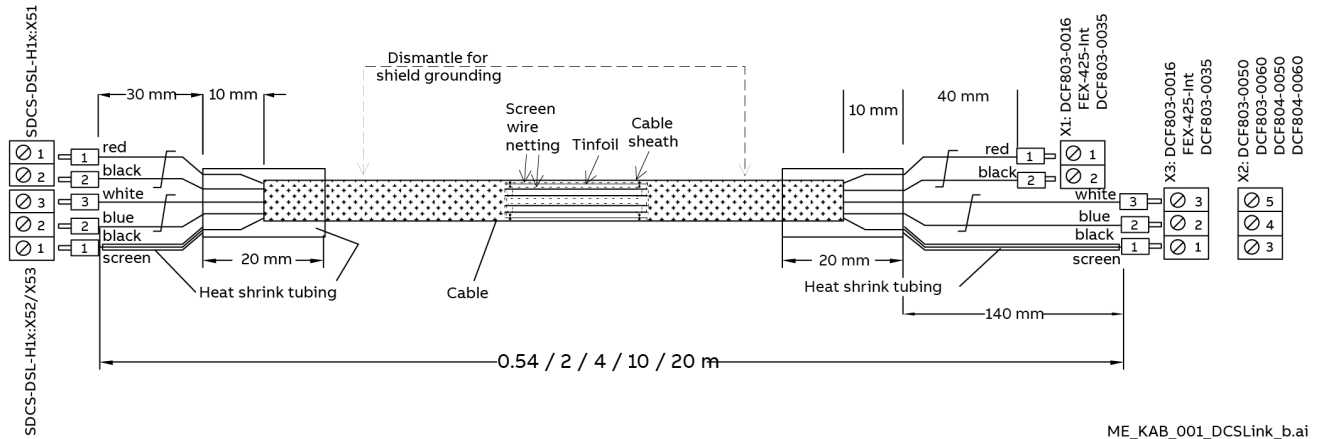

Recommended connectors

Option	Type	Manufactures description	Picture
FENA-x1	RJ45	HARTING RJ Industrial® 10G. Type: 09 45 151 1561.	
FBPA-01	D-Sub9	Subcon-Plus-Profibus. Type: 2744348.	
FCAN-01	D-Sub9	SUBCON-PLUS-CAN. Type: 2708119.	
FEN-xx	D-Sub9 or D-Sub 15 high density	MH Connectors Sub-D9, 90°. Type: MHDCMR09-K (just the housing, use standard D-Sub9 or D-Sub15 high density connectors).	

DCS Family



DCS550-S modules The compact drive for machinery application

20 ... 1,000 A_{DC}
0 ... 610 V_{DC}
230 ... 525 V_{AC}
IP00

- Compact
- Robust design
- Adaptive and winder program
- High field exciter current



DCS880 modules For safe productivity

20 ... 5,200 A_{DC}
0 ... 1,500 V_{DC}
230 ... 1,200 V_{AC}
IP00

- Safe torque off (STO) built in as standard
- Compact and robust
- Single drives, 20 A_{DC} to 5,200 A_{DC}, up to 1,500 V_{DC}
- IEC 61131 programmable
- Intuitive control panel and PC tool with USB connection and start up assistant
- Wide range of options to serve any DC motor application



DCS880-A enclosed converters Complete drive solutions

20 ... 20,000 A_{DC}
0 ... 1,500 V_{DC}
230 ... 1,200 V_{AC}
IP21 – IP54

- Suitable for motoric and non motoric applications (e.g. electrolysis & hydrogen production)
- Individually adaptable to customer requirements
- User-defined accessories like external PLC or automation systems can be included
- High power solutions in 6- and 12-pulse up to 20,000 A_{DC}, 1,500 V_{DC}
- In accordance to usual standards
- Individually factory load tested
- Detailed documentation



DCT880 modules Thyristor power controller

20 ... 4,200 A_{AC}
110 ... 990 V_{AC}
IP00

- Precise power control in industrial heating applications
- Two or three phase devices
- Power optimizer for peak load reduction
- Built on ABB's all-compatible drives architecture
- Intuitive control panel and PC tool with USB connection and start up assistant
- Application control programs and drive application programming with IEC 61131 programming



ABB AG

Wallstadter-Straße 59

68526 Ladenburg • Germany

Tel: +49 (0) 6203-71-0

Mail: dc-drives@de.abb.com

Web: www.abb.com/dc-drives

Ident. No.: 3ADW000462R0601 Rev F
12.2022



462R0601A2500000